

# CONSTRUCTION PLANS FOR IDALS PROJECT NO. WOR982203CN

SITE GRADING, BERM CONSTRUCTION, WATER CONTROL STRUCTURES,  
DRAINAGE TILE, RIPRAP, EROSION AND SEDIMENT CONTROL

## WORTH COUNTY, IOWA

SEPTEMBER 2023

### GOVERNING SPECIFICATIONS

THE SPECIFICATIONS AS PREPARED BY IOWA DEPARTMENT OF AGRICULTURE AND LAND STEWARDSHIP AND BOLTON & MENK, INC. SHALL BE CONSIDERED AS PART OF THIS DOCUMENT. NATURAL RESOURCES CONSERVATION SERVICE CONSTRUCTION SPECIFICATIONS SHALL APPLY.



THE CURRENT EDITION OF THE "IOWA STATEWIDE URBAN STANDARD SPECIFICATIONS FOR PUBLIC IMPROVEMENTS" SHALL GOVERN.

IOWA DEPARTMENT OF TRANSPORTATION "STANDARD SPECIFICATIONS FOR HIGHWAY AND BRIDGE CONSTRUCTION", SERIES 2021 AND ALL CURRENT GENERAL SUPPLEMENTAL SPECIFICATIONS AND MATERIALS INSTRUCTIONAL MEMORANDUM SHALL GOVERN AS REFERENCED.

ALL APPLICABLE FEDERAL, STATE, AND LOCAL LAWS AND ORDINANCES WILL BE COMPLIED WITH IN THE CONSTRUCTION OF THIS PROJECT.



THE SUBSURFACE UTILITY INFORMATION IN THIS PLAN IS UTILITY QUALITY LEVEL D. THIS UTILITY QUALITY LEVEL WAS DETERMINED ACCORDING TO THE GUIDELINES OF CI/ASCE 38-02, ENTITLED "STANDARD GUIDELINES FOR THE COLLECTION AND DEPICTION OF EXISTING SUBSURFACE UTILITY DATA."

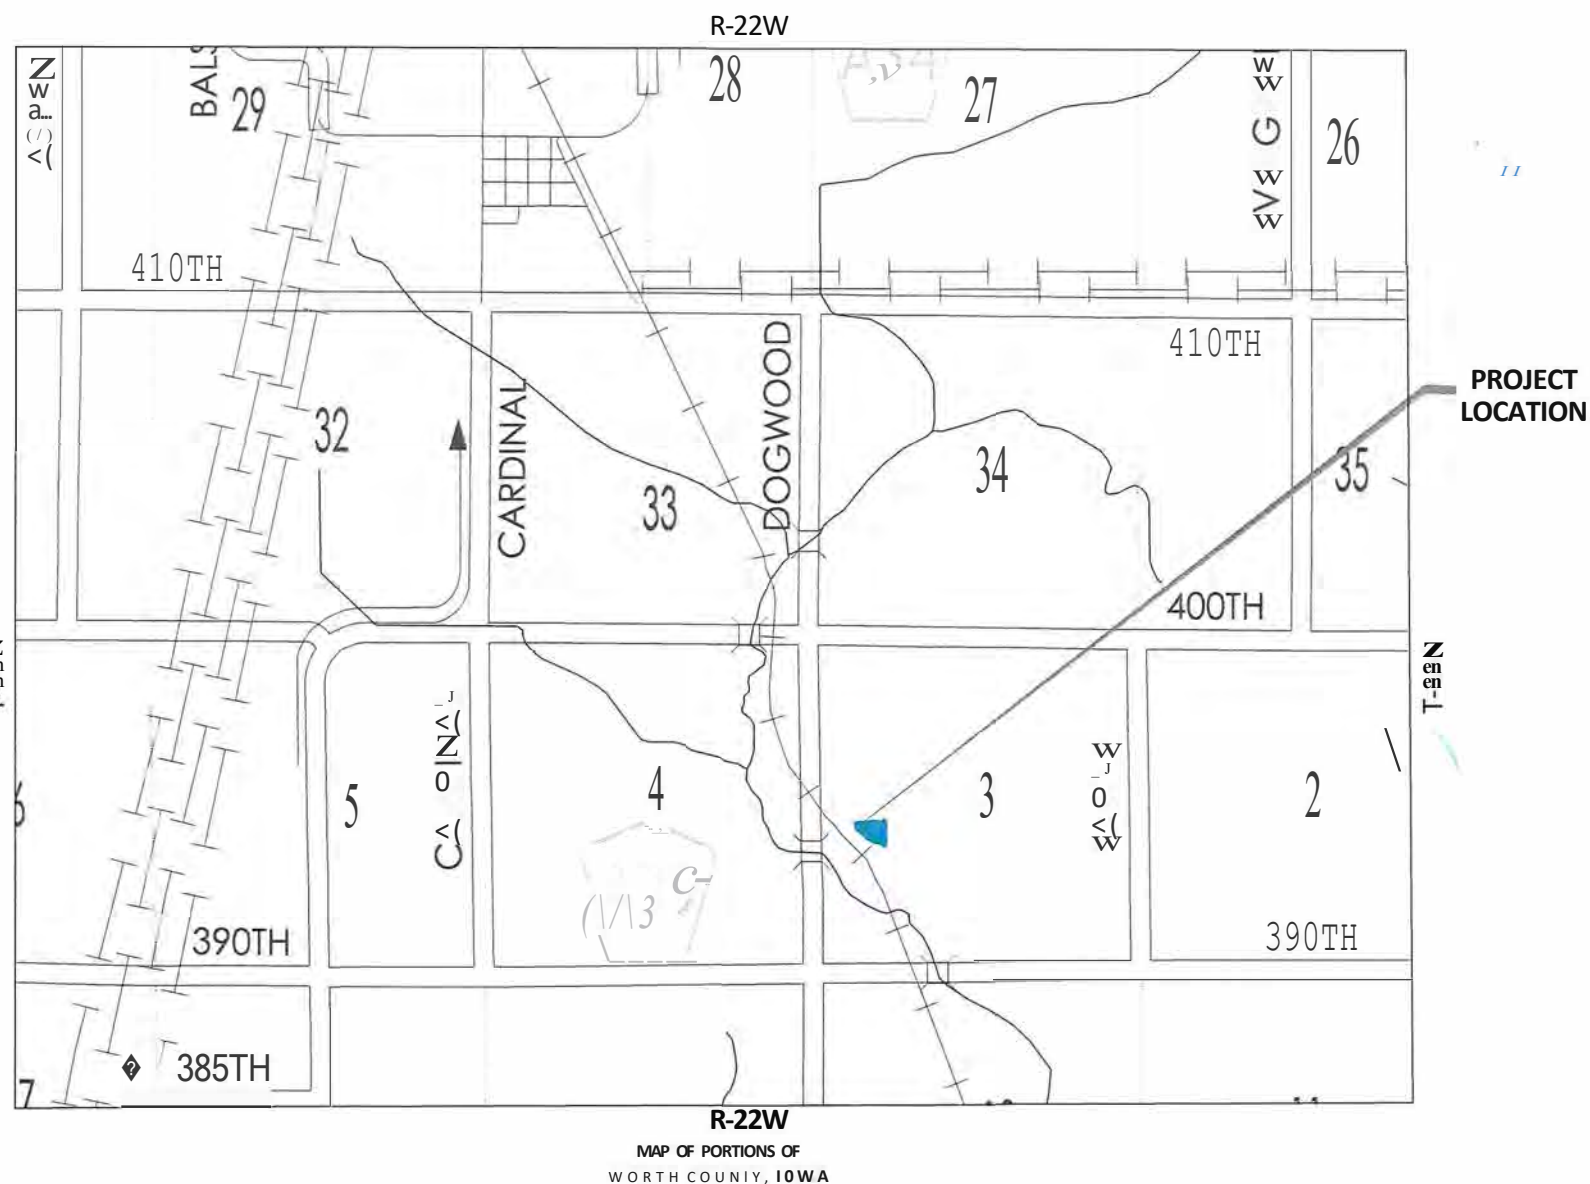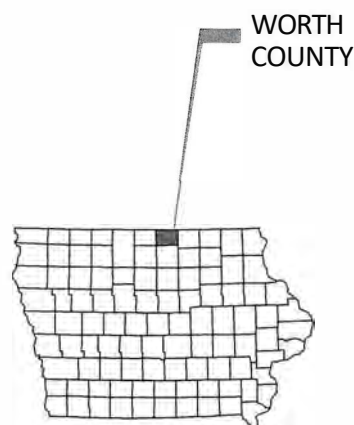

SHEET LIST TABLE	
SHEET NUMBER	SHEET TITLE
A.01	TITLE SHEET
A.02	OVERVIEW PLAN DESIGN
A.03	OVERVIEW PLAN DESIGN - WETLAND
A.04	OVERVIEW PLAN DESIGN - SATURATED BUFFER
B.01	RCP INSTALLATION DETAIL
B.02	CPDT INSTALLATION DETAIL
B.03 - B.04	IOWA DOT STRUCTURE DETAILS
B.05 - B.06	MODIFIED STRUCTURE DETAILS
B.07	NORTH SATURATED BUFFER STRUCTURE
B.08	SOUTH SATURATED BUFFER STRUCTURE
B.09	STILLING BASIN DETAIL
B.10	SHEET PILE DETAIL
B.11	SEEDING MAP
C.01	ESTIMATE QUANTITIES & REFERENCE NOTES
D.01	PLAN & PROFILE - 10' WIDE BERM
D.02 - D.03	PLAN & PROFILE - DIVERSION BERMS
D.04	PLAN & PROFILE - WATERWAY
D.05	PLAN & PROFILE - EMERGENCY SPILLWAY
M.01	PLAN & PROFILE - MAIN OUTLET PIPE
M.02	PLAN & PROFILE - LATERAL OUTLET PIPE
M.03	PLAN & PROFILE - TOE DRAIN
M.04	PLAN & PROFILE - DRAW DOWN PIPES
M.05-M.06	PLAN & PROFILE - NORTH SATURATED BUFFER
M.07	PLAN & PROFILE - SOUTH SATURATED BUFFER
M.08	DITCH RECONSTRUCTION CROSS-SECTIONS

THIS PLAN SET CONTAINS 29 SHEETS.

THESE PLANS WERE PREPARED IN ACCORDANCE WITH NRCS ENGINEERING JOB CLASS v, SPECIFICATIONS 656, 410, AND 378

I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF IOWA.

REG. NO. 21661 DATE: 7/10/24

MY LICENSE RENEWAL DATE IS 12/31/2024

PAGES OR SHEETS COVERED BY THIS SEAL:  
ALL PLAN SHEETS

DATUM EQUATION 1916 DATUM+ 1130.5' = NAVO 88	PROJECT DATUM: STATE PLANE HORIZONTAL: IOWA NORTH VERTICAL: NAVO 1988
---	---

8/10/27/2023 10:26:53 AM

1-SI-9-BA-L-TI\_M\_DR\_E\_D-RIV\_E

**BOLTON & MENK**

AMES, IOWA 50010  
Email: huss@bolton-menk.com  
www.bolton-menk.com


SPM/JKF	DATE: 8/10/23
PR	DATE: 8/10/23

IDA-LS WATER RESOURCES BUREAU

PETERSBURG  
TITLE SHEET

A.QI


© Bolton & Menk, Inc. 2024. All Rights Reserved. A:\IDALS\1217203\1217203.dwg 2/14/2024 12:58:32 PM

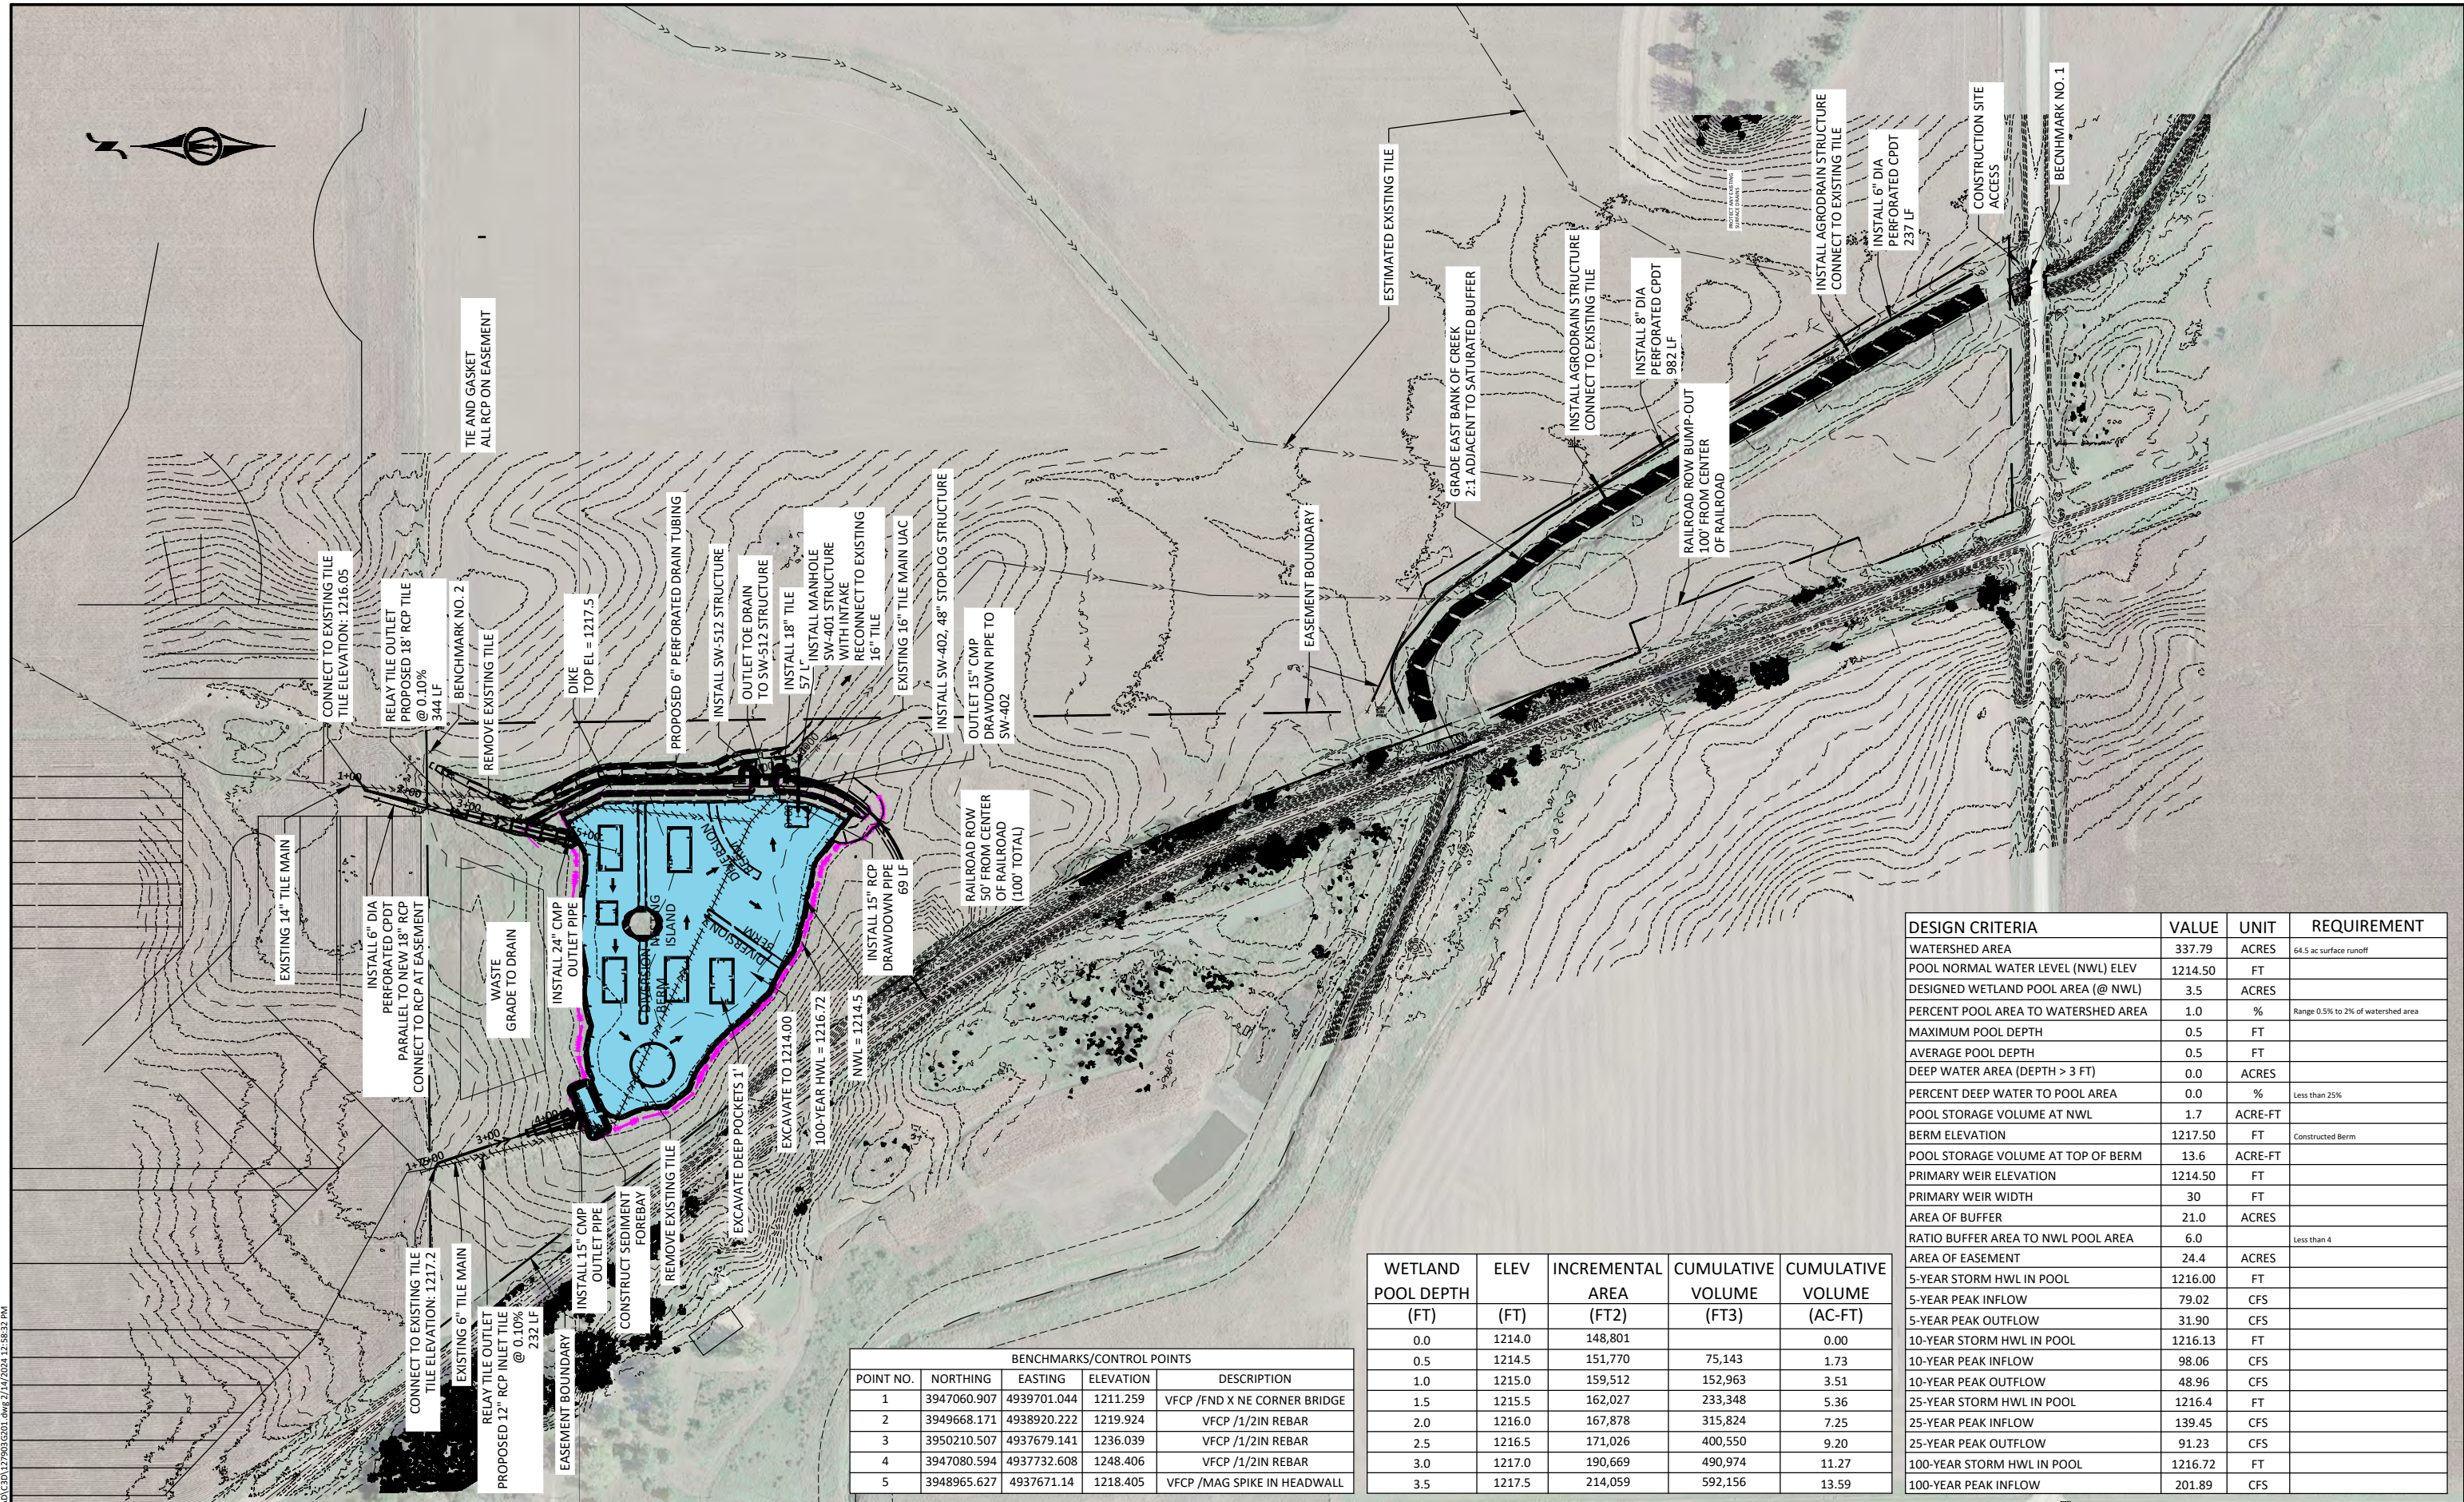

BENCHMARKS/CONTROL POINTS				
POINT NO.	NORTHING	EASTING	ELEVATION	DESCRIPTION
1	3947060.907	4939701.044	1211.259	VFCP /FND X NE CORNER BRIDGE
2	3949668.171	4938920.222	1219.924	VFCP /1/2IN REBAR
3	3950210.507	4937679.141	1236.039	VFCP /1/2IN REBAR
4	3947080.594	4937732.608	1248.406	VFCP /1/2IN REBAR
5	3948965.627	4937671.14	1218.405	VFCP /MAG SPIKE IN HEADWALL

WETLAND POOL DEPTH (FT)	ELEV (FT)	INCREMENTAL AREA (FT2)	CUMULATIVE VOLUME (FT3)	CUMULATIVE VOLUME (AC-FT)
0.0	1214.0	148,801		0.00
0.5	1214.5	151,770	75,143	1.73
1.0	1215.0	159,512	152,963	3.51
1.5	1215.5	162,027	233,348	5.36
2.0	1216.0	167,878	315,824	7.25
2.5	1216.5	171,026	400,550	9.20
3.0	1217.0	190,669	490,974	11.27
3.5	1217.5	214,059	592,156	13.59

DESIGN CRITERIA	VALUE	UNIT	REQUIREMENT
WATERSHED AREA	337.79	ACRES	64.5 ac surface runoff
POOL NORMAL WATER LEVEL (NWL) ELEV	1214.50	FT	
DESIGNED WETLAND POOL AREA (@ NWL)	3.5	ACRES	
PERCENT POOL AREA TO WATERSHED AREA	1.0	%	Range 0.5% to 2% of watershed area
MAXIMUM POOL DEPTH	0.5	FT	
AVERAGE POOL DEPTH	0.5	FT	
DEEP WATER AREA (DEPTH > 3 FT)	0.0	ACRES	
PERCENT DEEP WATER TO POOL AREA	0.0	%	Less than 25%
POOL STORAGE VOLUME AT NWL	1.7	ACRE-FT	
BERM ELEVATION	1217.50	FT	Constructed Berm
POOL STORAGE VOLUME AT TOP OF BERM	13.6	ACRE-FT	
PRIMARY WEIR ELEVATION	1214.50	FT	
PRIMARY WEIR WIDTH	30	FT	
AREA OF BUFFER	21.0	ACRES	
RATIO BUFFER AREA TO NWL POOL AREA	6.0		Less than 4
AREA OF EASEMENT	24.4	ACRES	
5-YEAR STORM HWL IN POOL	1216.00	FT	
5-YEAR PEAK INFLOW	79.02	CFS	
5-YEAR PEAK OUTFLOW	31.90	CFS	
10-YEAR STORM HWL IN POOL	1216.13	FT	
10-YEAR PEAK INFLOW	98.06	CFS	
10-YEAR PEAK OUTFLOW	48.96	CFS	
25-YEAR STORM HWL IN POOL	1216.4	FT	
25-YEAR PEAK INFLOW	139.45	CFS	
25-YEAR PEAK OUTFLOW	91.23	CFS	
100-YEAR STORM HWL IN POOL	1216.72	FT	
100-YEAR PEAK INFLOW	201.89	CFS	




1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com


DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			

**IDALS WATER RESOURCES BUREAU**  
PETERSBURG  
OVERVIEW PLAN DESIGN

SHEET  
**A.02**

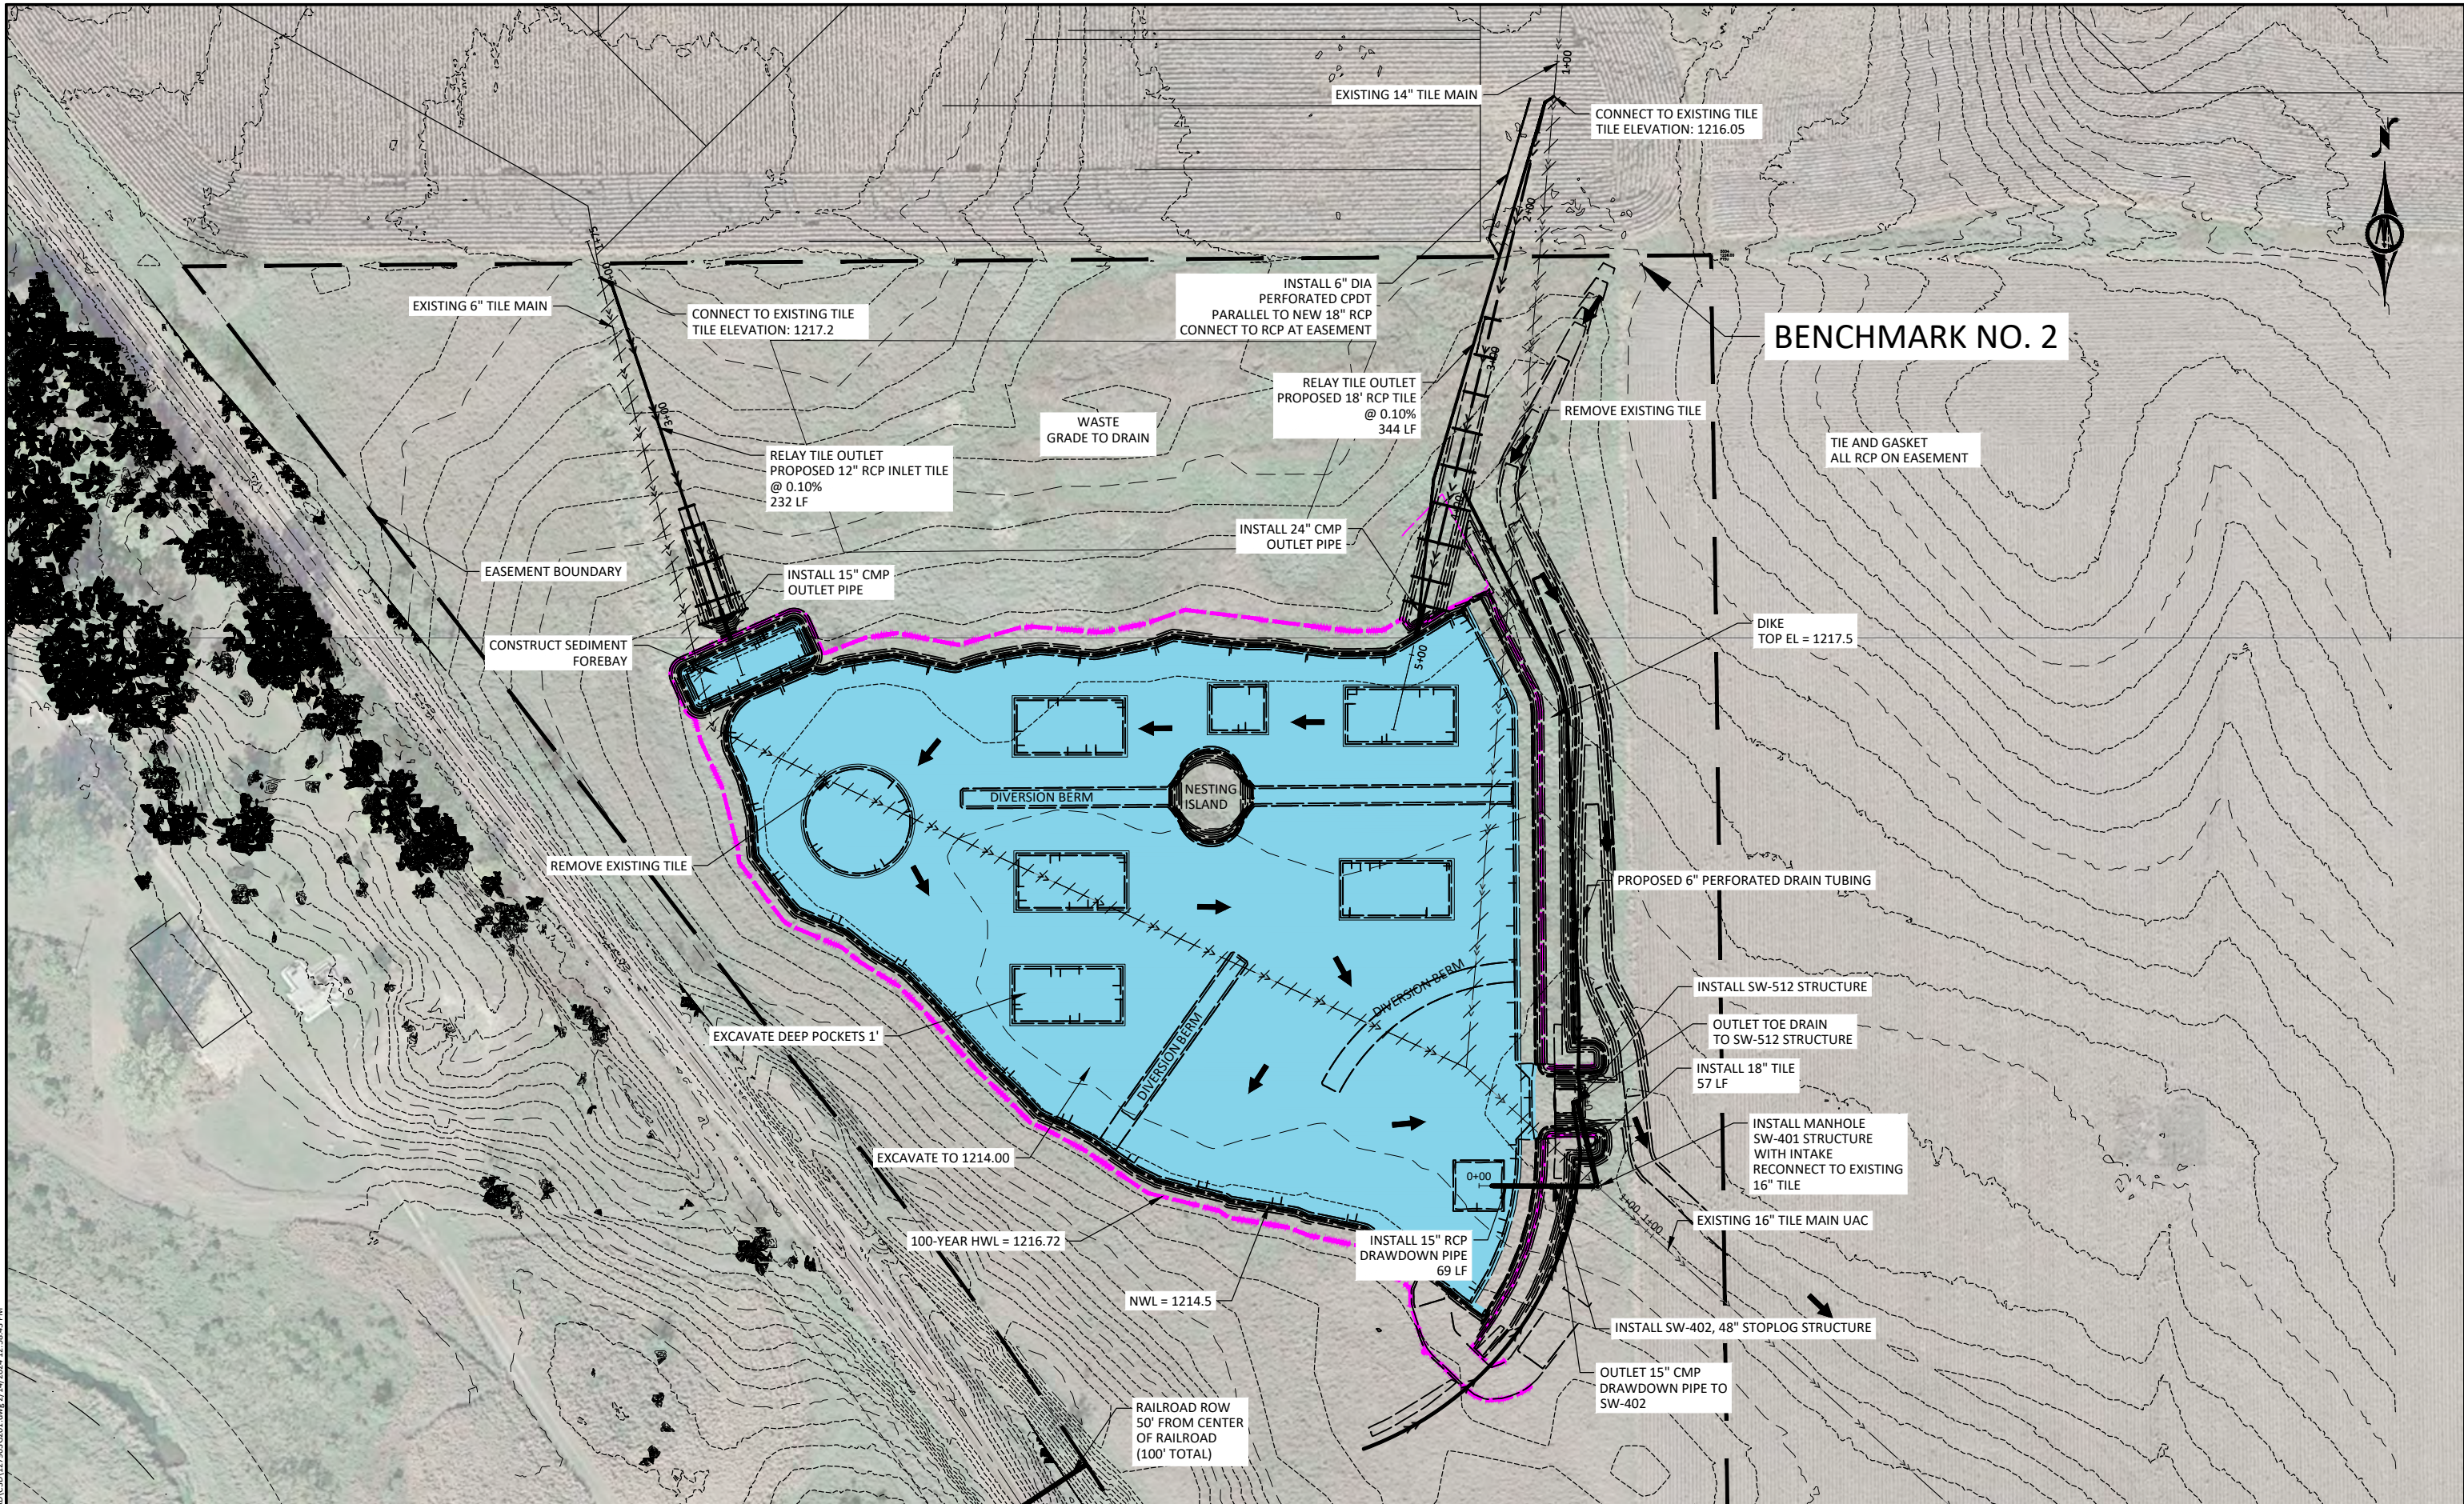

© Bolton & Menk, Inc. 2024. All Rights Reserved.  
 11/14/2024 11:29:03 AM CAD/CD/127903.G01 LowR 2/14/2024 12:58:43 PM





1519 BALTIMORE DRIVE  
 AMES, IOWA 50010  
 Phone: (515) 233-6100  
 Email: Ames@bolton-menk.com  
 www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
 PETERSBURG  
 OVERVIEW PLAN DESIGN - WETLAND

SHEET  
**A.03**

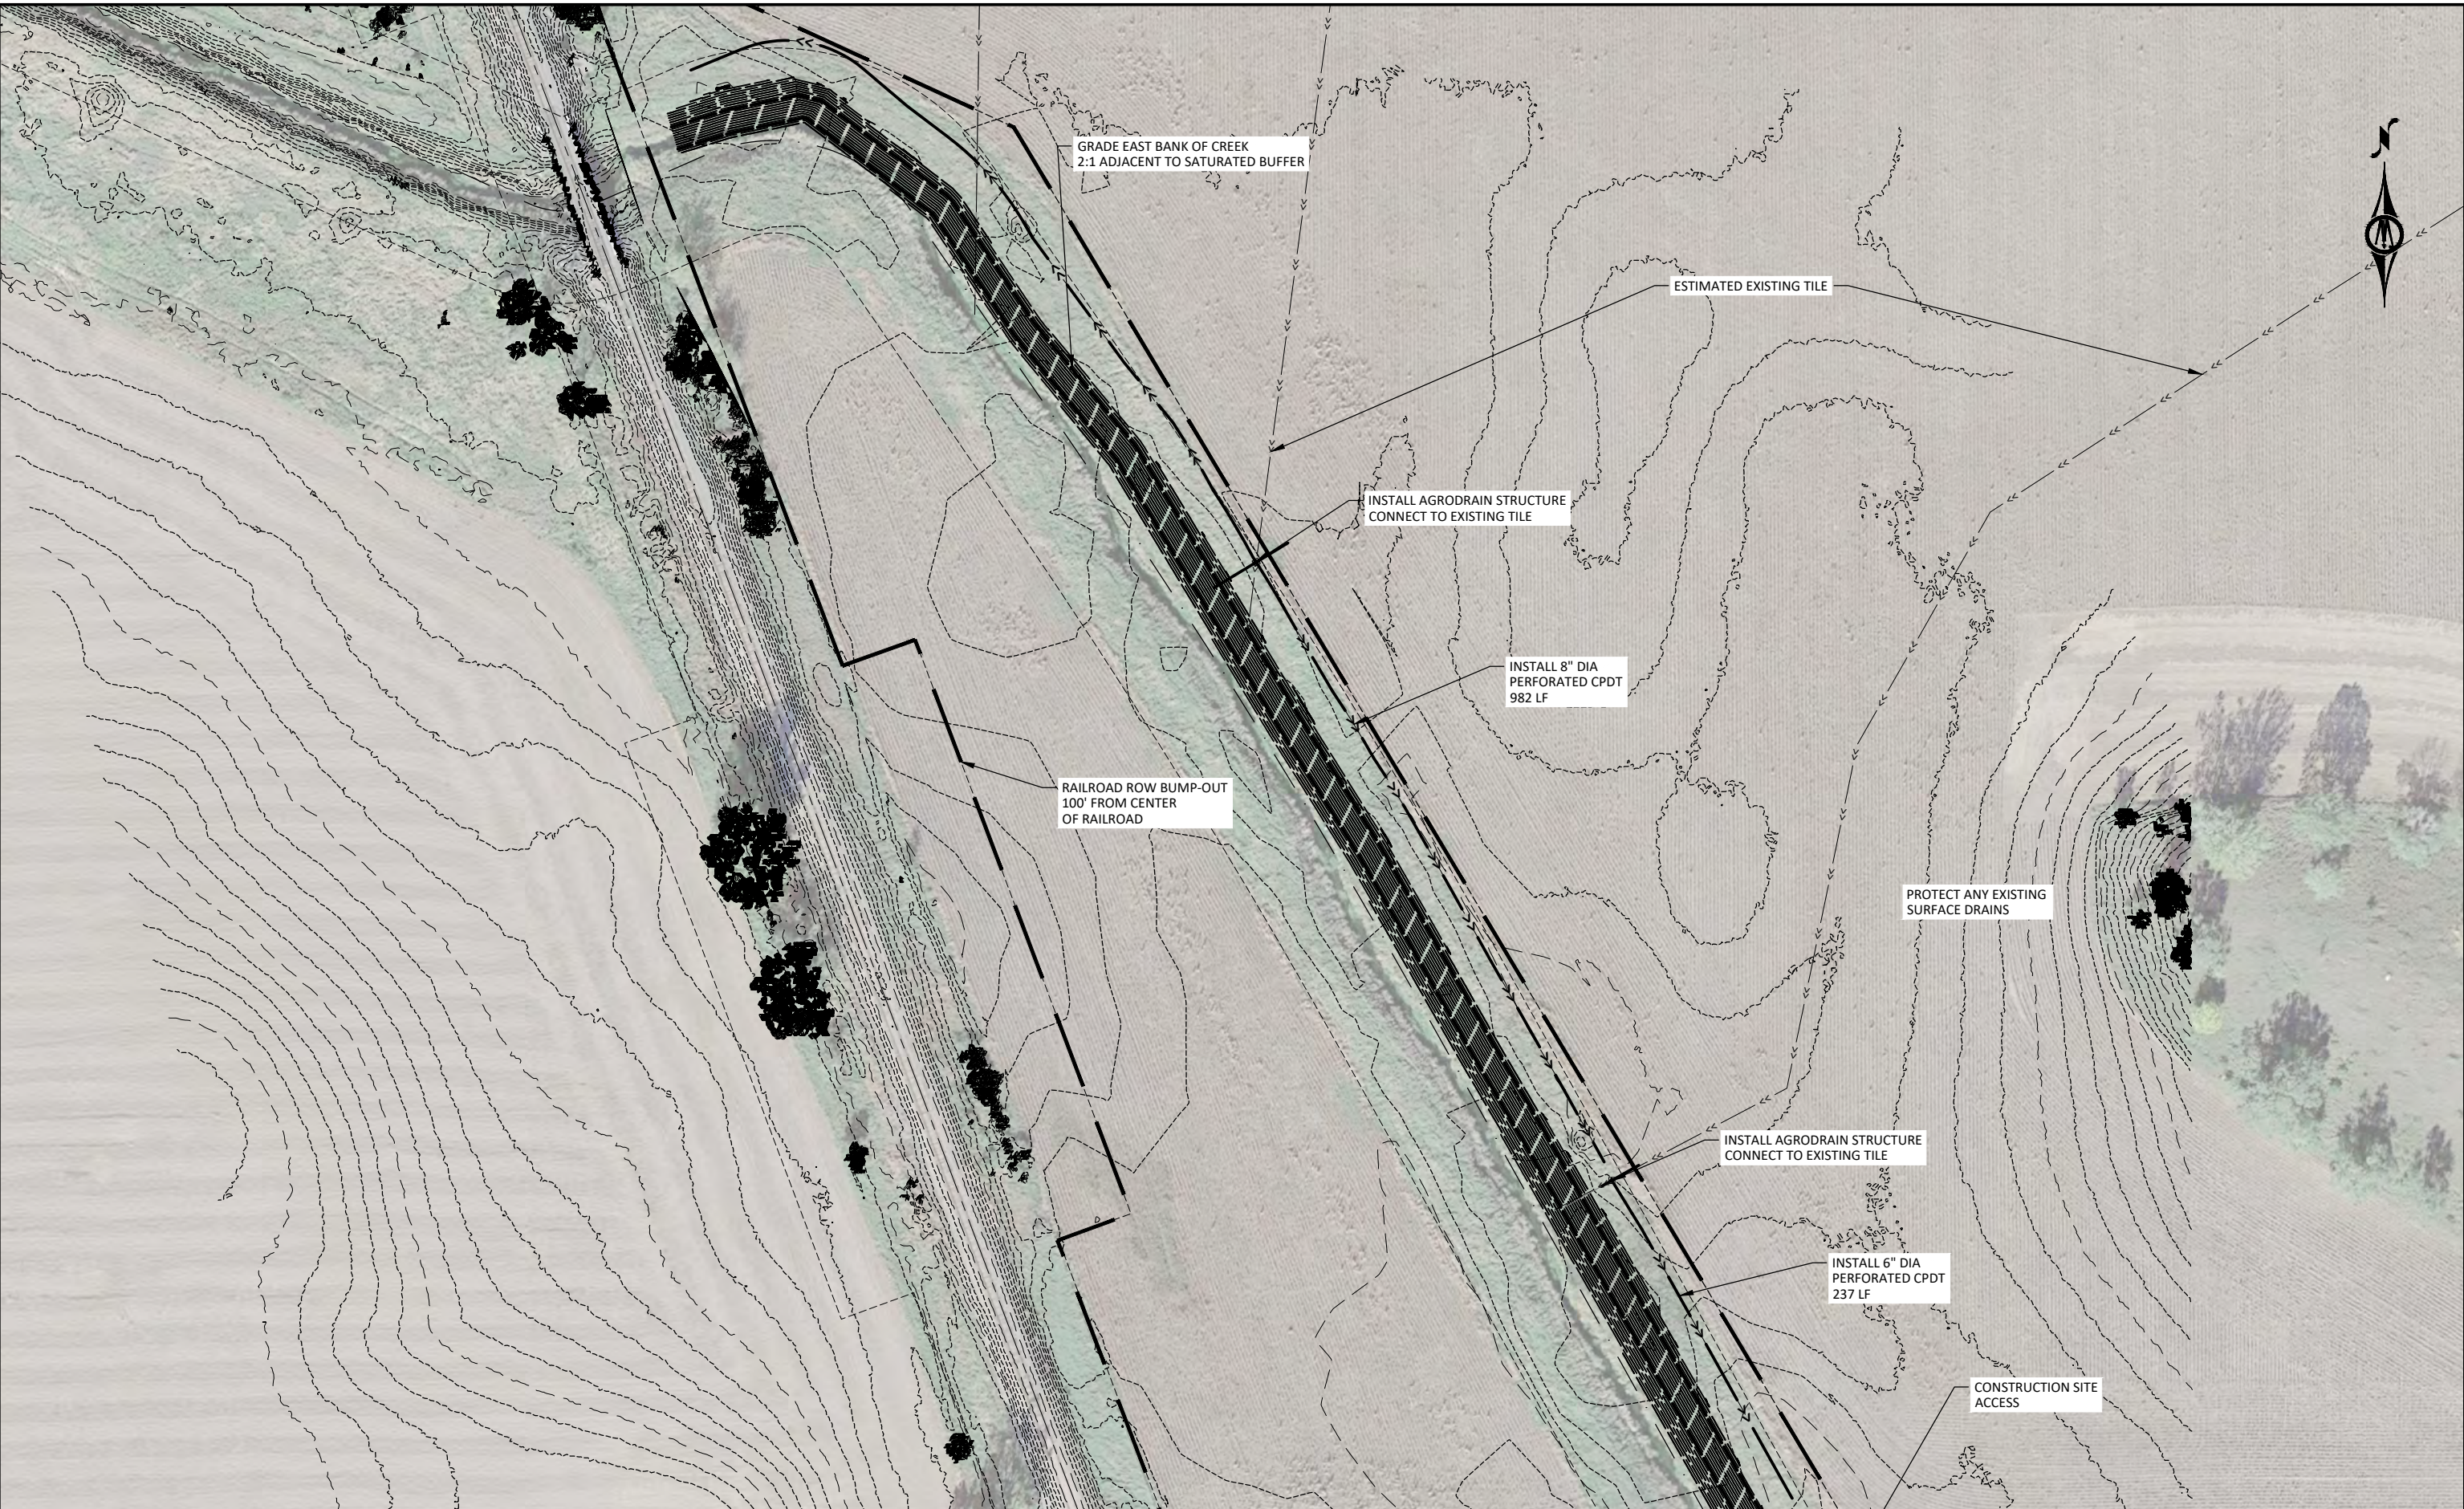

1519 BALTIMORE DRIVE  
 AMES, IOWA 50010  
 Phone: (515) 233-6100  
 Email: Ames@bolton-menk.com  
 www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
 PETERSBURG  
 OVERVIEW PLAN DESIGN - SATURATED BUFFER

SHEET  
 A.04

© Bolton & Menk, Inc. 2024. All Rights Reserved.  
 PLANS/304112/2024/01/2024/2/14/2024 12:58:51 PM



## CORRUGATED POLYETHYLENE DRAINAGE TUBING MATERIAL & INSTALLATION NOTES

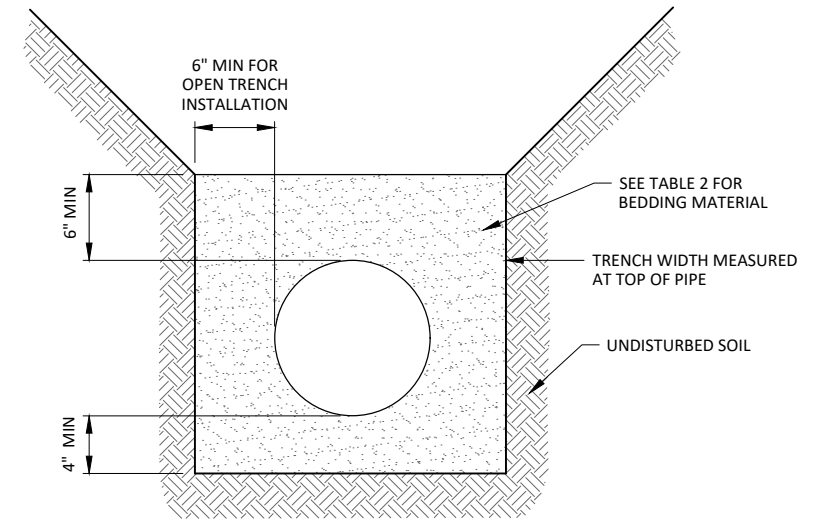
1. ALL CPDT AND CONNECTORS FURNISHED SHALL BE IN COMPLIANCE WITH MATERIAL STANDARDS ASTM F405 AND F667, AS APPLICABLE, AND SHALL BE CLASSIFIED AS HEAVY-DUTY UNDER THOSE STANDARDS.
2. EXCEPT MODIFIED HEREIN OR OTHERWISE APPROVED BY ENGINEER, ALL CPDT SHALL BE INSTALLED IN COMPLIANCE WITH THE ASTM 449 STANDARD PRACTICE.
3. FOR PIPES 6" DIAMETER AND SMALLER A 90° V GROOVE BOTTOM MAY BE USED, FOR ALL LARGER PIPE A TRAPEZOIDAL BOTTOM OR A CIRCULAR BOTTOM CONFORMING TO THE OUTSIDE DIAMETER OF THE PIPE SHALL BE USED. PRIOR TO THE INSTALLATION OF CPDT, CONTRACTOR MUST PROVE TO ENGINEER THAT THE INSTALLATION REQUIREMENTS, INCLUDING THE SHAPE OF THE TRENCH BOTTOM, WILL BE ACCOMPLISHED.
4. WHERE TRENCH BOTTOM IS IN FIRM UNDISTURBED SOIL, SHAPE TRENCH BASE GROOVE. WHERE EXCESS CUT OCCURS, OVEREXCAVATE AND PLACE MINIMUM THREE (3) INCH THICK, GRAVELLY SAND BEDDING TO RESTORE GRADE. THIS BEDDING SHALL MEET THAT REQUIRED FOR TRENCH INSTALLATION TYPE 3 ON PLAN SHEET C.02. IF DUE TO CONTRACTOR ERROR THIS MATERIAL AND WORK IS SUBSIDIARY TO THE INSTALLATION OF THE PIPE. CONTRACTOR MAY SUBSTITUTE PIPE BEDDING ROCK AS THE BEDDING MATERIAL.
5. NATIVE SOILS MAY BE USED AS BACKFILL MATERIAL UNLESS UNSTABLE TRENCH CONDITIONS PREVENT THE TRENCH BOTTOM HOLDING THE SHAPED GROOVE. IF TRENCH BOTTOM WILL NOT HOLD GROOVE SHAPE CONTRACTOR SHALL NOTIFY ENGINEER IMMEDIATELY. A FLAT BOTTOM TRENCH INSTALLATION WILL THEN BE ASSUMED. THE REQUIRED BEDDING MATERIAL WILL BE PAID UNDER THE TILE TRENCH STABILIZATION AND CRADLING ROCK BID ITEM.
6. MINIMUM TRENCH WIDTH IS PIPE OUTSIDE DIAMETER PLUS FOUR (4) INCHES FOR PLOWED INSTALLATION AND PIPE OUTSIDE DIAMETER PLUS TWELVE (12) INCHES FOR OPEN TRENCH INSTALLATION.
7. ALL LATERAL CONNECTIONS, ELBOWS, TEES, ALIGNMENT CURVES, START HOLES AND ALL PORTIONS OF THE TRENCH NOT MEETING THE GROOVED TRENCH INSTALLATION REQUIREMENTS SHALL BE FILLED TO A MINIMUM OF SIX (6) INCH COVER OVER THE PIPE WITH GRADED CRUSHED STONE OR GRAVEL AS SHOWN ON TABLE 2 OF THIS SHEET. UNLESS DUE TO CONTRACTOR ERROR THIS BEDDING MATERIAL WILL BE PAID UNDER THE TILE TRENCH STABILIZATION AND CRADLING ROCK BID ITEM.
8. MANUFACTURER'S ENDCAPS SHALL BE INSTALLED AT THE TERMINATION OF EACH LINE UNLESS A CONNECTION TO AN EXISTING DRAIN IS MADE.
9. WITH THE INSTALLATION OF THE FIRST REACH OF CPDT ON THE PROJECT, CONTRACTOR IS REQUIRED TO WORK WITH THE ENGINEER TO CHECK AND CONFIRM THAT THE PIPE STRETCH, IF ANY, DOES NOT EXCEED 5%.
10. ALIGNMENT TURNS MAYBE MADE USING EITHER A MANUFACTURED FITTING OR CURVING THE LINE WITH A 25' MINIMUM RADIUS.

Table 1 Maximum Allowable Buried Depth to Flowline of CPDT					
Nominal Pipe Diameter (IN)	Pipe Quality (ASTM)	Trench Width at Top of the Pipe (FT)			
		12"	18"	24"	30" or Greater
4	Standard	13	7	5.5	5
	Heavy-duty	Any	10	7	6
6	Standard	10	7	5.5	5
	Heavy-duty	Any	9.5	6.5	6
8	Standard	10	7	5.5	5
	Heavy-duty	Any	10	7	6
10	Heavy-duty	...	9	7	6
12	Heavy-duty	...	9	7	6
15	Heavy-duty	...	...	7	6

Table 2 Acceptable Bedding Material and Compaction Requirements					
Description	Percentage Passing Sieve Sizes			Minimum Standard Density (%)	Maximum Compaction Layer Height (IN.)
	1"	3/4"	No. 4		
Crushed Stone Crushed Gravel*	100%	> 95%	< 5%	Dumped	18

\* Class 1 Bedding Material Per SUDAS 3010.202A is an Allowable Substitute




FILL TRENCH TO 6" ABOVE TOP OF PIPE WITH CRUSHED STONE OR GRAVEL MEETING THE REQUIREMENTS IN TABLE 2. BEDDING MATERIAL SHALL BE INCIDENTAL TO THE PIPE INSTALLATION.

### FLAT BOTTOM TRENCH INSTALLATION


NOT TO SCALE  
SOURCE: ASTM F449

NOTE: THIS IS AN ALLOWED ALTERNATIVE INSTALLATION FOR CPDT

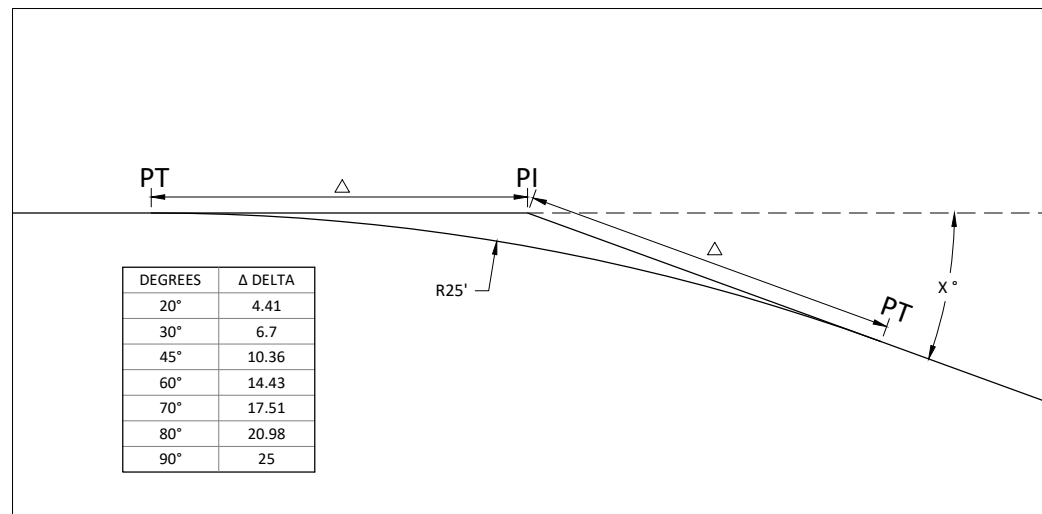

THE CIRCULAR GROOVE SHALL BE A MINIMUM 0.35R DEEP AND SHALL MATCH THE OUTSIDE CURVE SHAPE OF THE DEFLECTED CPDT.


THE TRAPEZOIDAL GROOVE SHALL BE SHAPED AND ADJUSTED SUCH THAT POINTS A, B, & C WILL TOUCH THE UNDEFLECTED CPDT FOR EACH SIZE INSTALLED.

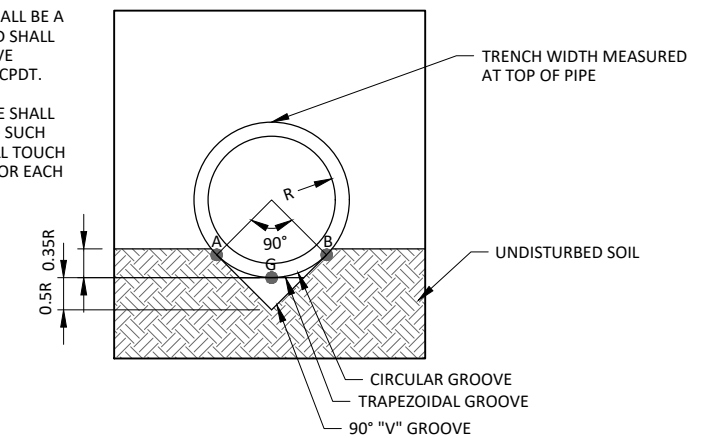


### PREFERRED TRENCH INSTALLATION BOTTOM

TRAPEZOIDAL GROOVE, "V" GROOVE, & CIRCULAR GROOVE  
NOT TO SCALE  
SOURCE: ASTM F449

- ① Cast-in-place base shown. If base is precast integral with bottom riser, the footprint of the base is not required to extend beyond the outer edge of the riser.
- ② For additional configurations, maintain a minimum of 12 inches of concrete between vertical edges of pipe openings.
- ③ 12 inch minimum riser height above all pipe openings.

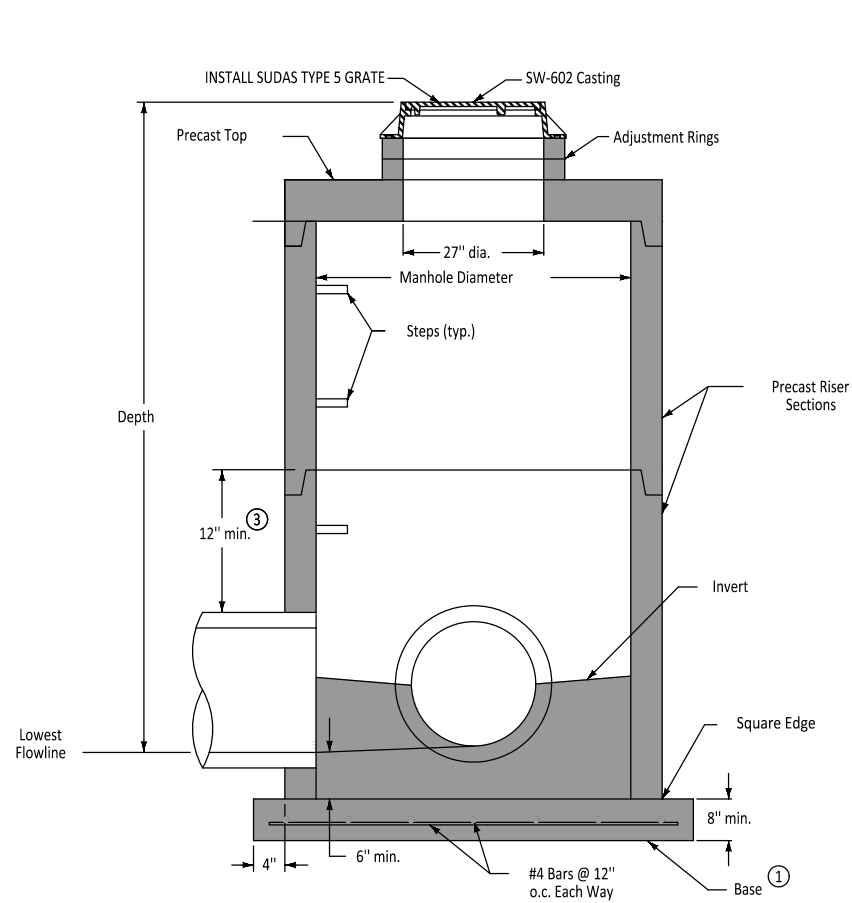


TYPICAL SECTION  
(not to scale)  
**SW-401**

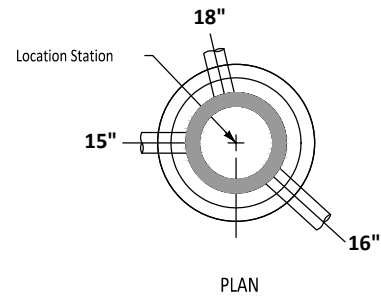

Manhole Diameter (inches)	Maximum Pipe Diameter (inches) for 2 Pipes	
	At 180° Separation	At 90° Separation
48	24	18
60	36	24
72	42	30
84	48	36
96	60	42

		REVISION
		NEW 04-21-09
FIGURE 6010.401	STANDARD ROAD PLAN	<b>SW-401</b>
REVISIONS: New: Replaces SUDAS Type "M-A" Manhole. Will replace RA-50.		SHEET 1 of 1
SUDAS DIRECTOR		DESIGN METHODS ENGINEER
CIRCULAR STORM SEWER MANHOLE		

DETAIL - TILE INTERCEPT MANHOLE

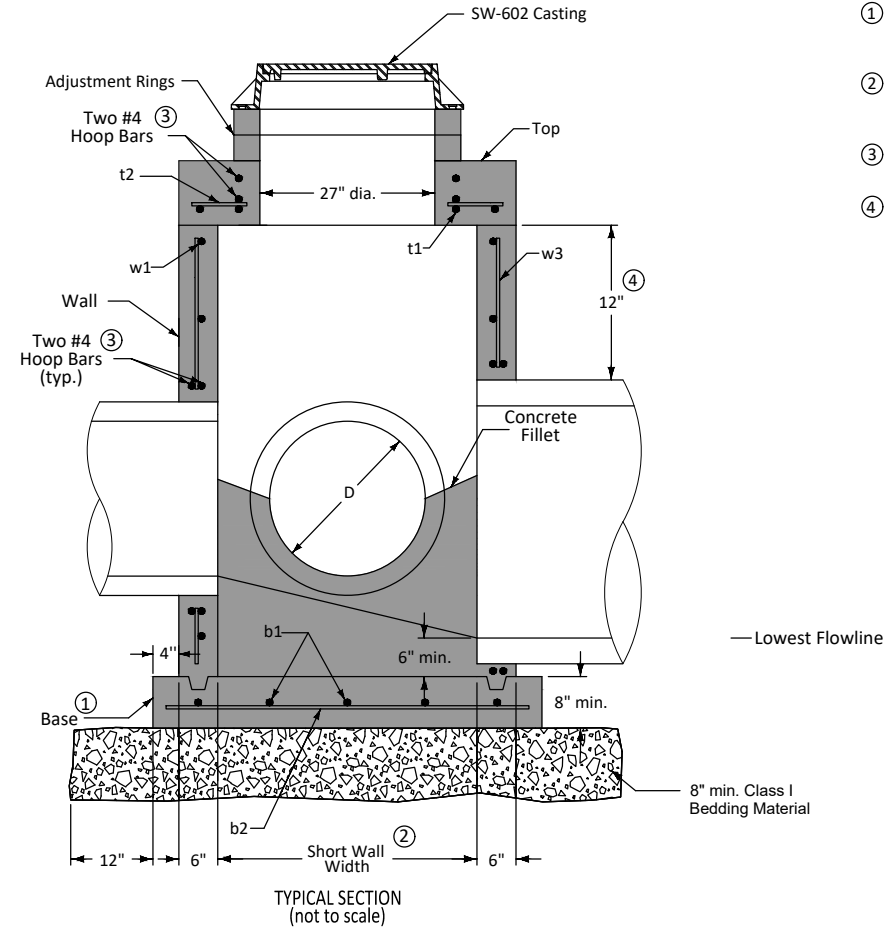

TYPICAL SECTION  
(not to scale)  
**SW-402**

FOR INFORMATIONAL PURPOSES ONLY

Adjacent walls may have different widths based upon pipe configuration, but structure must be rectangular.

- ① Cast-in-place base shown. If base is precast integral with walls, the footprint of the base is not required to extend beyond the outer edge of the walls.
- ② Wall widths vary with pipe diameter and range from 40 inches minimum to 77 inches maximum. Provide 6 inches of wall width (minimum) each side of pipe opening.
- ③ Provide two #4 hoop bars at top opening and at all pipe openings.
- ④ 12 inch minimum wall height above all pipes.

		REVISION
		NEW 04-21-09
FIGURE 6010.402	STANDARD ROAD PLAN	<b>SW-402</b>
REVISIONS:		SHEET 1 of 1
SUDAS DIRECTOR		DESIGN METHODS ENGINEER
RECTANGULAR STORM SEWER		


DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			

- ① Precast (shown) or cast-in-place base:

Precast: 6 inch thick concrete with #6 welded wire mesh on 4 inch centers (WWF 4" x 4"). Center mesh vertically within base.

Cast-in-place: 8 inch thick non-reinforced concrete.

- ② 12 inch minimum riser height above all pipes.

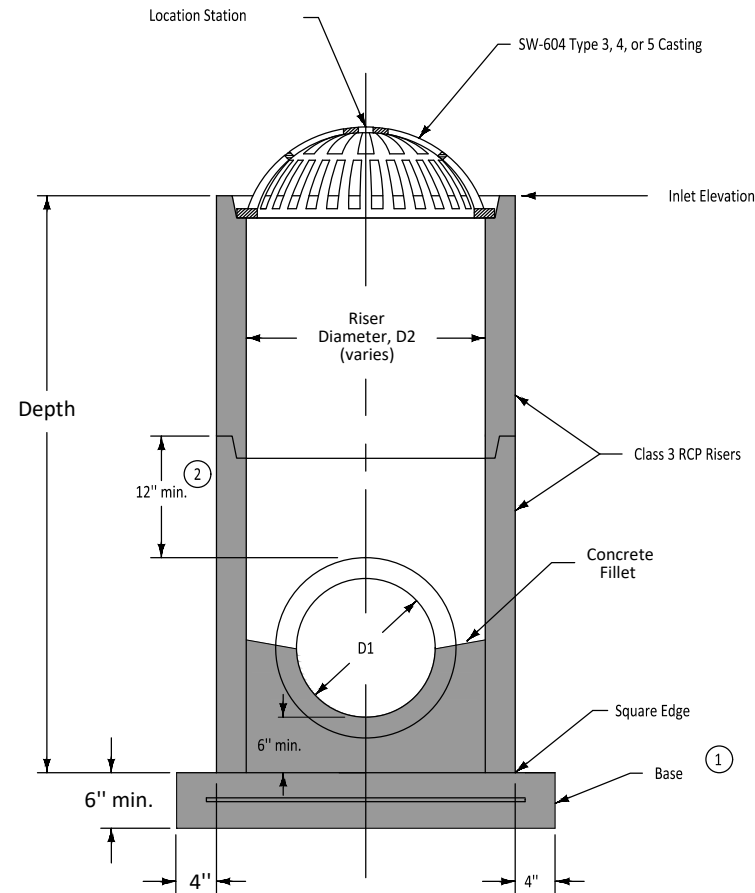

TYPICAL SECTION  
(not to scale)

SW-512

INTAKE SIZE - CASE 1	
Outlet Pipe Diameter, D1	Minimum Riser Diameter, D2
12"	18"
15"	24"
18"	24"
21"	30"
24"	30"
27"	36"

		REVISION
		4   04-21-20
FIGURE 6010.S12	STANDARD ROAD PLAN	SW-512
REVISIONS: Changed 1 to 1 on Bedding Material.		SHEET 1 of 2
MODIFICATIONS:		
SUDAS DIRECTOR	DESIGN METHODS ENGINEER	
CIRCULAR AREA INTAKE		

© Bolton & Menk, Inc. 2024. All Rights Reserved. P:\104613\1117303\CAD\CAD12\F05\C101.dwg 2/24/2024 12:58:54 PM



1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU


PETERSBURG

IOWA DOT STRUCTURE DETAILS


SHEET

B.04




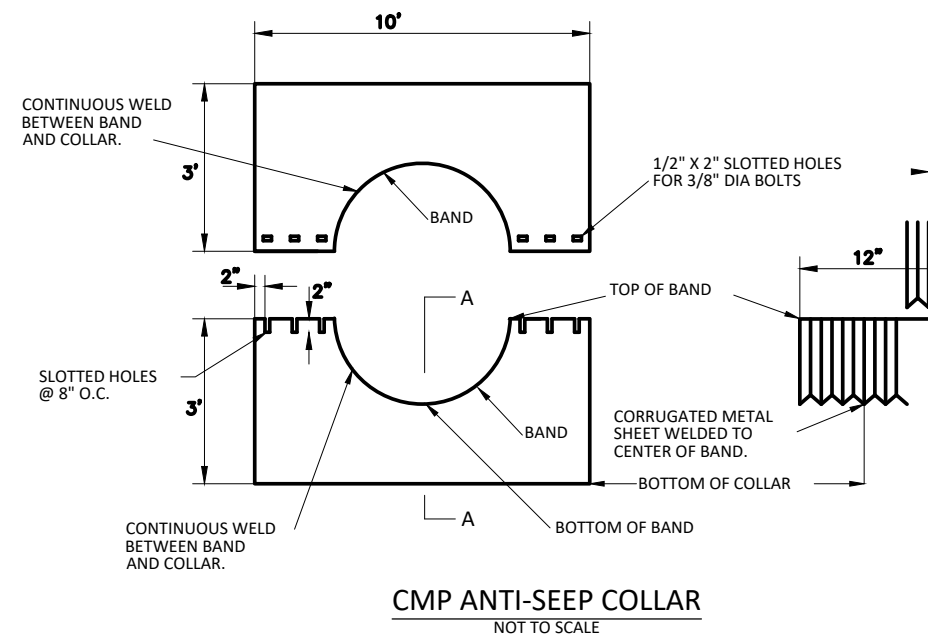

**CMP ANTI-SEEP COLLAR**  
NOT TO SCALE

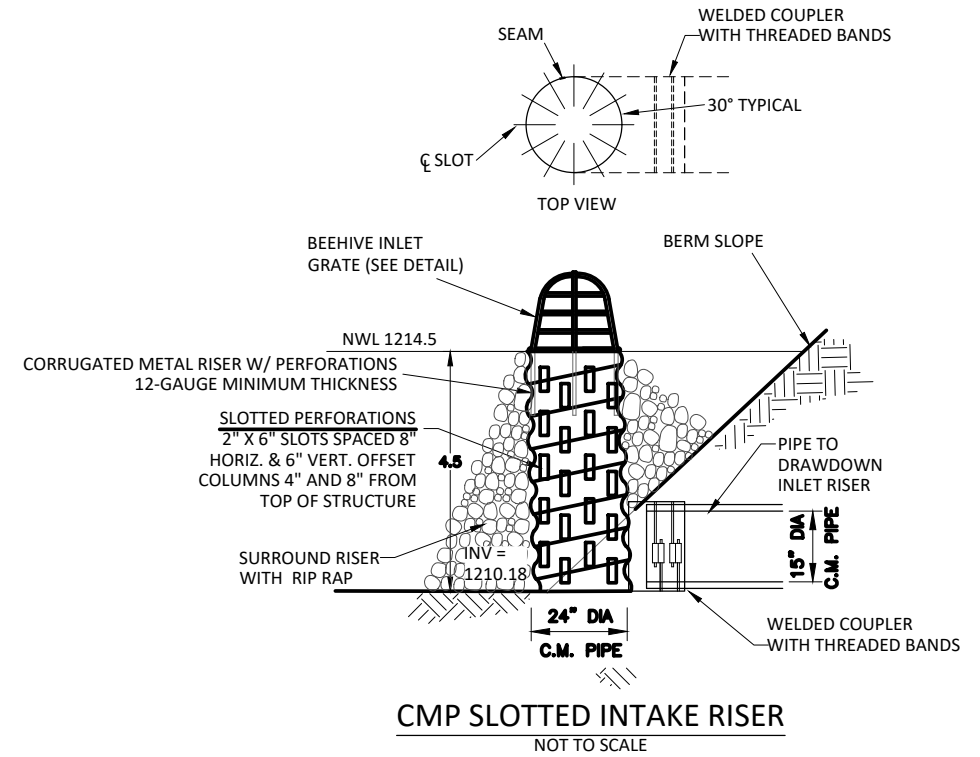

**CMP SLOTTED INTAKE RISER**  
NOT TO SCALE

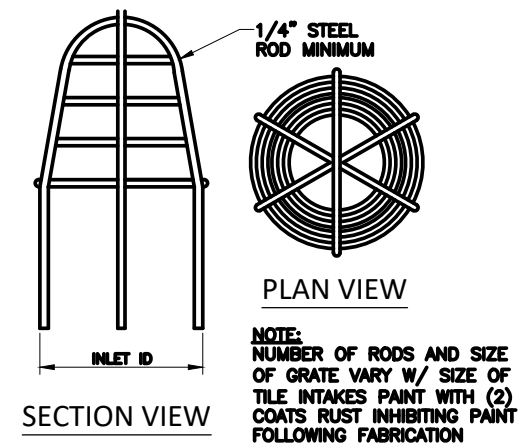

**BEEHIVE INLET GRATE (STEEL BARS)**  
NOT TO SCALE

© Bolton & Menk, Inc. 2024. All Rights Reserved. 11/04/2024 11:27:03 AM CAD/CADD/127905.CAD/127905.LDW 2/24/2024 12:58:54 PM




1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
PETERSBURG  
MODIFIED STRUCTURES


SHEET  
B.05

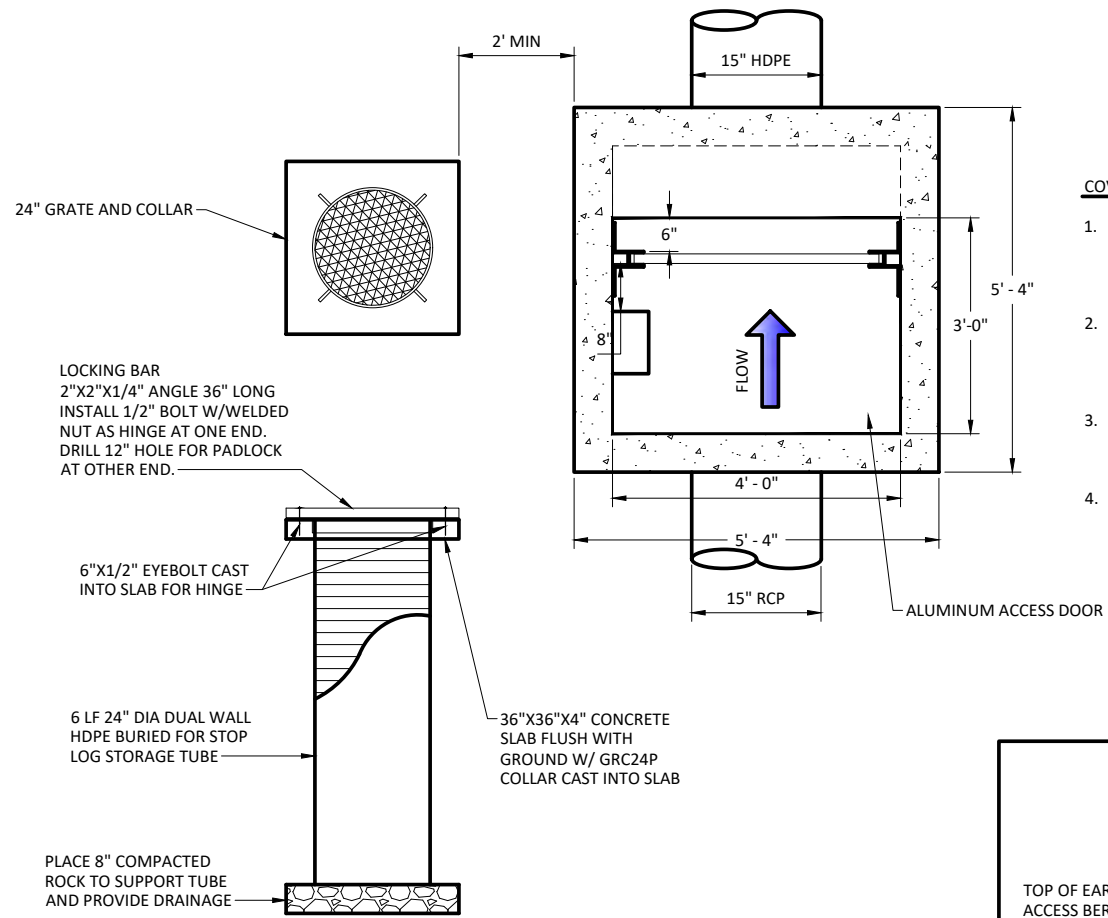

**COVER AND STOP LOG STORAGE DETAIL**  
NOT TO SCALE

**COVER/STOP LOG STORAGE NOTES:**


1. PROVIDE (HALLIDAY PRODUCTS MODEL S1R3660 OR APPROVED EQUAL) 36"X60" ALUMINUM ACCESS DOOR WITH LOCKING MECHANISM AND LIFTING HANDLE.
2. BOTH PADLOCKS FOR ACCESS DOOR AND STOP LOG STORAGE TUBE SHALL BE KEYED ALIKE. FOUR KEYS ARE TO BE SUPPLIED UPON PROJECT COMPLETION.
3. TOP OF STRUCTURE SHALL BE AN 8" THICK REINFORCED PRECAST TOP WITH ALUMINUM ACCESS DOOR CAST INTO TOP.
4. PROVIDE 24" GRATE AND COLLAR (AGRI DRAIN GR24 GRATE AND GRC24 COLLAR OR APPROVED EQUAL) FOR STOP LOG STORAGE.

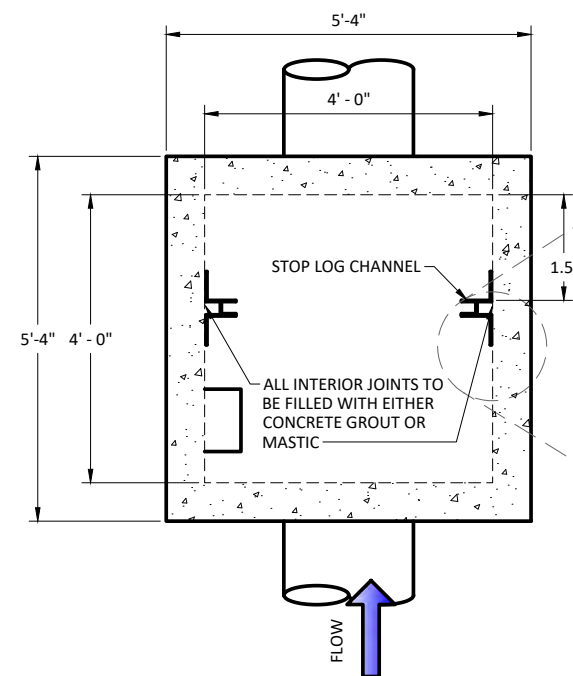


**STOP LOG CHANNEL DETAIL**

**STOP LOG CHANNEL NOTES:**

1. ALL STEEL SHALL BE FY=36 KSI.
2. ANCHORS SHALL BE STAINLESS STEEL FURNISHED W/NUTS, WASHERS AND LOCK WASHERS.
3. STOP LOG CHANNEL SHALL BE FURNISHED AS ONE CONTINUOUS PIECE W/CONTINUOUS WELDS.
4. ALL STEEL STOP LOG CHANNEL COMPONENTS ARE TO BE GALVANIZED AFTER WELDING AND DRILLING IS COMPLETE.
5. CONTRACTOR SHALL GROUT JOINT LINES INSIDE STRUCTURE ON WALLS BEHIND STOPLOGS CHANNEL.
6. CONTRACTOR IS TO APPLY SEALANT VERY GENEROUSLY TO BACKSIDE OF STOP LOG CHANNEL TO ENSURE WATERTIGHT SEAL. SEALANT SHALL BE SIKA 30 YEAR INDUSTRIAL CAULK IN LIMESTONE GREY OR APPROVED EQUIVALENT.

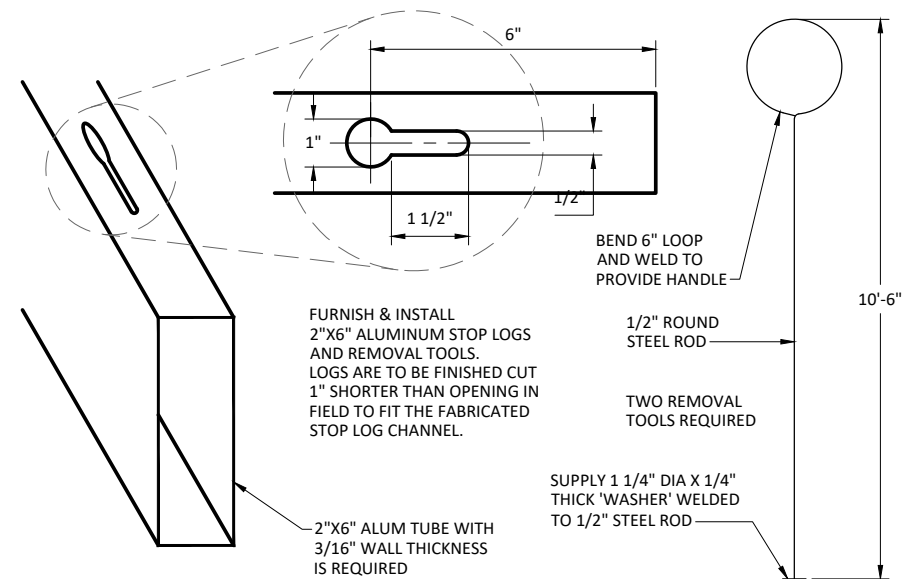

**STOP LOG & REMOVAL TOOL DETAIL**  
NOT TO SCALE

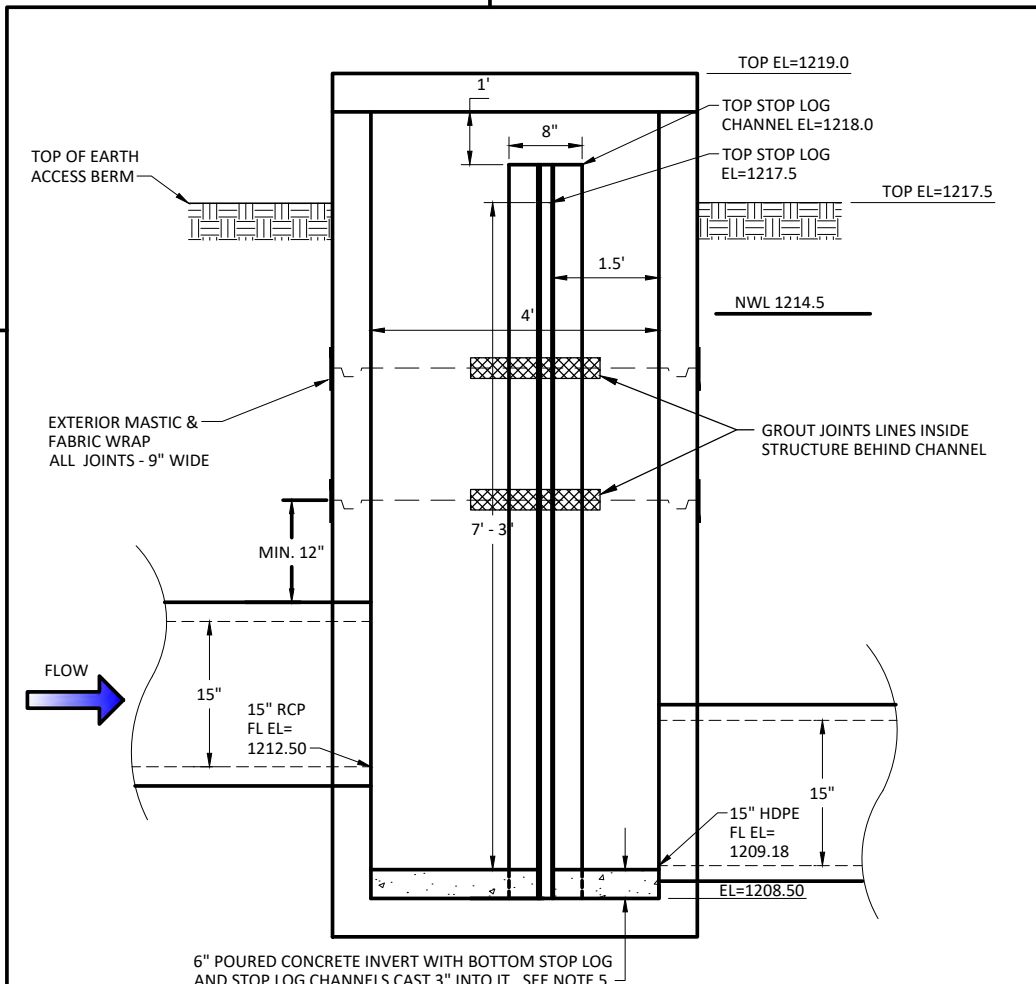

**SW-402 WATER CONTROL OUTLET STRUCTURE ELEVATION**  
NOT TO SCALE

**WATER CONTROL STRUCTURE NOTES:**

1. STRUCTURE FABRICATION AND INSTALLATION SHALL CONFORM TO SUDAS 6010.302 SW-402 SANITARY MANHOLE
2. STRUCTURE SHOP DRAWINGS ARE REQUIRED FOR ENGINEER'S REVIEW AND APPROVAL BEFORE FABRICATION OF WATER CONTROL STRUCTURE.
3. PRECAST WATER CONTROL STRUCTURE SHALL BE SUPPLIED IN 2 OR 3 SECTIONS, PLUS AN 8" THICK COVER SECTION. SECTION SIZE IS LEFT TO CONTRACTOR'S DISCRETION EXCEPT BOTTOM SECTION SHALL INCLUDE BASE AND WALLS TO 12" ABOVE INLET HOLE.
4. STOP LOG CHANNEL IS TO BE ANCHORED TO THE WALLS AND FLOOR PRIOR TO PLACING CONCRETE INVERT.
5. A CONCRETE INVERT IS TO BE INSTALLED AFTER STOP LOG CHANNEL IS INSTALLED. THE BOTTOM STOP LOG IS TO BE CAST INTO THE INVERT WITH THREE HALF INCH DIA. "J BOLTS" FASTENED TO THE BOTTOM STOP LOG. NO LIFTING HOLES ARE REQUIRED FOR THIS BOTTOM LOG.
6. ALL SECTIONS OF THE STRUCTURE ARE TO HAVE "TONGUE AND GROOVE" JOINTS SEALED WITH O RING GASKETS IN THE JOINT AND MASTIC AND FABRIC WRAP ON THE STRUCTURE EXTERIOR.
7. INTERIOR JOINTS SHALL BE FILLED AND SEALED TO PREVENT WATER FLOW IN JOINT BEHIND STOP LOG CHANNEL USING EITHER CONCRETE GROUT OR MASTIC.
8. ALL REINFORCEMENT FOR WATER CONTROL STRUCTURE SHALL BE ONE LAYER OF #4 REBAR @ 12" SPACING, CENTERED IN WALL, TWO #4 HOOP BARS ARE TO BE USED AT EACH OPENING.
9. PLACE BASE OF STRUCTURE ON FIRM UNDISTURBED EARTH FOUNDATION APPROVED BY ENGINEER.
10. A-LOK (OR EQUIVALENT) WATERTIGHT SEALS ARE REQUIRED FOR PIPE CONNECTIONS TO THE DRAWDOWN CONTROL STRUCTURE.
11. MANHOLE STEPS ARE TO BE INSTALLED FOR MAINTENANCE ACCESS TO THE STOP LOGS. STEPS ARE TO BE PER SUDAS SECTION 6010-2-2.13.
12. A-LOK'S (OR EQUIVALENT) WATERTIGHT SEALS ARE REQUIRED FOR PIPE CONNECTIONS TO THE WATER CONTROL STRUCTURE.
13. INSURE THAT ALL JOINTS ARE WATER-TIGHT AND PROPERLY SEALED

© Bolton & Menk, Inc. 2024. All Rights Reserved. 11/12/2024 11:27:53 AM C:\Users\jpr\OneDrive\Documents\2/24/2024 11:25:54 PM




1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			


**IDALS WATER RESOURCES BUREAU**  
PETERSBURG  
MODIFIED STRUCTURES

SHEET  
**B.06**



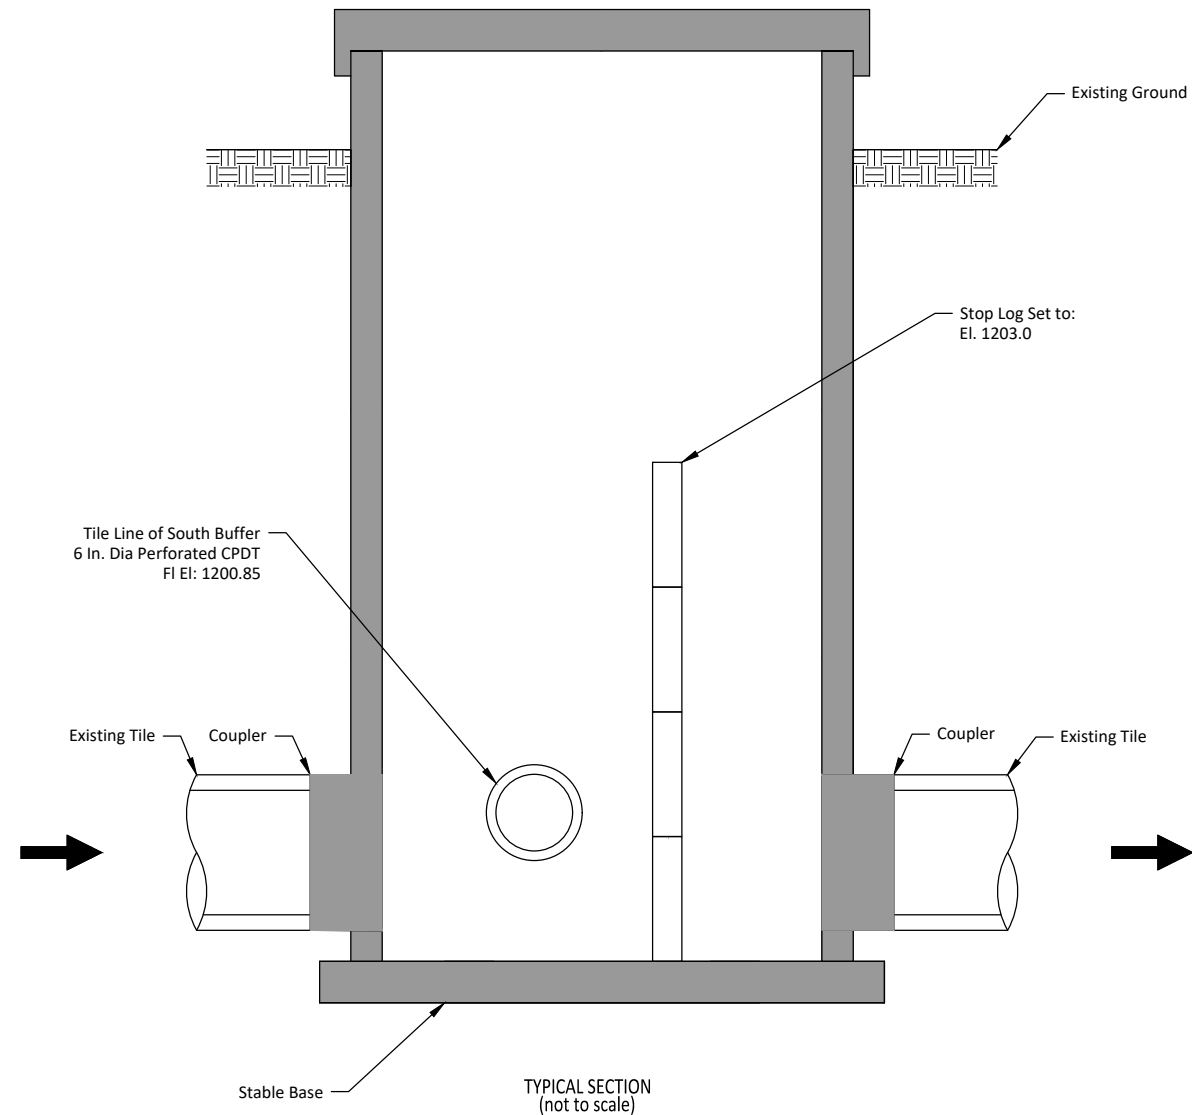

**SOUTH SATURATED BUFFER  
STRUCTURE  
AGRIDRAIN INLINE WATER  
LEVEL CONTROL STRUCTURE**

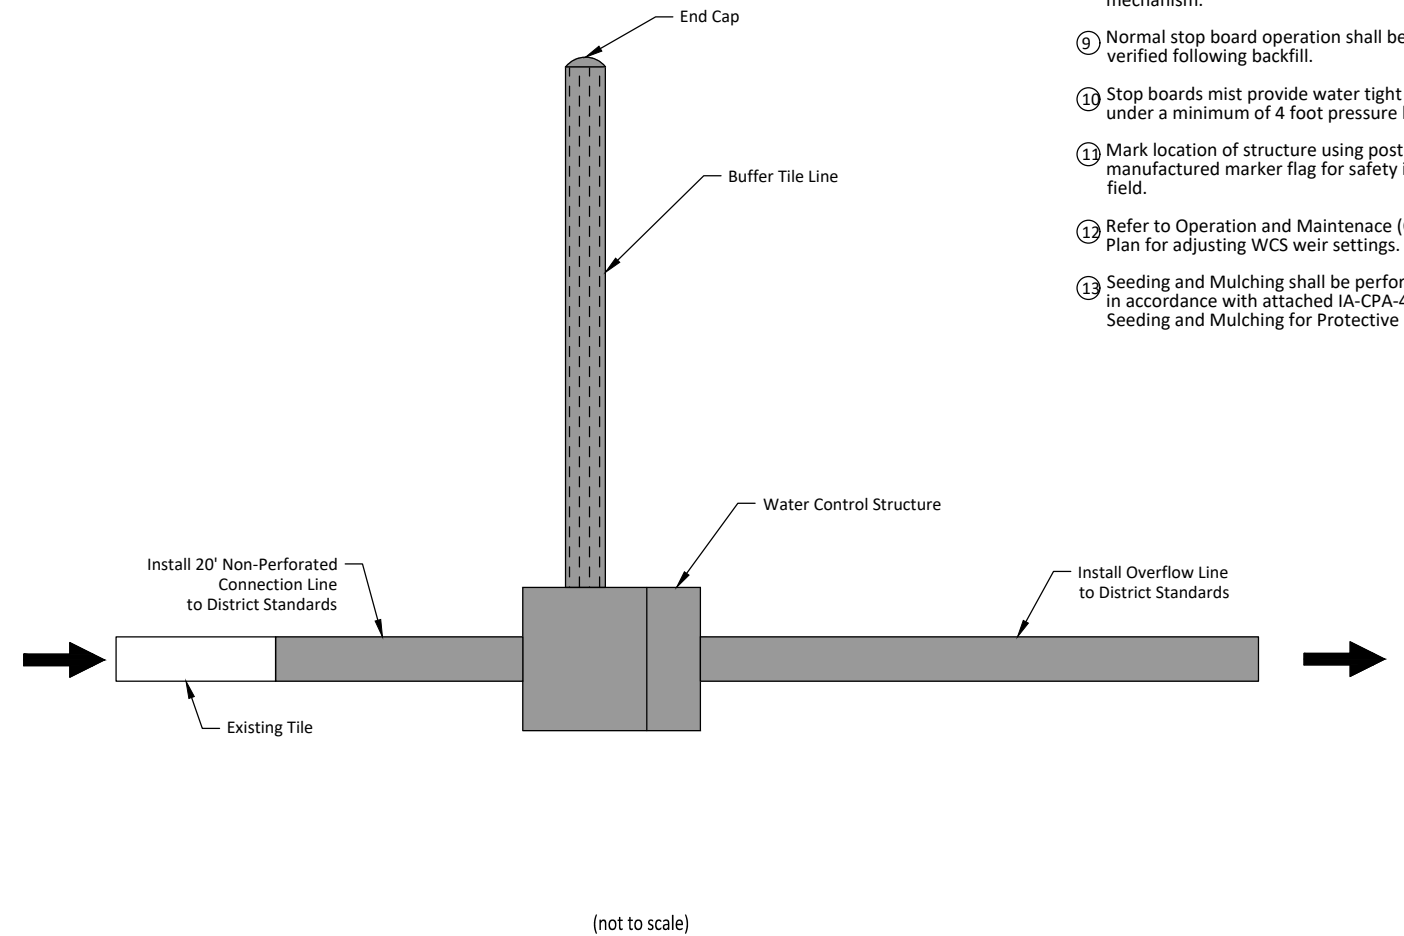

- ① Install perforated buffer tile lines parallel to the ditch and connect them to the side couplers on the water control structure (see Plan).
- ② Connect non-perforated plastic pipe to the upstream and downstream couplers on the water control structure, upstream 20' minimum, see typical section for downstream length. Diameter, d, is inside diameter in inches.
- ③ Pipe must be PVC or PE. Pipe, pipe sizes, fittings and other appurtenances shall conform to the "Materials" section of Iowa NRCS Construction Specification (CS) IA-620, Underground Outlet.
- ④ Saturated Buffer installation shall be in conformance with CS IA-45, Plastic (PVC, PE) Pipe.
- ⑤ Water Control Structure (WCS) materials shall be in conformance with CS IA-45, Plastic (PVC, PE) Pipe.
- ⑥ Place structure and pipe coupler on a minimum 4 inch stable base. A stable base may be compacted earth, compacted fill gravel, or a concrete pad. Extend the stable base no less than 1 foot around structure.
- ⑦ Stop Board removal tool shall be provided.
- ⑧ Structure lid shall be provided with locking mechanism.
- ⑨ Normal stop board operation shall be verified following backfill.
- ⑩ Stop boards must provide water tight seals under a minimum of 4 foot pressure head.
- ⑪ Mark location of structure using post or manufactured marker flag for safety in the field.
- ⑫ Refer to Operation and Maintenance (O&M) Plan for adjusting WCS weir settings.
- ⑬ Seeding and Mulching shall be performed in accordance with attached IA-CPA-4, Seeding and Mulching for Protective Cover.

© Bolton & Menk, Inc. 2024. All Rights Reserved. 11/04/2024 11:27:03 AM C:\CADD\127905\127905.dwg 2/14/2024 12:58:55 PM





1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN	SPM/JKF		
CHECKED	JPR		
CLIENT PROJ. NO.			

**IDALS WATER RESOURCES BUREAU**  
PETERSBURG  
SOUTH SATURATED BUFFER STRUCTURES

SHEET  
**B.08**

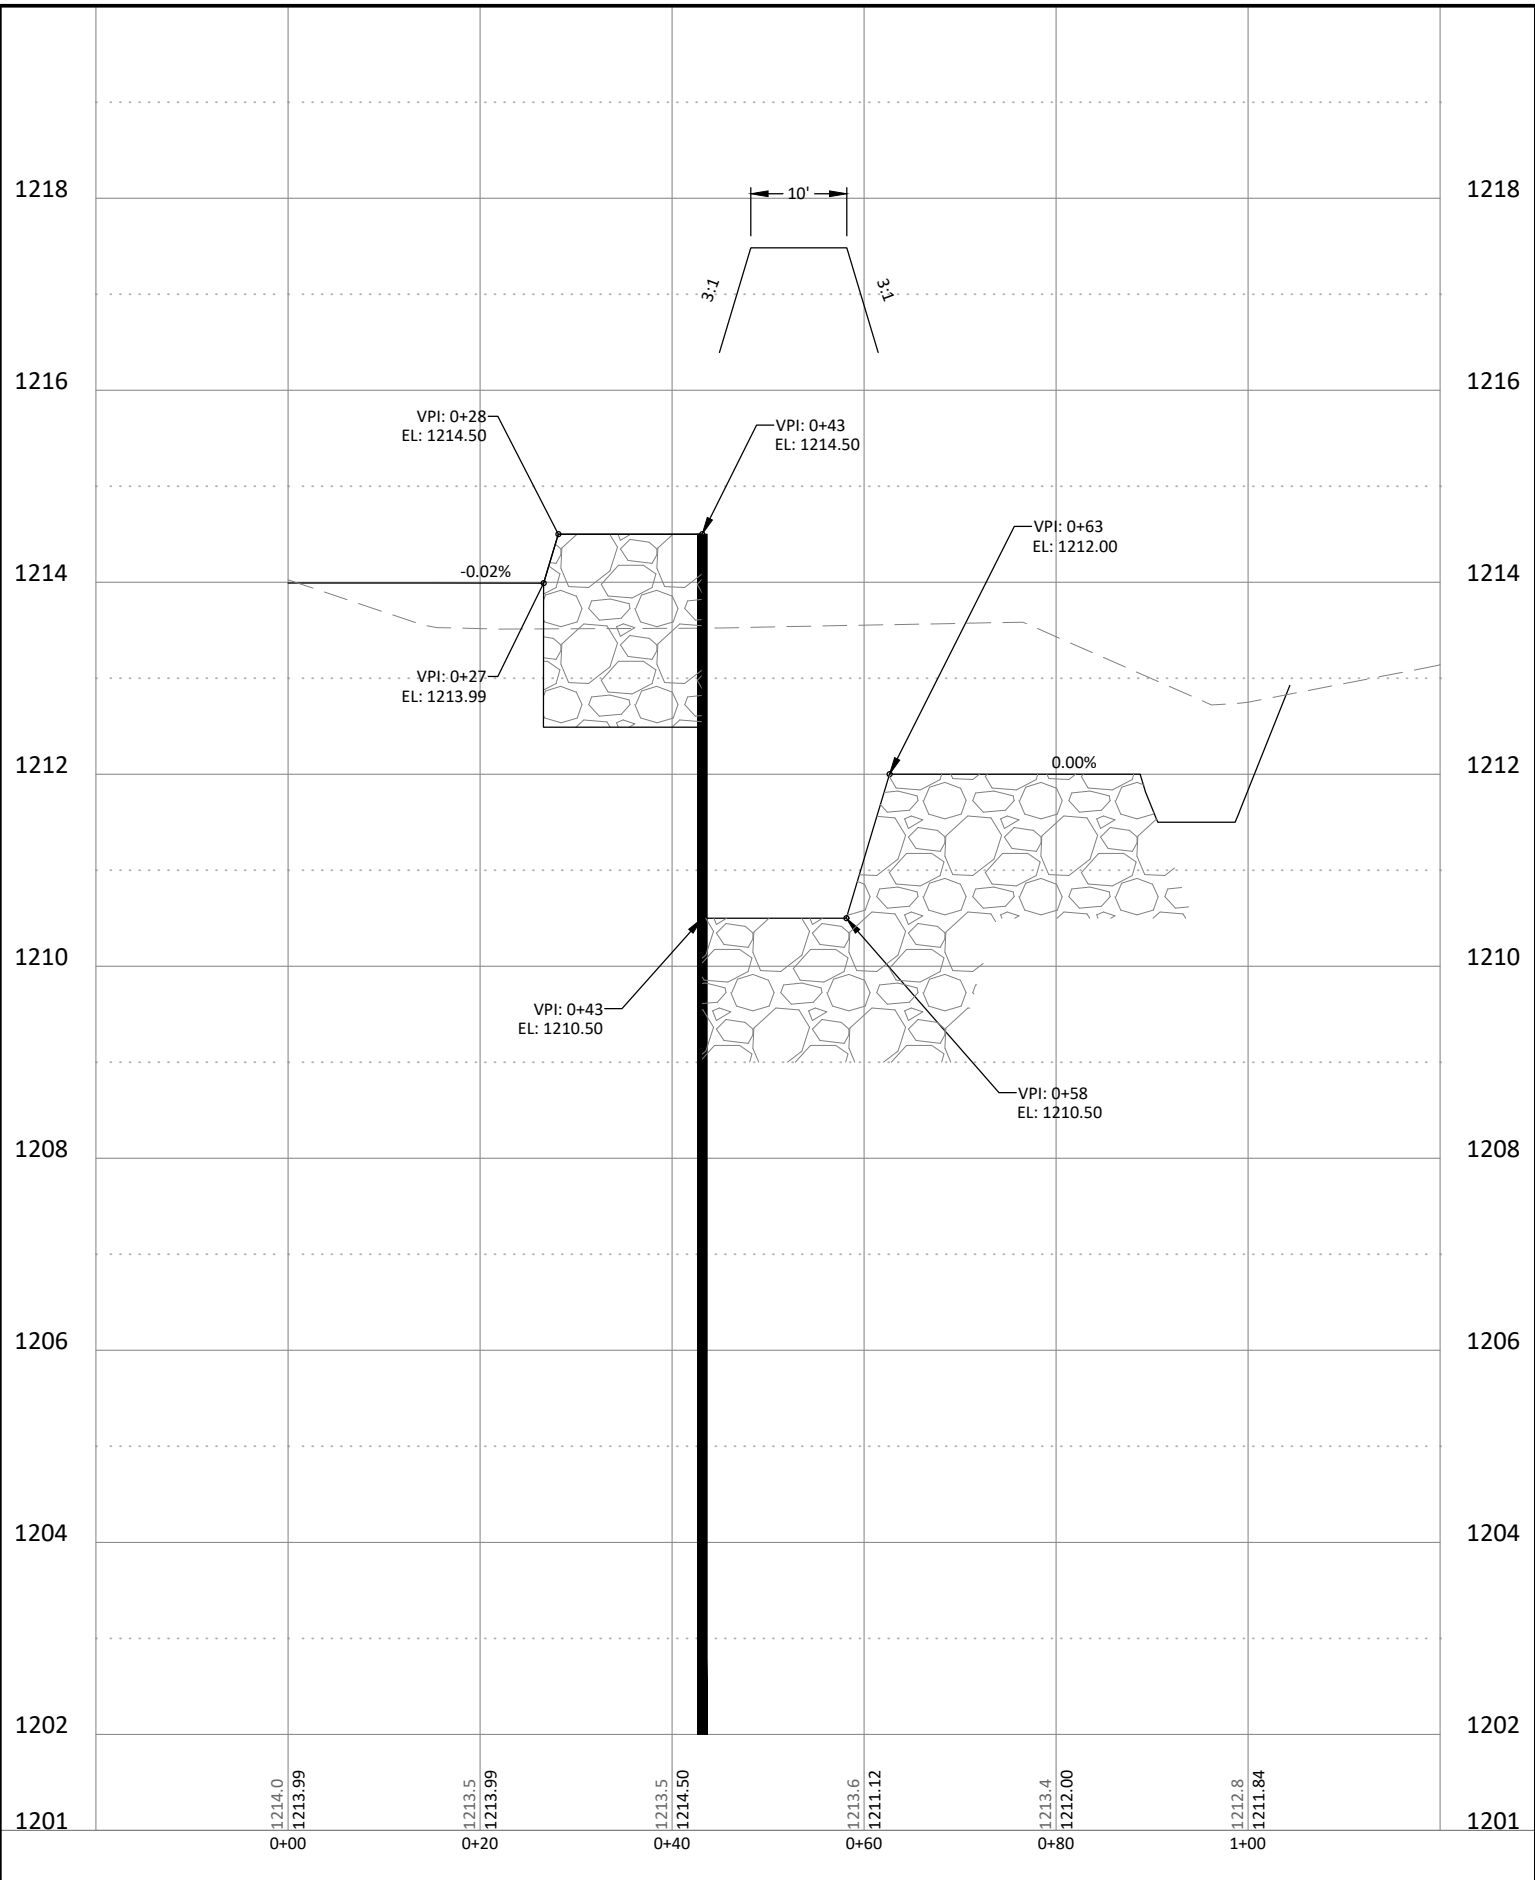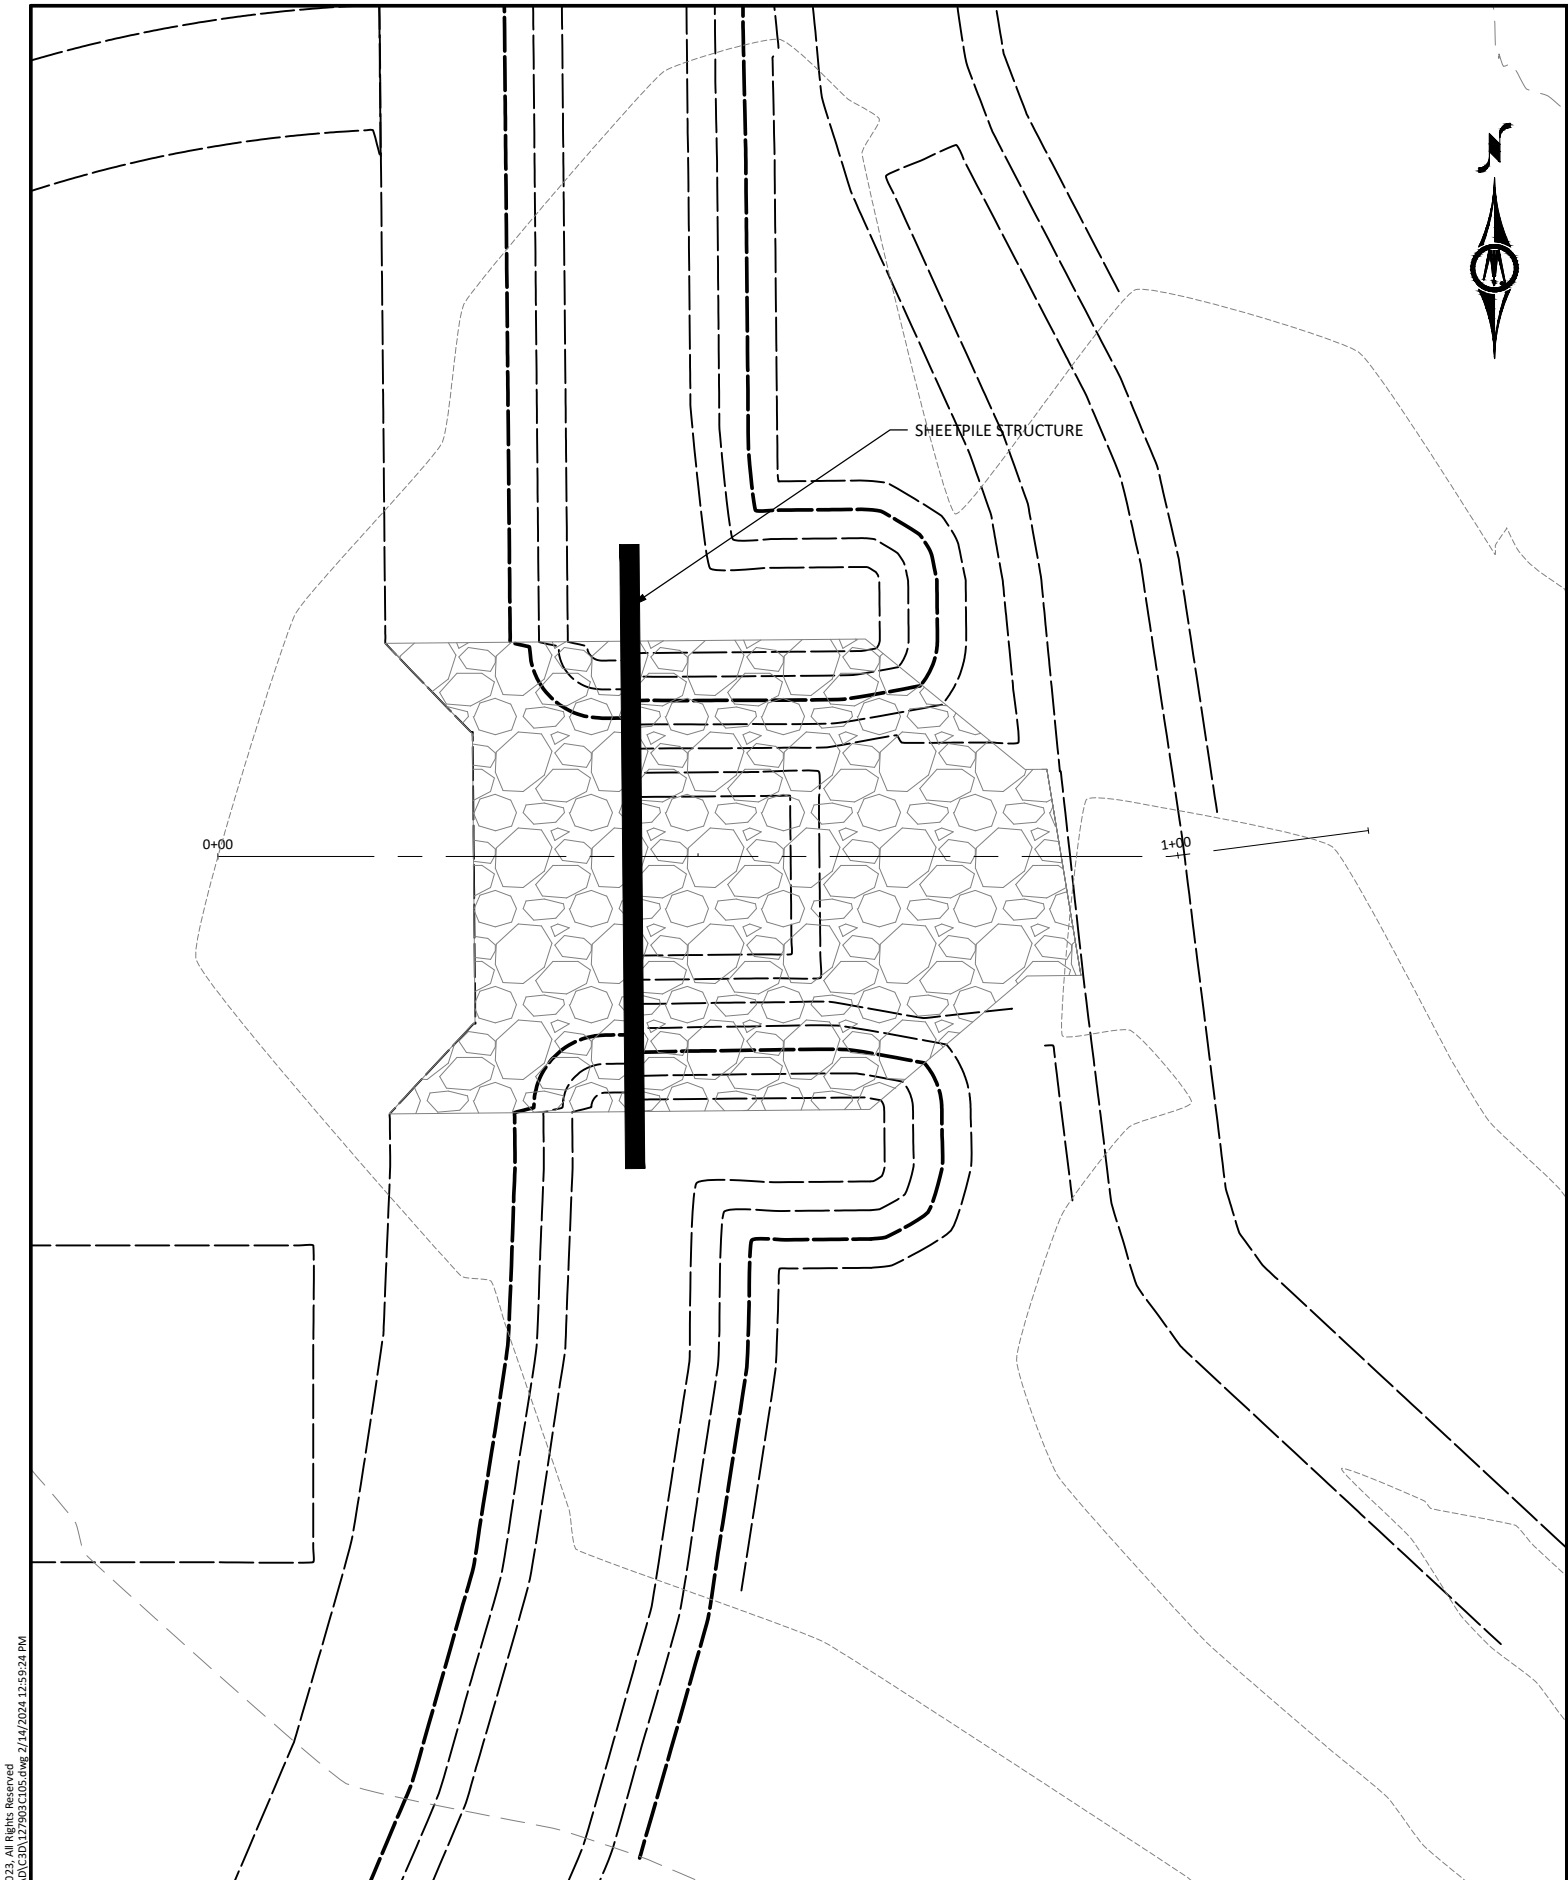

© Bolton & Menk, Inc. 2023. All Rights Reserved. PL0412301127933 CAL03127903105.dwg 2/14/2024 12:52:24 PM



1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
PETERSBURG  
STILLING BASIN DETAIL

SHEET  
B.09

DESIGN SHEET PILING AREA IS 464 SF - AFTER TRIMMING



**SHEET PILING REQUIREMENTS**

MINIMUM WEB THICKNESS 0.250" IN  
 MINIMUM SECTION MODULUS OF 1.17 CUBIC INCHES PER FOOT OF WALL.  
 MINIMUM GRADE OF STEEL IS 25 KSI.  
 MINIMUM MOMENT OF INERTIA OF .67 INCHES <sup>4</sup> PER FOOT OF WALL.  
 ALL SHEETING SHALL MEET ASTM A-328, A-572 GR50 OR A-690.

**APPROVED PRODUCTS**


CONTCH ENGINEERED SOLUTIONS LZ-250, SZ-15, SZ-14.5  
 SHORELINE STEEL LZ-250  
 SKYLINE STEEL SKS 14, SCZ 14

OTHER SHEETING MAYBE ALLOWED WITH PRIOR APPROVAL OF ENGINEER.

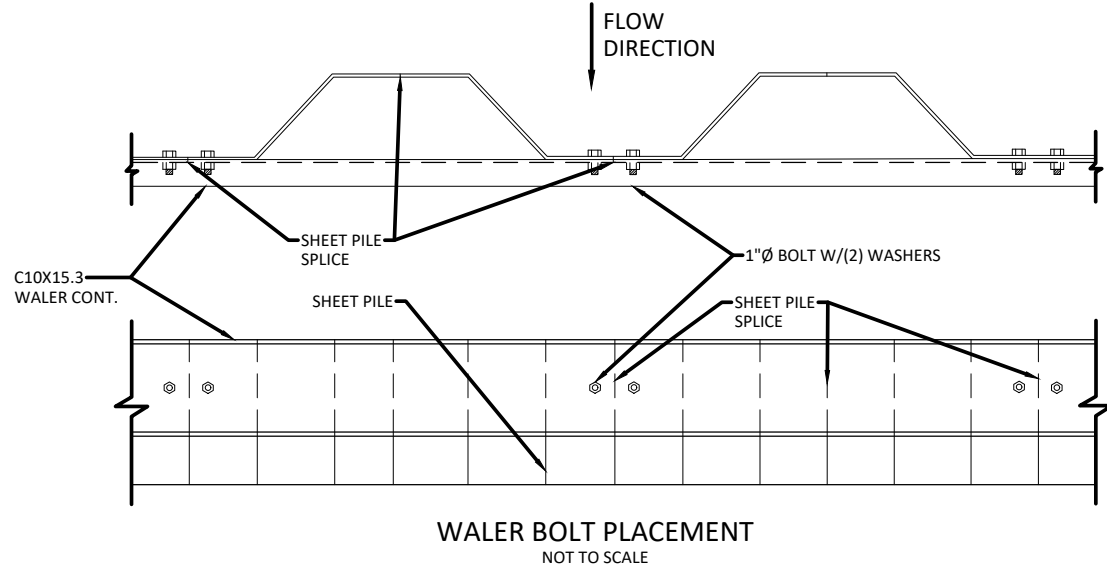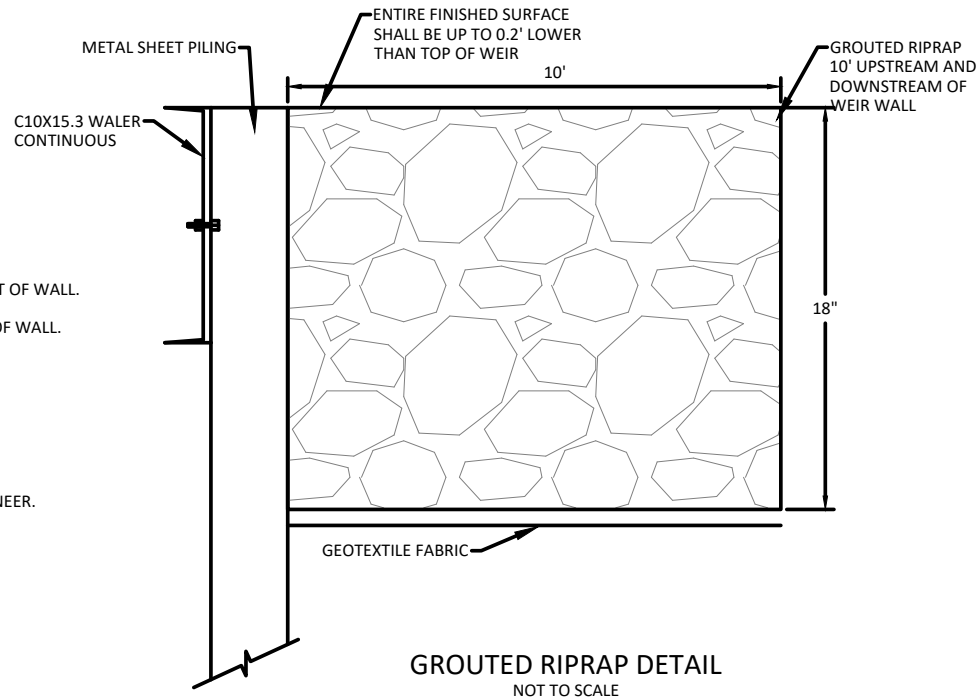



**NOTES:**

- ALL BOLTS WILL BE 1" DIA. WITH 2 WASHERS. BOLT SHALL BE EXTENDED AT A MINIMUM OF  $\frac{3}{8}$ " BEYOND THE NUT.
- ALL HOLES SHALL BE DRILLED  $\frac{1}{16}$ " DIA. LARGER THAN THE BOLT.
- THE WALER SHALL BE PLACED ON THE DOWNSTREAM SIDE OF THE WEIR.
- ANY HOLES LEFT IN SHEET PILE (LIFTING HOLES ETC.) SHALL BE WELDED CLOSED.
- AFTER SHEETING AND WALER INSTALLATION ALL SHEETING ON THE WEIR IS TO BE CUT TO CONFORM WITH 3:1 SLOPE AND THE DESIGN ELEVATIONS.
- STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN ACCORDING WITH THE LATEST SPECIFICATION OF AISC. FABRICATOR SHALL SUBMIT SHOP DRAWINGS SHOWING THAT PLANNED STEEL WILL COMPLETELY COVER INTENDED WALL AREA. FABRICATE AFTER ENGINEERS REVIEW.
- DEFLECTIONS SHALL BE MADE IN FABRICATED PIECES AND STILL CONFORM TO THE DIMENSIONS GIVEN.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE ALLOWABLE CONSTRUCTION LIVE LOADS.
- PROVIDE ALL NECESSARY TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO AVOID EXCESSIVE STRESSES AND TO HOLD STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION.

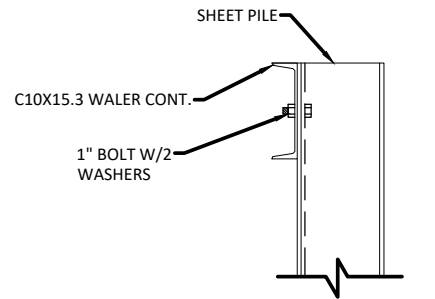

NOTE: 1 BOLT TO BE PLACED ON EACH SIDE OF SPLICE

**BOLT DETAIL**  
NOT TO SCALE

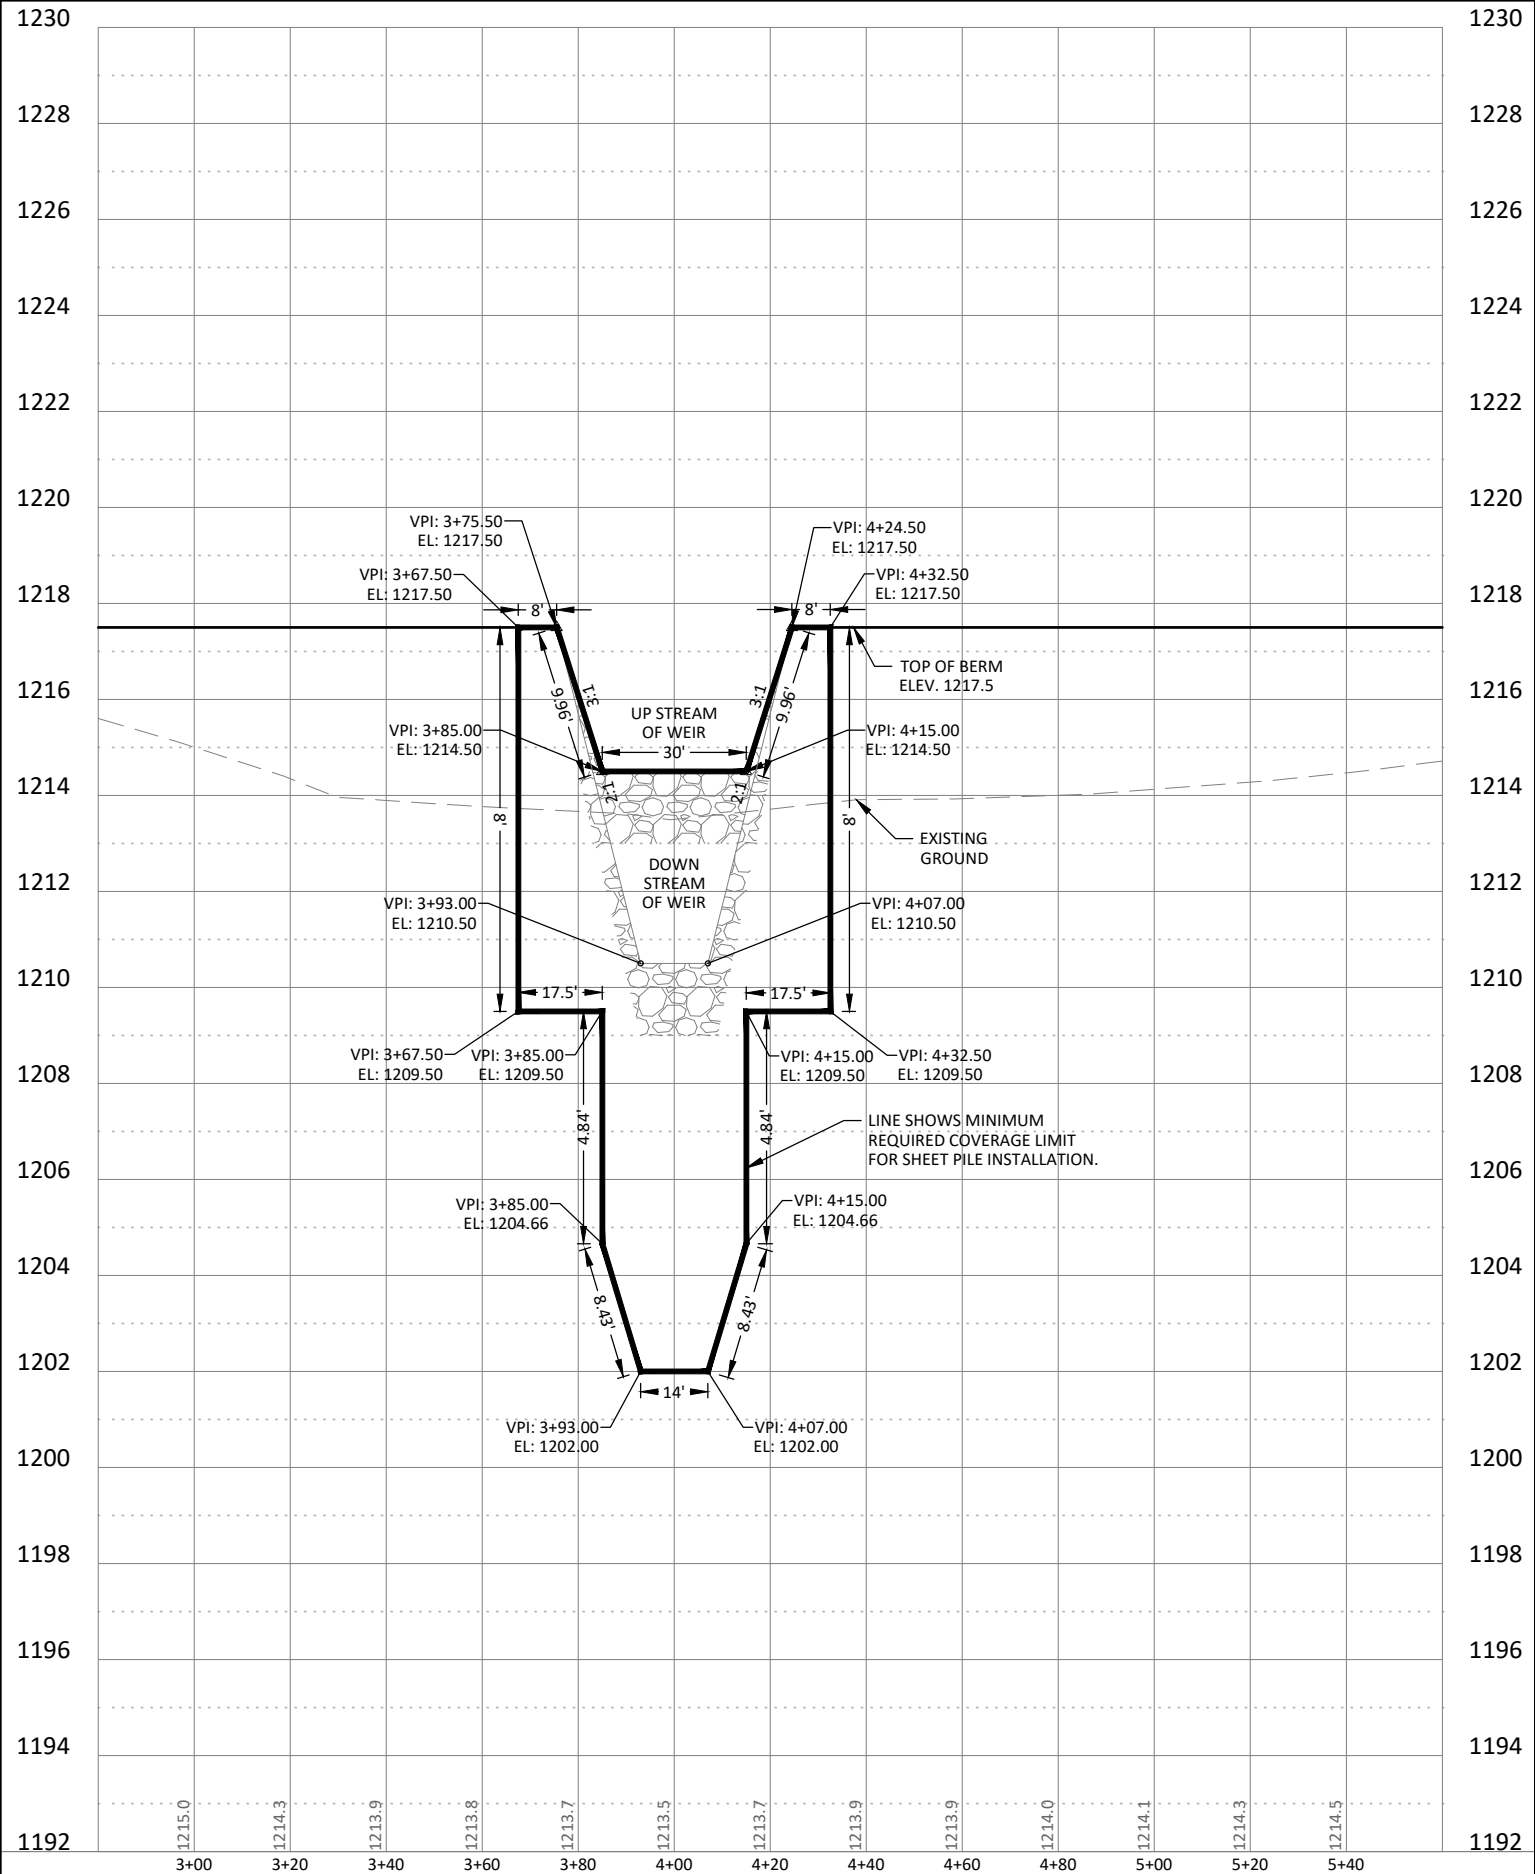

1519 BALTIMORE DRIVE  
 AMES, IOWA 50010  
 Phone: (515) 233-6100  
 Email: Ames@bolton-menk.com  
 www.bolton-menk.com


DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU

PETERSBURG

SHEET PILE DETAIL


SHEET  
B.10

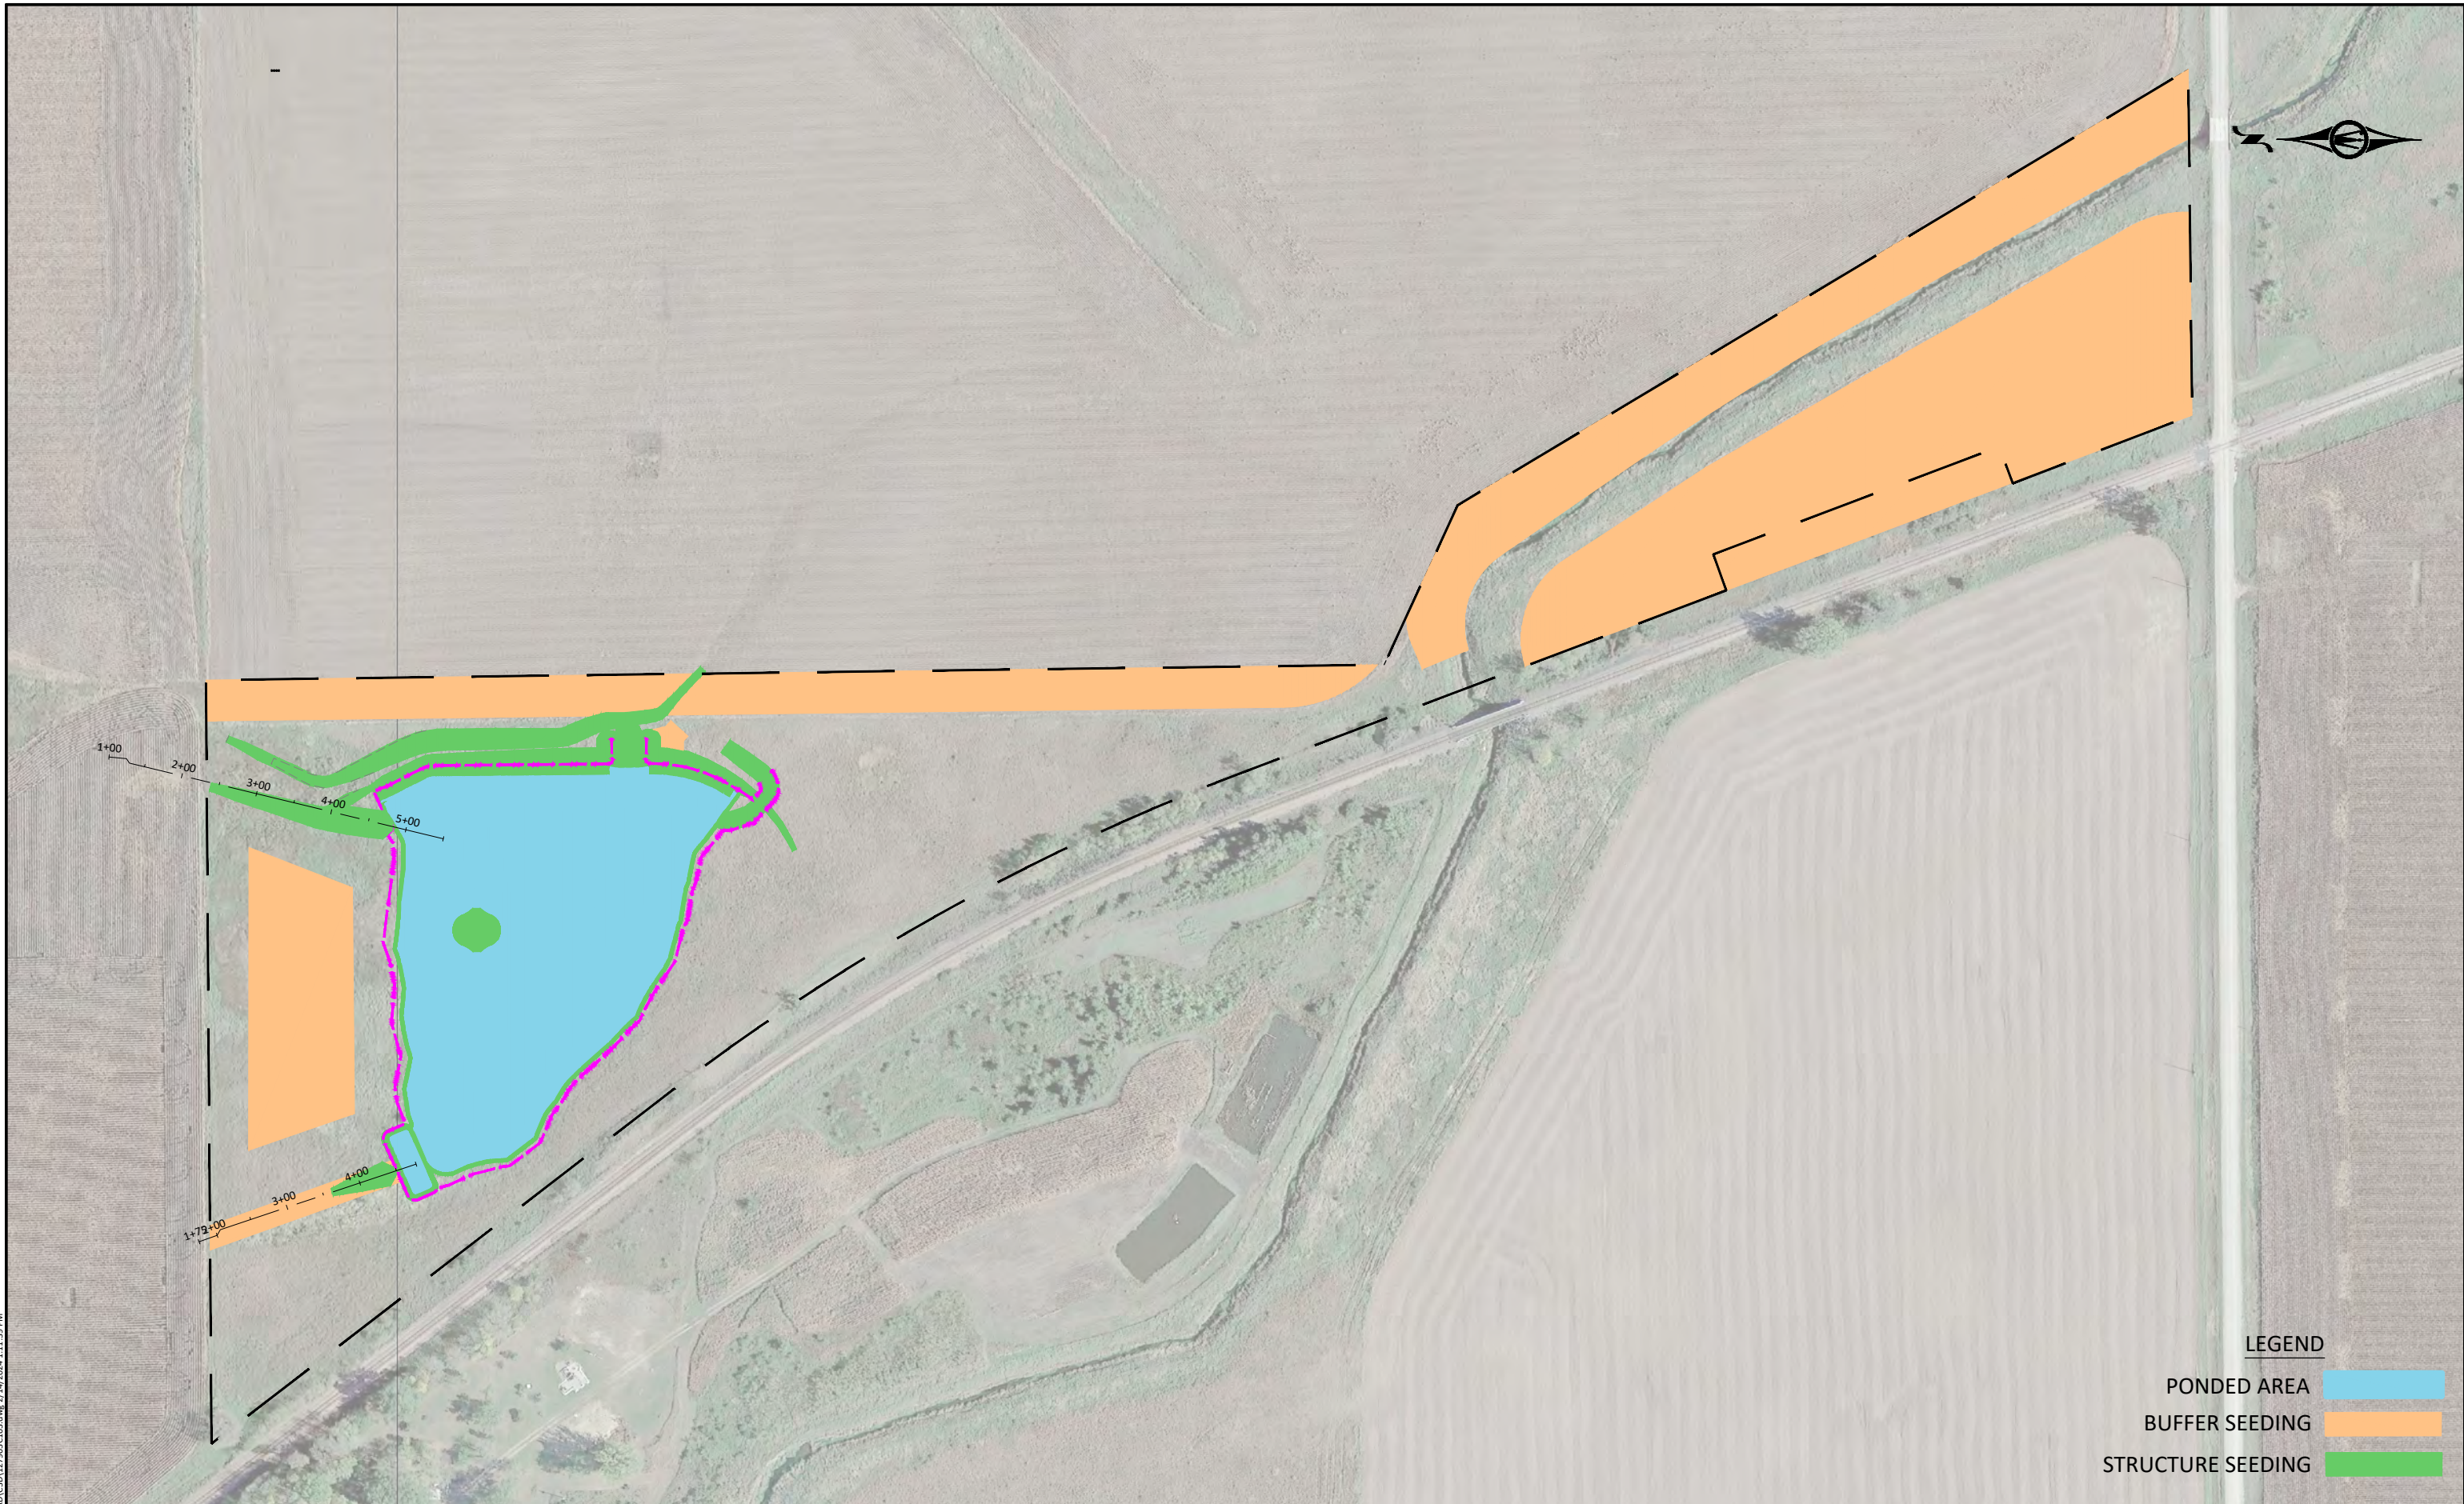

**LEGEND**

- PONDED AREA
- BUFFER SEEDING
- STRUCTURE SEEDING

© Bolton & Menk, Inc. 2023. All Rights Reserved.  
 A:\IDALS\112793\112793.dwg 2/14/2024 1:11:39 PM



1519 BALTIMORE DRIVE  
 AMES, IOWA 50010  
 Phone: (515) 233-6100  
 Email: Ames@bolton-menk.com  
 www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
 PETERSBURG  
 SEEDING MAP

SHEET  
**B.11**

Bid Item	Sub-Item	Description	Specifications		Plan No.	Estimated Quantities of Work	
			No.	Page		Quantity	Unit or Select
<b>WETLAND QUANTITIES</b>							
1	-	Site stripping & preparation	IA CS-001	1-2	A.02-04	1	LS
2	-	Crop damage	IA CS-001	1-2		0	AC
3	-	Structure & channel seeding	IA CS-006	6-9	B.10	1.4	AC
4	-	Buffer seeding	IA CS-006	6-9	B.10	9.4	AC
5	-	Mobilization and demobilization	CS-008	10-12		1	LS
6	-	Drain tile investigation and removal	IA CS-009	13-16	A.02-04	1	LS
7	-	Steel sheet piling	IA CS-013	19-20	B.06-09, D.01	610	SF
8	-	Excavation (General)	IA CS-021	21-23	D.01-05	4560	CY
9	-	Earthfill (General)	IA CS-023	24-28	D.01-05	830	CY
10	-	Earthfill (General Dam)	IA CS-023	24-28	D.01	1320	CY
11	-	Earthfill (Dam Core)	IA CS-023	24-28	D.01	1080	CY
12	-	Drainfill, fine	IA CS-024	29-31		60	CY
13	-	Topsoil Placement	IA CS-026	32-33	A.02-04	5840	CY
14	-	CMP tile outlets (20 LF each):					
	A.	18" x 20'	IA CS-051	50-53	M.02	1	EA
	B.	24" x 20'	IA CS-051	50-53	M.01	1	EA
15	-	Riprap (Class E)	IA CS-061	54-55	B.08-09, D.01	50	TN
16	-	Concrete grout	IA CS-062	56-58	B.08-09, D.01	40	CY
17	-	Geotextile Fabric	IA CS-095	56-58	B.08-09, D.01	220	SY
18	-	Concrete structures (Outlet):					
	A.	SW-401	IA CS-031, 6010-1.08-B	34-40	B.03, M.04	1	EA
	B.	SW-402 Water Control Outlet Structure	IA CS-031, 6010-1.08-B	34-40	B.03, M.04	1	EA
	C.	SW-512	IA CS-031, 6010-1.08-B	34-40	B.04, M.03-04	1	EA
19	-	Toe Drain					
	A.	Corrugated Polyethylene pipe (single wall) (perforated) - 6" Diameter	IA-CS-045	41-45	M.03	700	LF
20	-	Reinforced concrete pipe (RCP)					
	A.	12" Diameter	IA-CS-046, SUDAS 4020	46-49	M.02	232	LF
	B.	15" Diameter	IA-CS-046, SUDAS 4020	46-49	M.04	29	LF
	C.	18" Diameter	IA-CS-046, SUDAS 4020	46-49	M.01, M.04	401	LF
21	-	RCP Drawdown Wetland Outlet Pipe					
	A.	15" Diameter	IA-CS-031, SUDAS 4020	34-40	B.05, M.04	40	LF
22	-	Silt Fence	IA-CS-005	3-4	D.04	250	LF
<b>SATURATED BUFFER QUANTITIES</b>							
23	-	Excavation (General)	IA-CS-021	21-23	M.08	3660	CY
24	-	Corrugated Polyethylene pipe (single wall) (perforated):					
	A.	6" Diameter	IA CS-045	41-45	M.07	237	LF
	B.	8" Diameter	IA CS-045	41-45	M.05-06	982	LF
25	-	Corrugated profile wall (Dual wall) Polyethylene pipe:					
	A.	10" Diameter	IA CS-045	41-45	M.07	28	LF
26	-	CMP tile outlets (20 LF each):					
	A.	12" x 20'	IA CS-051	50-53	M.07	1	EA
27	-	Reinforced concrete pipe (RCP)					
	A.	18" Diameter	IA-CS-046, SUDAS 4020	46-49	M.05	56	LF
28	-	North AgriDrain Water Control Structure	IA CS-045	41-45	M.05-07	1	EA
29	-	South AgriDrain Water Control Structure	IA CS-045	41-45	M.05-07	1	EA




ESTIMATE REFERENCE INFORMATION	
ITEM NO.	DESCRIPTION
1	SITE STRIPPING & PREPERATION THIS INCLUDES CLEARING, GRUBBING, STRIPPING, REFUSE REMOVAL, BANK SLOPING AND STRUCTURE REMOVAL ON THE SITE NECESSARY TO RID THE SITE OF ALL UNDESIRABLE MATERIALS ON OR NEAR THE SURFACE AND PREPARE THE SITE FOR THE STRUCTURE.
2	CROP DAMAGE THIS INCULDES CROP DAMAGE THAT RESULTS FROM CONSTRUCTION ACTIVITY.
3	STRUCTURE & CHANNEL SEEDING INCLUDES SEEDING OF HIGH WATER BERMS AND AREAS DISTURBED AROUND STRUCTURES. SEED MIX SHALL BE APPROVED BY IDALS AND THE NRCS.
4	BUFFER SEEDING INCLUDES SEEDING THE AREAS DESIGNATED ON THE PLANS AS BUFFER SEEDING AND INCLUDES BORROW AREAS, DISTURBED AREAS NOT SEEDED AS PART OF STRUCTURAL SEEDING, AND OTHER AREAS WITHIN THE EASEMENT
5	MOBILIZATION/DEMOLIBIZATION INCLUDES MOBILIZATION AND DEMOLIBIZATION OF THE CONTRACTOR'S FOURCES AND EQUIPMENT NECESSARY FOR PERFORMING THE WORK REQUIRED UNDER CONTRACT
6	DRAIN TILE INVESTIGATION AND REMOVAL THIS ITEM WILL CONSIST OF THE EXPLORATION REQUIRED TO LOCATE TILES SHOWN ON THE PLANS OR NOT SHOWN AND THE EXCAVATIONS REQUIRED TO ABANDON THE TILES SHOWN ON THE PLANS OR NOT SHOWN. THIS IS FULL COMPENSATION FOR THE EXCAVATION, BACKFILLING AND ABANDONMENT OF THE TILE TRENCHES WITHIN THE PERMANENT EASEMENT BOUNDARY.
7	STEEL SHEET PILE THIS ITEM SHAL CONSIST OF FURNISHING AND DRIVING THE SPECIFIC SHEET PILING AT THE LOCATION SHOWN ON THE DRAWINGS
8	EXCAVATION (GENERAL) THIS IS FULL COMPENSATION FOR THE EXCAVATION REQUIRED FOR THE CORE TRENCH, POOL AREA AND OUTLET CHANNEL. NO ADDITIONAL MEASURMENTS WILL BE TAKED AT THE END OF EXCAVATION. EXCAVATION WILL BE PAID BASED ON THE QUANTITY OUTLINED IN COST ESTIMATE AND PLAN SET.
9	EARTHFILL (GENERAL) THIS INCLUDES THE CONSTRUCTION OF THE COVER BERMS AND THE DIVERSION BERMS TO THE SLOPES AND ELEVATIONS DETAILED ON THE PLANS THE CONTRACTOR SHALL PROVIDE A MINIMUM ALLOWABLE SETTLEMENT OF 5% OF THE TOTAL FILL DEPTH WHEN CONSTRUCTING THE BERM. THIS ADDITIONAL QUANTITY OF MATERIAL IS NOT FIGURED INTO THE BID QUANTITY. EXCESS MATERIAL FROM EXCAVATIONS CAN BE USED OR WASTED HERE TO BUILD THE SLOPES. THIS QUANTITY ASSUMED A 35% SHRINKAGE FACTOR ON THE MATERIAL.
10	EARTHFILL (GENERAL DAM) THIS INCLUDES THE CONSTRUCTION OF THE EMBANKMENT BERM (DIKE) TO THE SLOPES AND ELEVATIONS DETAILED ON THE PLANS THE CONTRACTOR SHALL PROVIDE A MINIMUM ALLOWABLE SETTLEMENT OF 5% OF THE TOTAL FILL DEPTH WHEN CONSTRUCTING THE BERM. THIS ADDITIONAL QUANTITY OF MATERIAL IS NOT FIGURED INTO THE BID QUANTITY. EXCESS MATERIAL FROM EXCAVATIONS CAN BE USED OR WASTED HERE TO BUILD THE SLOPES. THIS QUANTITY ASSUMED A 35% SHRINKAGE FACTOR ON THE MATERIAL.
11	EARTHFILL (DAM CORE) THIS INCLUDES THE CONSTRUCTION OF THE CORE TRENCH OF THE EMBANKMENT BERM TO THE SLOPES AND ELEVATIONS DETAILED ON THE PLANS THE CONTRACTOR SHALL PROVIDE A MINIMUM ALLOWABLE SETTLEMENT OF 5% OF THE TOTAL FILL DEPTH WHEN CONSTRUCTING THE BERM. THIS ADDITIONAL QUANTITY OF MATERIAL IS NOT FIGURED INTO THE BID QUANTITY. EXCESS MATERIAL FROM EXCAVATIONS CAN BE USED OR WASTED HERE TO BUILD THE SLOPES. THIS QUANTITY ASSUMED A 35% SHRINKAGE FACTOR ON THE MATERIAL.
12	DRAINFILL, FINE THIS ITEM INCLUDES FURNISHING AND PLACING DRAINFILL REQUIRED IN THE CONSTRUCTION OF TOEWALL DRAINAGE SYSTEM
13	TOPSOIL PLACEMENT THIS ITEM INCLUDES REMOVAL OF VEGETATION FROM THE BORROW AREA PRIOR TO STRIPPING TOPSOIL, CLEARING AND GRUBBING, AND ANY FENCE REMOVAL/REPLACMENT NEEDED TO ACCESS AREAS ON PROJECT. ANY FENCE REMOVAL NEEDED SHALL BE COORDINATE WITH PROPERTY OWNER TO MAINTAIN CATTLE CONFINEMENT.
14 A	CMP TILE OUTLETS, 18" X 20' THIS IS FULL COMPENSATION FOR INSTALLATION, BEDDING AND BACKFILLING OF THE BYPASS TILE. LENGTH IS MEASURED FROM CENTER OF STRUCTURE
14 B	CMP TILE OUTLETS, 24" X 20' THIS IS FULL COMPENSATION FOR INSTALLATION, BEDDING AND BACKFILLING OF THE BYPASS TILE. LENGTH IS MEASURED FROM CENTER OF STRUCTURE
15	RIPRAP (CLASS E) THIS ITEM INCLUDES THE CONSTRUCTION OF LOOSE ROCK RIPRAP REVETMENTS, STRUCTURES AND BLANKETS, INCLUDING FILTER LAYES OR BEDDING WHERE SPECIFIED ON SHEET B.08 AND B.09
16	CONCRETE GROUT THIS ITEM INCLUDES FURNISHING, TRANSPORTING, AND PLACING CONCRETE GROUT IN THE CONSTRUCTION OF GROUTED RIPRAP SECTIONS AS SHOWN ON IN SHEET B.08 AND B.09

ESTIMATE REFERENCE INFORMATION (CONTINUED)	
ITEM NO.	DESCRIPTION
17	GEOTEXTILE FABRIC THIS ITEM SHALL CONSIST OF FURNISHING AND PLACING GEOTEXTILE ON ALL SURFACES THAT CONTACT THE ROCK RIPRAP WITHIN THE STILLING BASIN AS SHOWN IN THE DRAWINGS
18 A	STRUCTURE, SW-401 SEE SHEET B.03 FOR DETAILS.
18 B	STRUCTURE, SW-402 SEE SHEET B.03 AND B.06 FOR DETAILS. INCLUDES FURNISHING AND INSTALLING STOP LOG CHANNELS, MANHOLE STEPS, AND ALUMINUM ACCESS DOOR, STOP LOGS, STOP LOG REMOVAL TOOL, STOPLOG STORAGE w/GRATE AND COLLAR, WATERTIGHT PIPE CONNECTIONS ARE ALL INCIDENTAL TO THIS BID ITEM.
18 C	STRUCTURE, SW-512 SEE SHEET B.04 FOR DETAILS.
19 A	TOE DRAIN, CORRUGATED POLYETHYLENE PIPE (PERFORATED), 6" THIS IS FULL COMPENSATION FOR INSTALLATION, BEDDING AND BACKFILLING OF THE TOE DRAIN TILE. THIS ITEM INCLUDES FULL COMPENSATION FOR ALL JUNCTIONS, FITTINGS, AND END CAPS NECESSARY FOR PROPER INSTALLATION ACCORDING TO PLANS AND SPECIFICATIONS. LENGTH IS MEASURED FROM CENTER OF STRUCTURE TO CENTER OF STRUCTURE AND THROUGH BENDS. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON SHEET B.02.
20 A	REINFORCED CONCRETE PIPE (RCP), 12" DIAMETER THIS IS FULL COMPENSATION FOR INSTALLATION, BEDDING AND BACKFILLING OF THE BYPASS TILE. LENGTH IS MEASURED FROM CENTER OF STRUCTURE. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON B.01
20 B	REINFORCED CONCRETE PIPE (RCP), 15" DIAMETER THIS IS FULL COMPENSATION FOR INSTALLATION, BEDDING AND BACKFILLING OF THE BYPASS TILE. LENGTH IS MEASURED FROM CENTER OF STRUCTURE. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON B.01
20 C	REINFORCED CONCRETE PIPE (RCP), 18" DIAMETER THIS IS FULL COMPENSATION FOR INSTALLATION, BEDDING AND BACKFILLING OF THE BYPASS TILE. LENGTH IS MEASURED FROM CENTER OF STRUCTURE. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON B.01
21	RCP DRAWDOWN WETLAND OUTLET PIPE, 15" DIAMETER THIS ITEM WILL CONSIST OF PROVIDING AND INSTALLING THE RCP DRAWDOWN OUTLET PIPE AS SHOWN IN THE DRAWINGS ALONG WITH THE INLET RISER STRUCTURE AND ANTI-SEEP COLLAR(S) AS DETAILED IN THE DRAWINGS. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON B.01
22	SILT FENCE SILT FENCE TO BE INSTALLED DURING CONSTRUCTION. ITEM INCLUDES ANCHORING POSTS, MAINTENANCE AND CLEANING, REMOVAL AND RESTORATION OF THE AREA TO FINISHED GRADE, AND DISPOSAL.
23	EXCAVATION (GENERAL) THIS IS FULL COMPENSATION FOR THE EXCAVATION REQUIRED FOR GRADING THE DITCH BANK. NO ADDITIONAL MEASUREMENTS WILL BE TAKED AT THE END OF EXCAVATION. EXCAVATION WILL BE PAID BASED ON THE QUANTITY OUTLINED IN COST ESTIMATE AND PLAN SET.
24 A	CORRUGATED POLYETHYLENE PIPE (PERFORATED), 6" DIAMETER THIS ITEM INCLUDES MEASUREMENT AND PAYMENT FOR THE PVC OR PE PIPE INSTALLED ON A LINEAR FOOT BASIS, AND SHALL INCLUDE ALL NECESSARY FITTINGS AND ADAPTERS, WATERTIGHT JOINTS, EXCAVATION AND BACKFILL. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON SHEET B.02.
24 B	CORRUGATED POLYETHYLENE PIPE (PERFORATED), 8" DIAMETER THIS ITEM INCLUDES MEASUREMENT AND PAYMENT FOR THE PVC OR PE PIPE INSTALLED ON A LINEAR FOOT BASIS, AND SHALL INCLUDE ALL NECESSARY FITTINGS AND ADAPTERS, WATERTIGHT JOINTS, EXCAVATION AND BACKFILL. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON SHEET B.02.
25 A	CORRUGATED PROFILE WALL (DUAL WALL) POLYETHYLENE PIPE 10" DIAMETER THIS ITEM INCLUDES MEASUREMENT AND PAYMENT FOR THE PVC OR PE PIPE INSTALLED ON A LINEAR FOOT BASIS, AND SHALL INCLUDE ALL NECESSARY FITTINGS AND ADAPTERS, WATERTIGHT JOINTS, EXCAVATION AND BACKFILL. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON SHEET B.02.
26 A	CMP TILE OUTLETS, 12" X 20' THIS IS FULL COMPENSATION FOR INSTALLATION, BEDDING AND BACKFILLING OF THE BYPASS TILE. LENGTH IS MEASURED FROM CENTER OF STRUCTURE
27 A	REINFORCED CONCRETE PIPE (RCP), 18" DIAMETER THIS IS FULL COMPENSATION FOR INSTALLATION, BEDDING AND BACKFILLING OF THE BYPASS TILE. LENGTH IS MEASURED FROM CENTER OF STRUCTURE. TRENCH INSTALLATION SHALL COMPLY WITH DETAILS ON B.01
28	NORTH AGRIDRAIN WATER CONTROL STRUCTURE THIS ITEM INCLUDES FURNISHING AND INSTALLING 31" WIDE BY 39" DEEP BY 8' TALL INLINE WATER LEVEL CONTROL STRUCTURE FROM AGRIDRAIN CORPORATION OR AN EQUAL APPROVED BY THE ENGINEER ALONG WITH CONDUITS AND APPURTENANCES NECESSARY FOR WATER CONTROL STRUCTURE. FOLLOW MANUFACTURER'S INSTALLATION INSTRUCTIONS.
29	SOUTH AGRIDRAIN WATER CONTROL STRUCTURE THIS ITEM INCLUDES FURNISHING AND INSTALLING 31" WIDE BY 39" DEEP BY 8' TALL INLINE WATER LEVEL CONTROL STRUCTURE FROM AGRIDRAIN CORPORATION OR AN EQUAL APPROVED BY THE ENGINEER ALONG WITH CONDUITS AND APPURTENANCES NECESSARY FOR WATER CONTROL STRUCTURE. FOLLOW MANUFACTURER'S INSTALLATION INSTRUCTIONS.



DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			



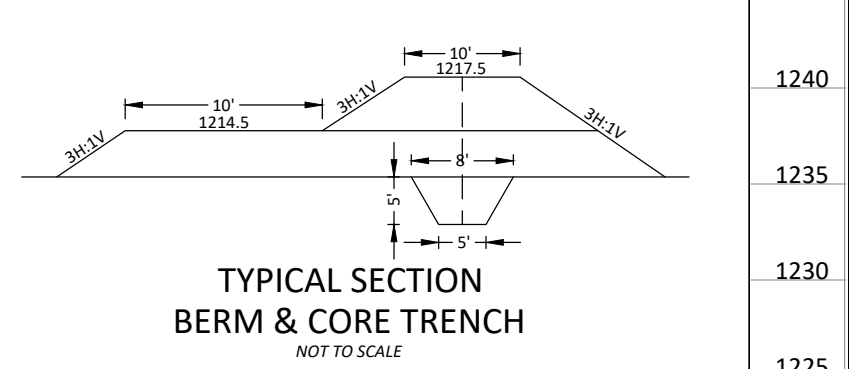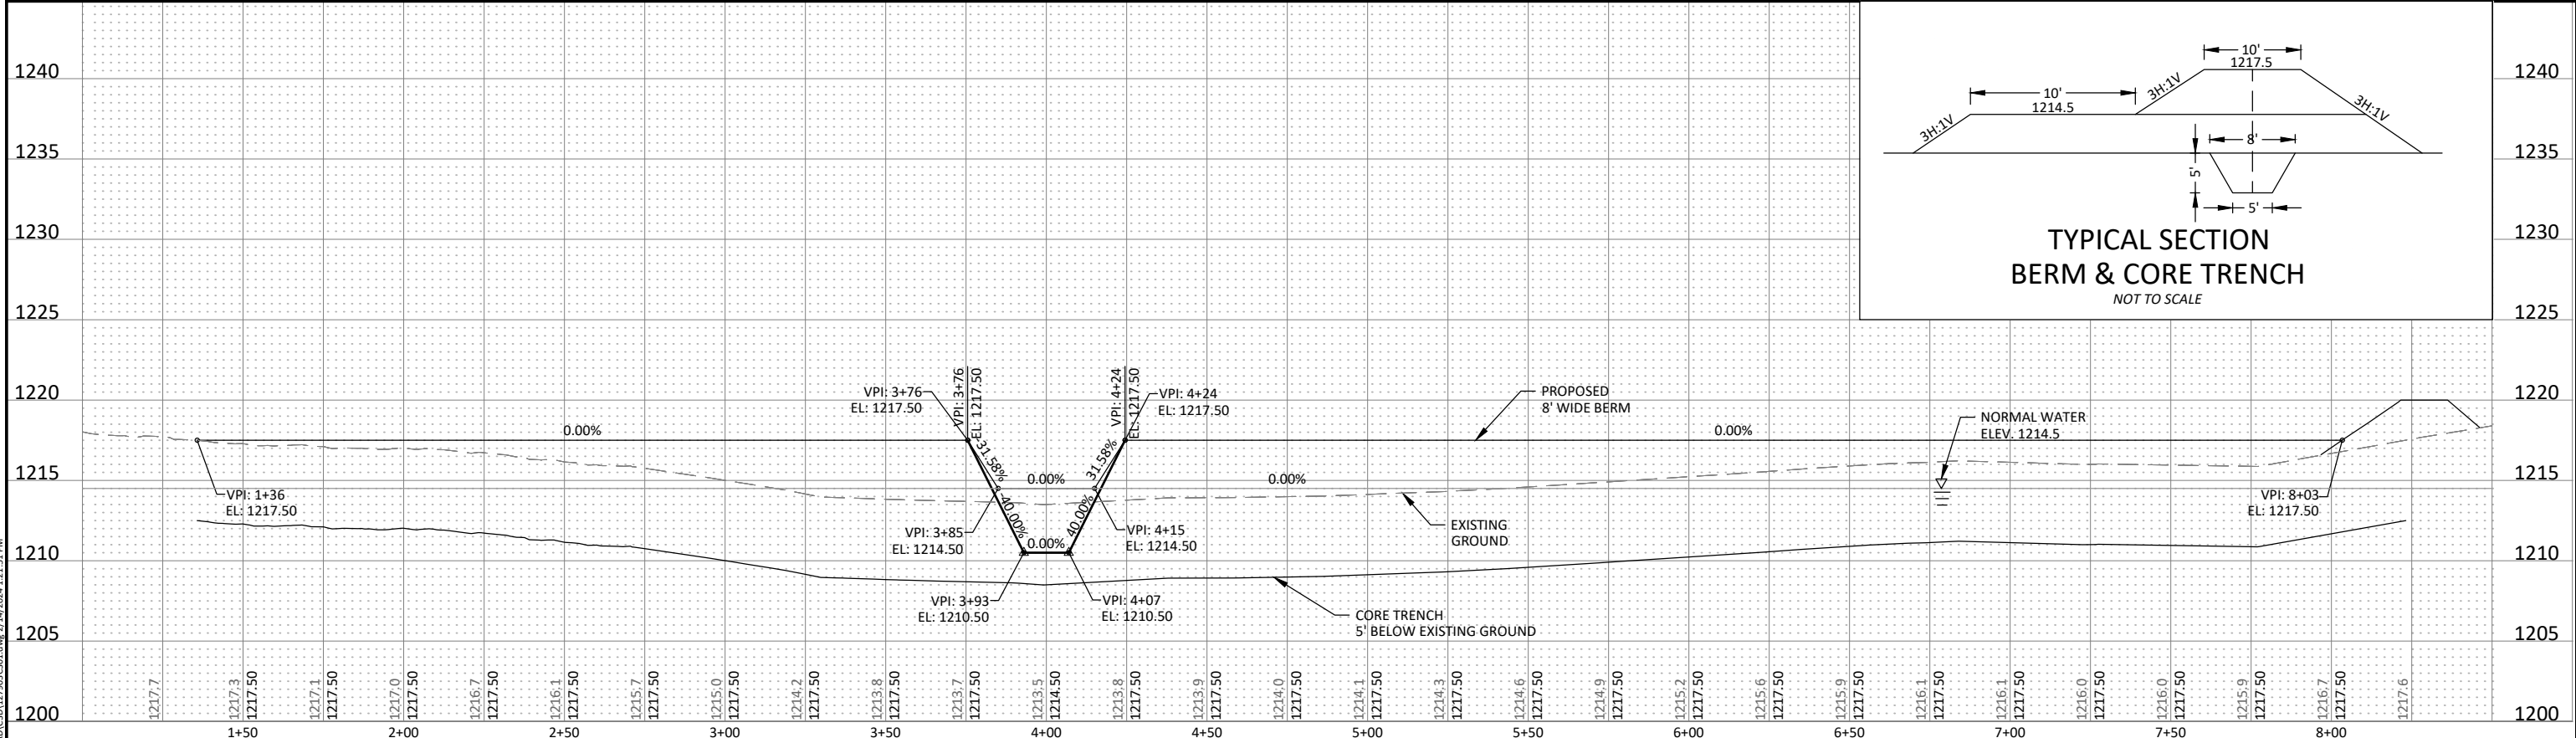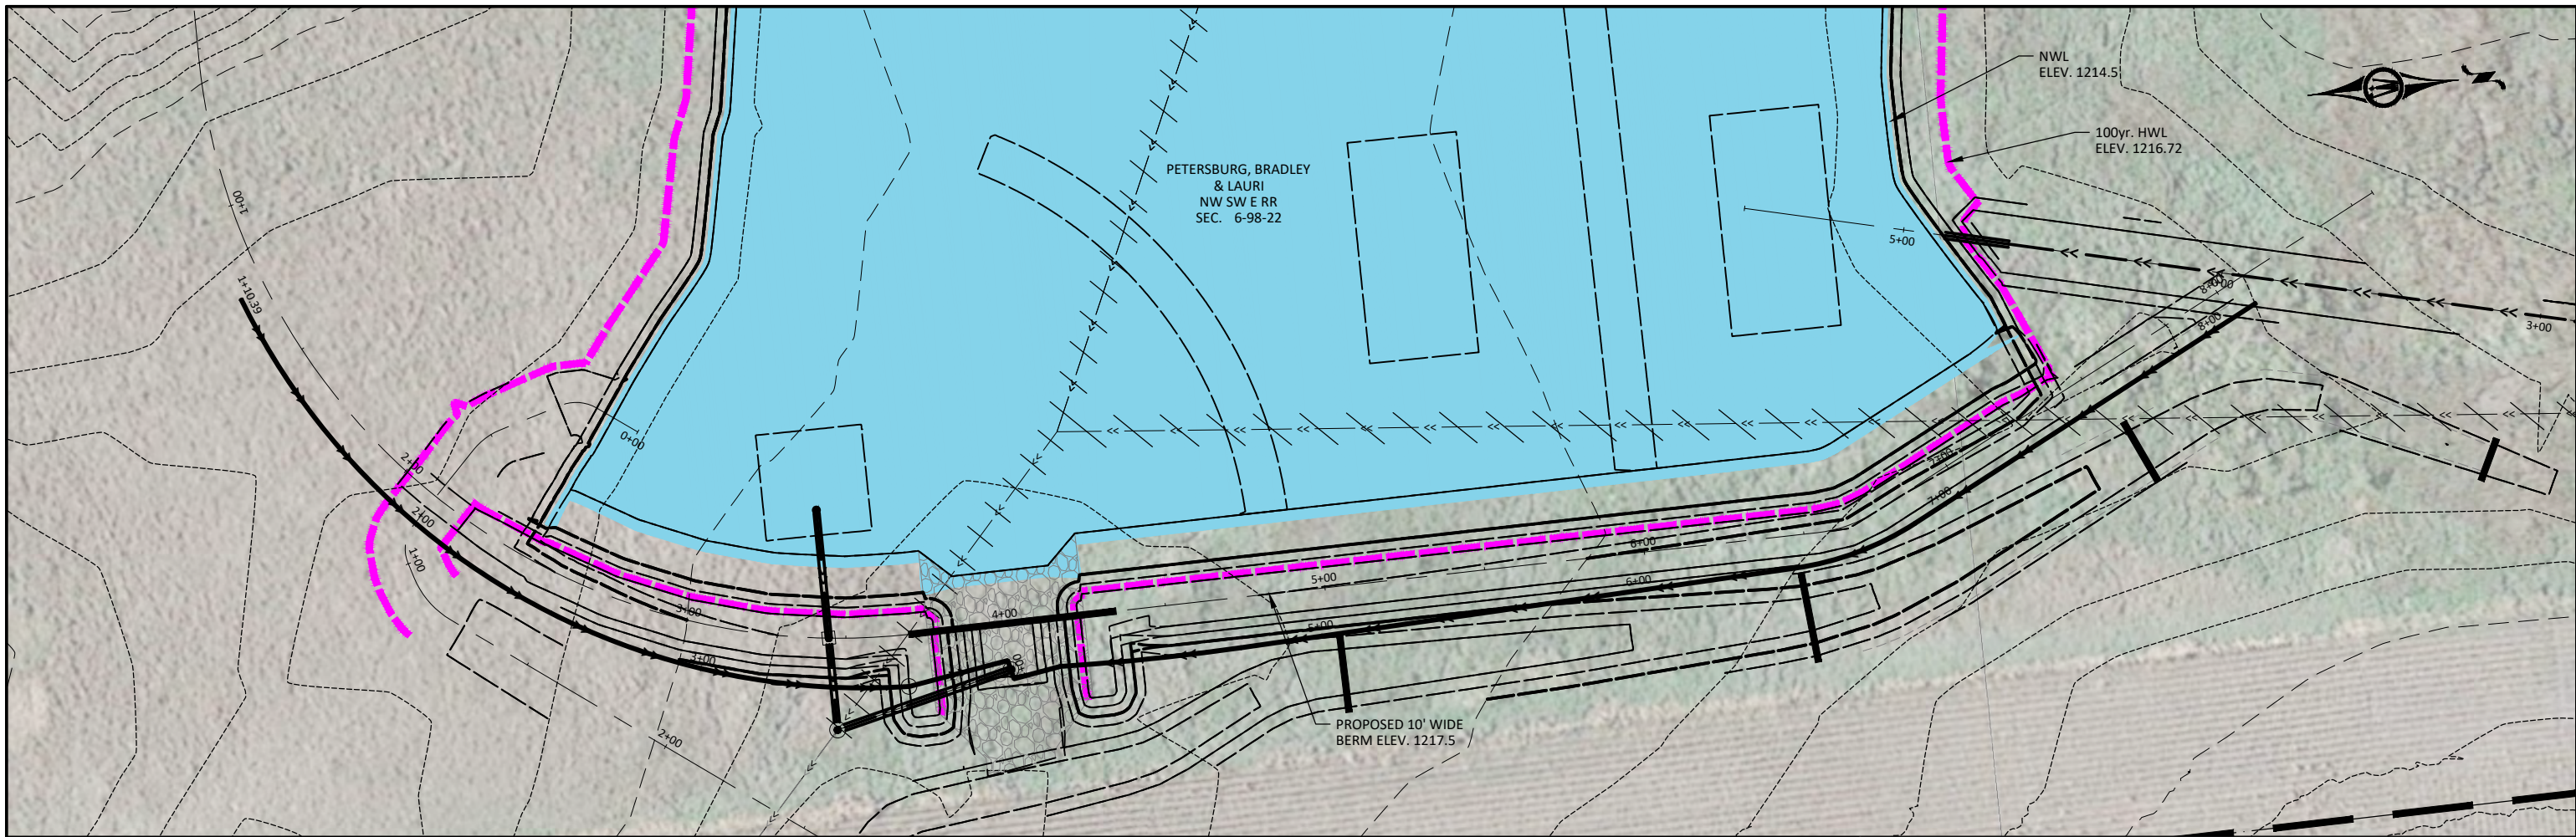

© Bolton & Menk, Inc. 2023. All Rights Reserved. IDALS(2023)127903 CAD/CADD/127903/001.dwg 2/24/2024 12:51 PM





1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com



DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
PETERSBURG  
PLAN & PROFILE - 10' WIDE BERM


SHEET  
D.01

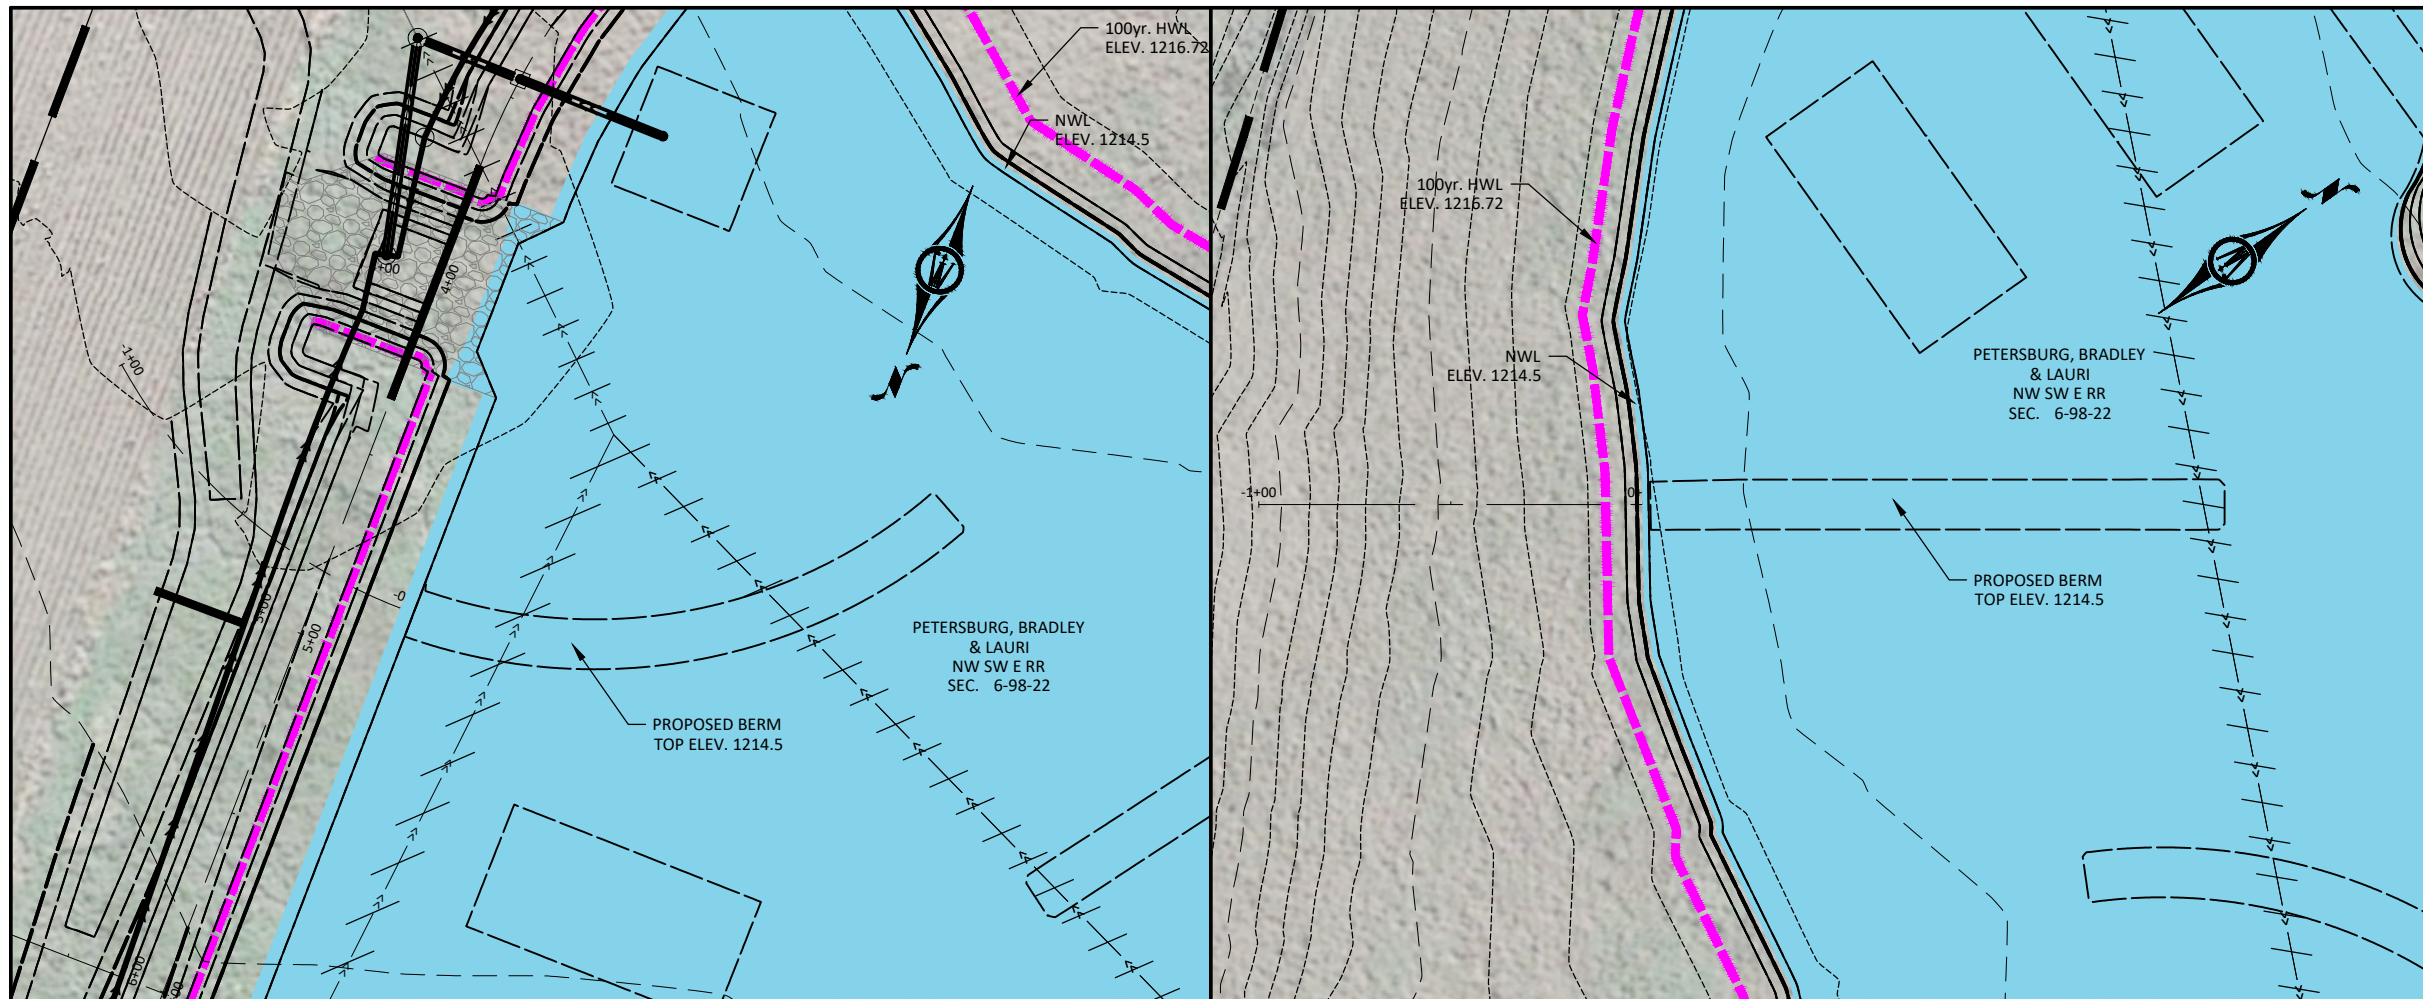

**TYPICAL SECTION  
DIVERSION BERM**  
NOT TO SCALE

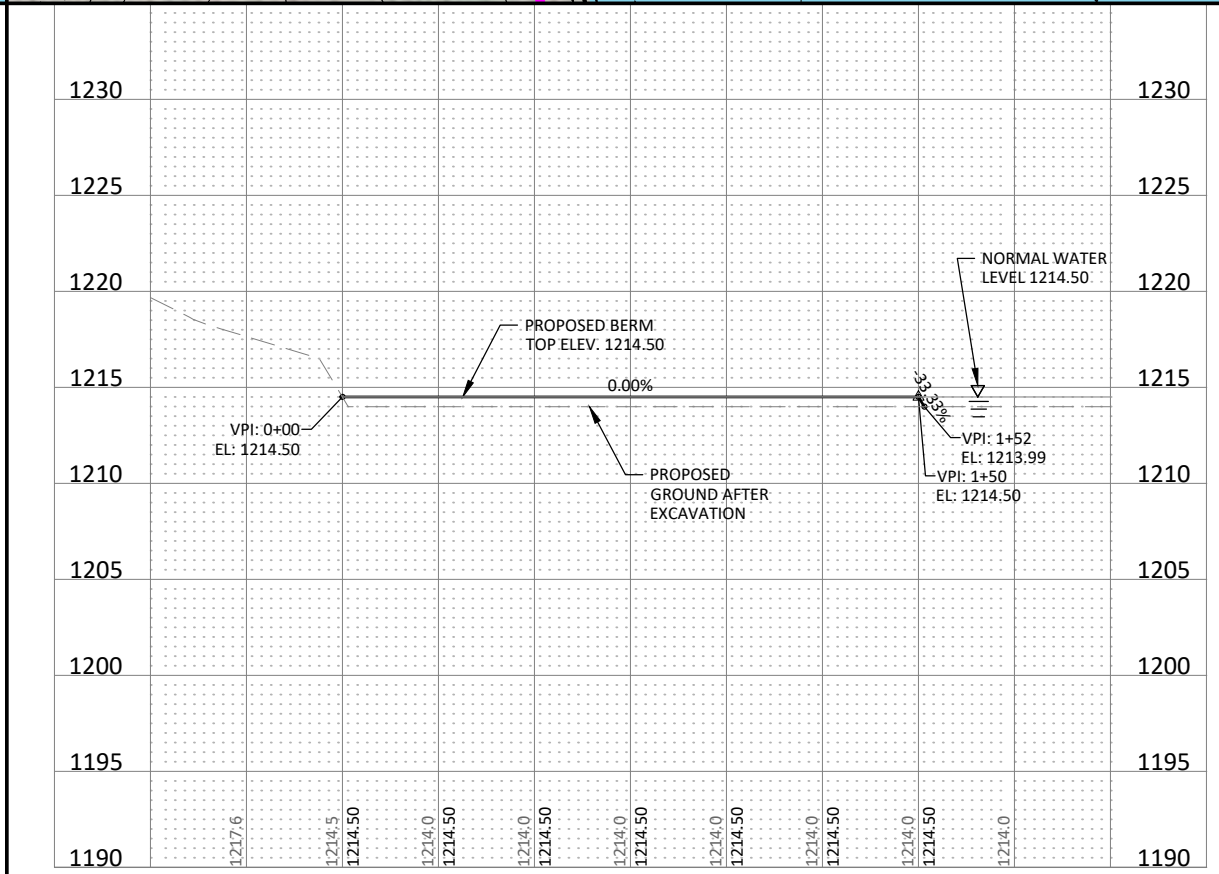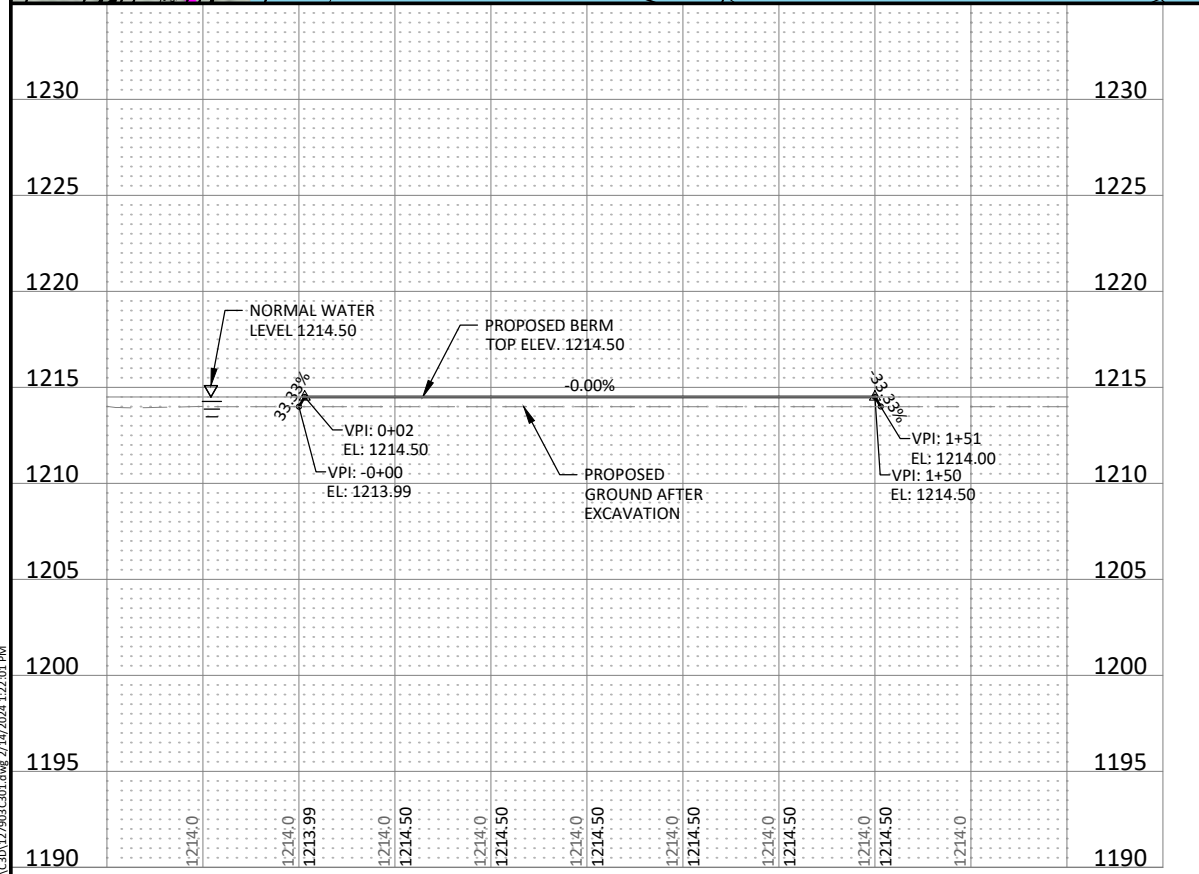

© Bolton & Menk, Inc. 2023. All Rights Reserved. IDALS(2023)1127933 CAD/CADD/127933/001.dwg 2/24/2024 1:22:01 PM






1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
PETERSBURG  
PLAN & PROFILE - DIVERSION BERMS

SHEET  
D.02

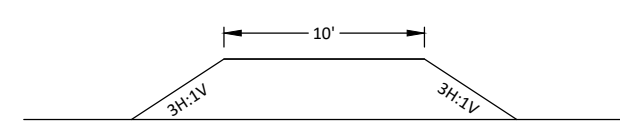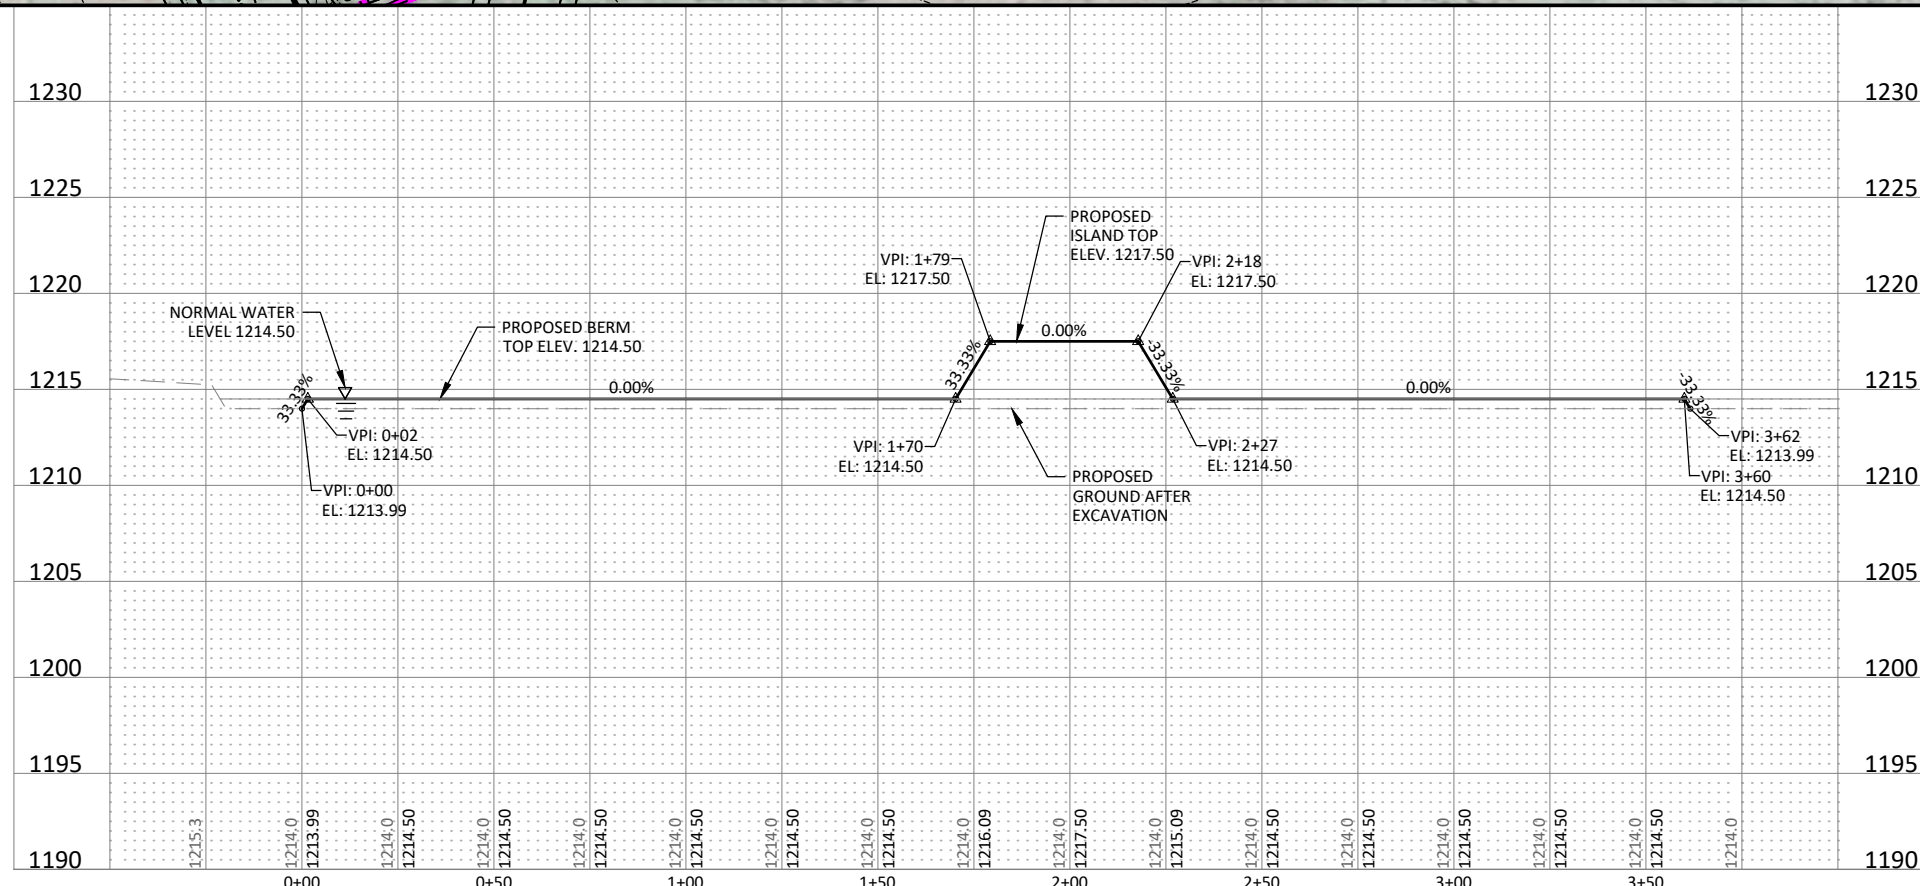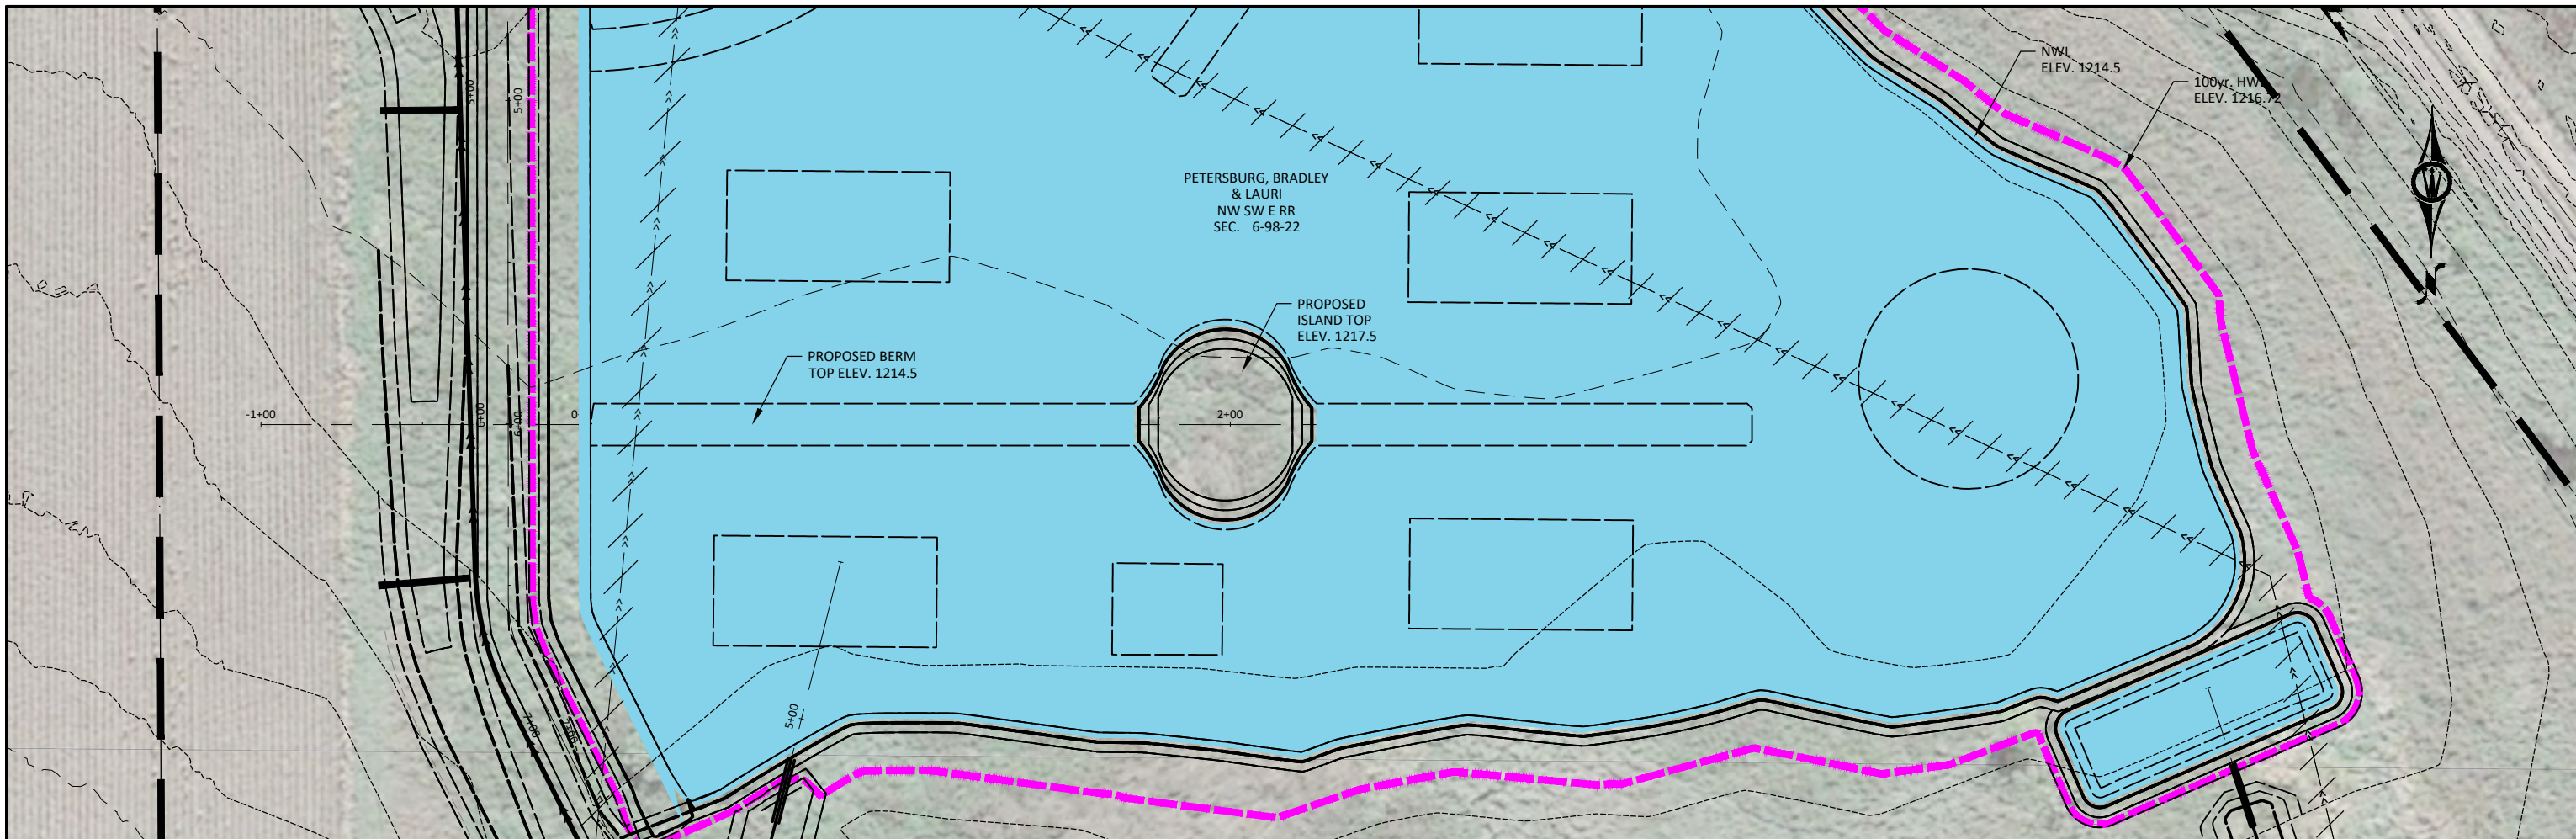

TYPICAL SECTION  
DIVERSION BERM  
NOT TO SCALE

© Bolton & Menk, Inc. 2023. All Rights Reserved. IDALS(2011)127303 CAD/CADD/127903/501.DWG 2/14/2024 1:22:06 PM



1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com




DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
PETERSBURG

PLAN & PROFILE - DIVERSION BERMS

SHEET

D.03

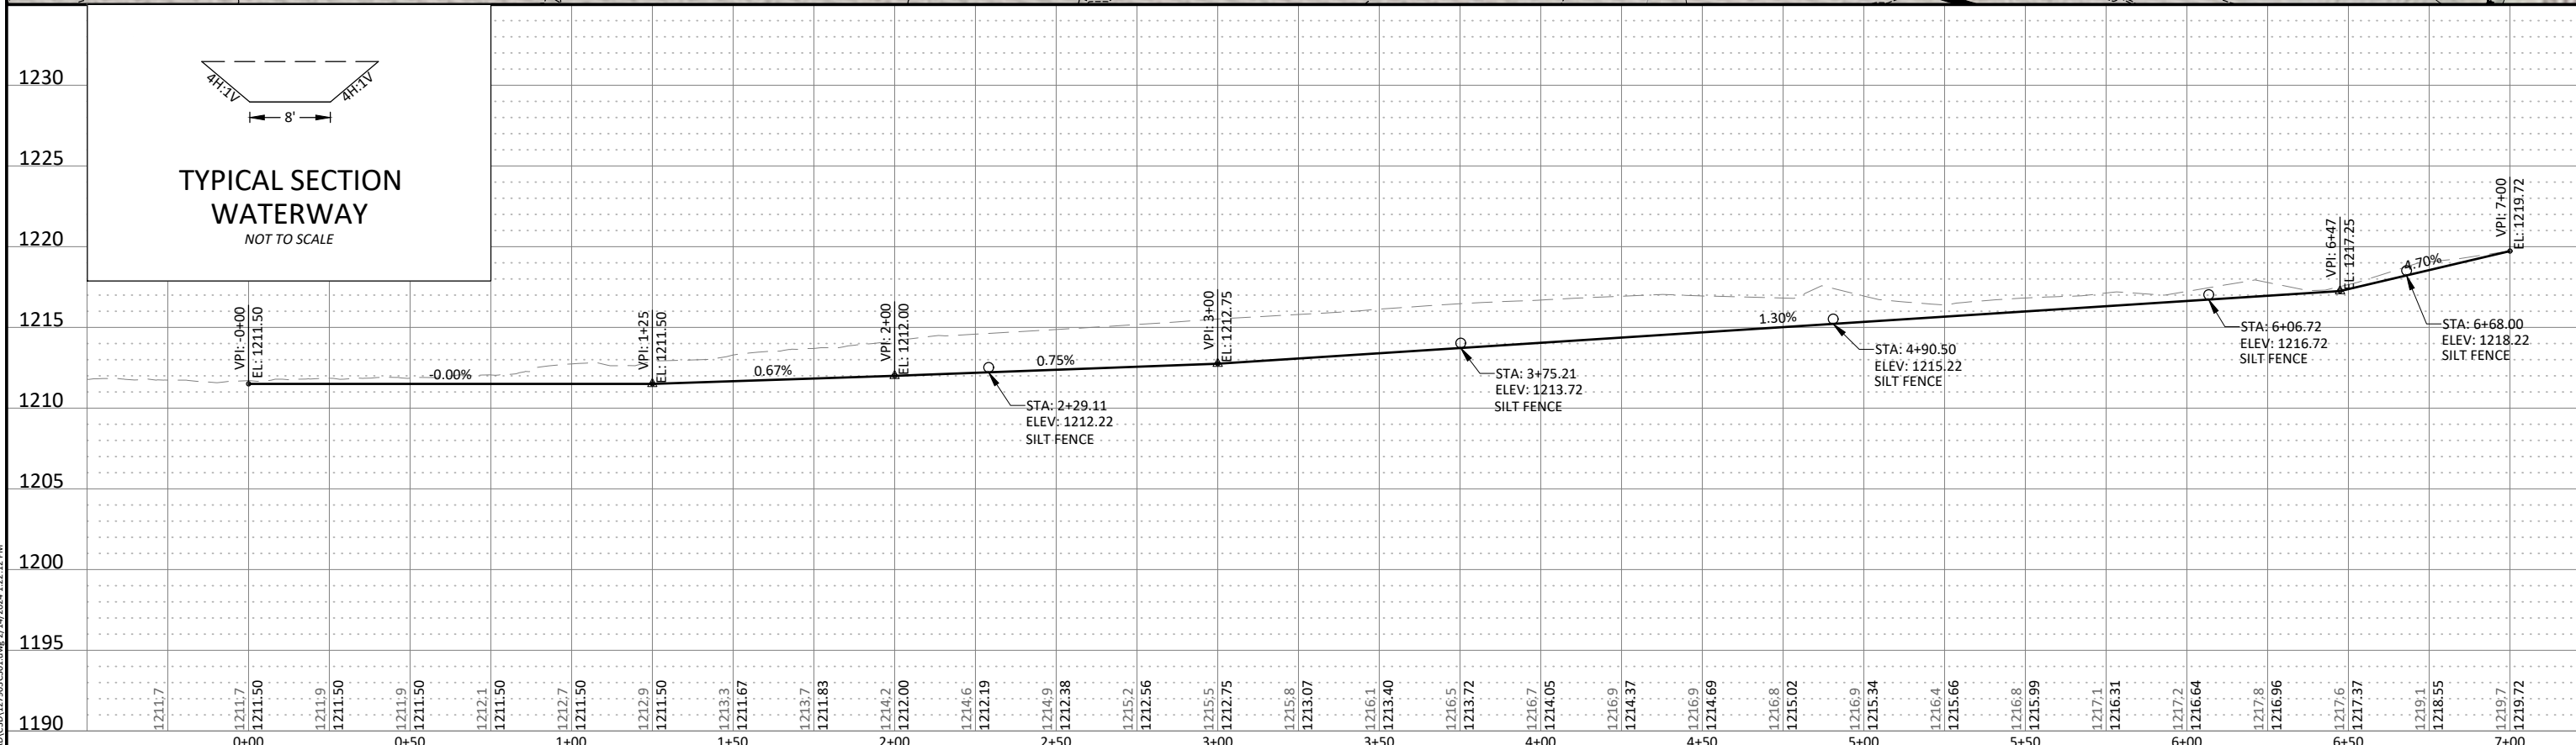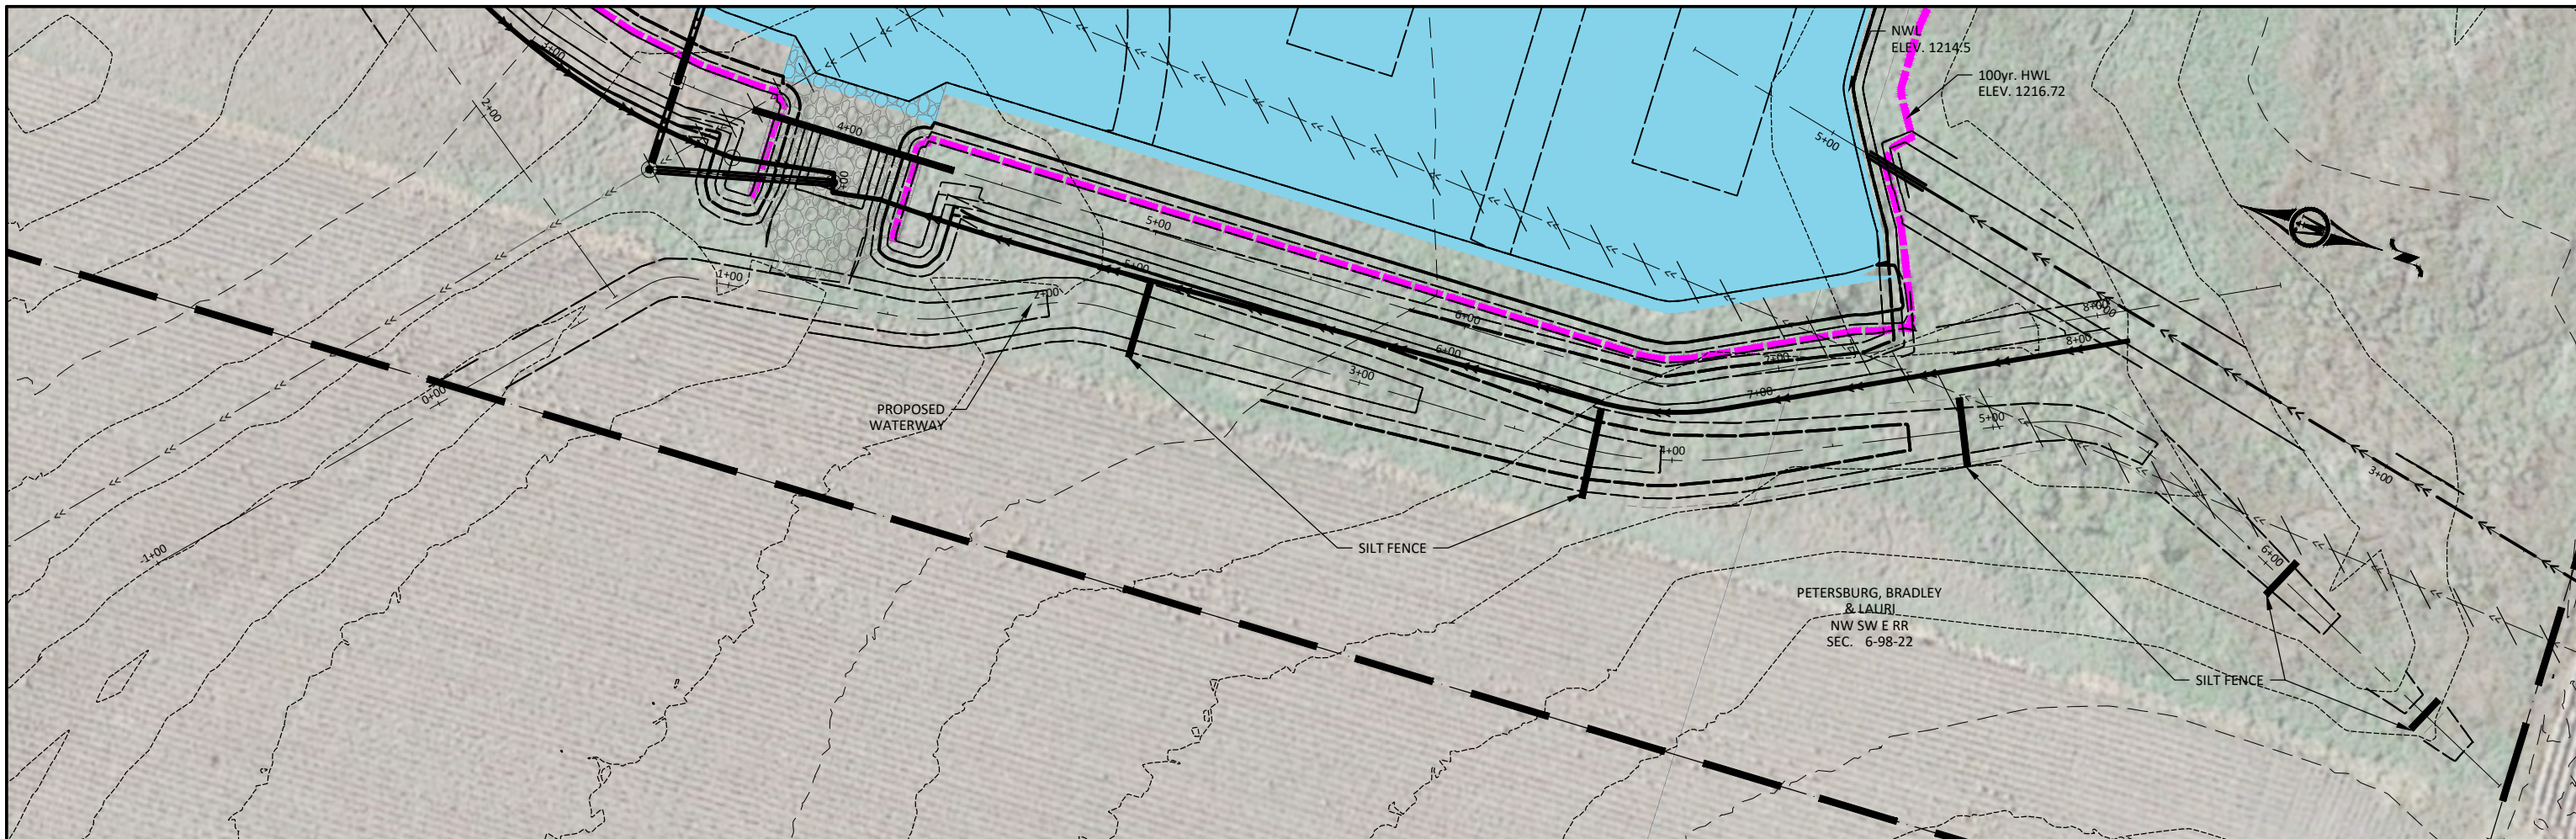





1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
PETERSBURG  
PLAN & PROFILE - WATERWAY

SHEET  
D.04

© Bolton & Menk, Inc. 2023. All Rights Reserved. IDALS(2023)127933 CAD/CADD/229803501.dwg 2/24/2024 1:22:12 PM

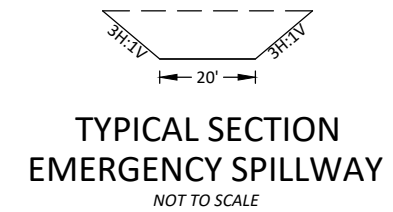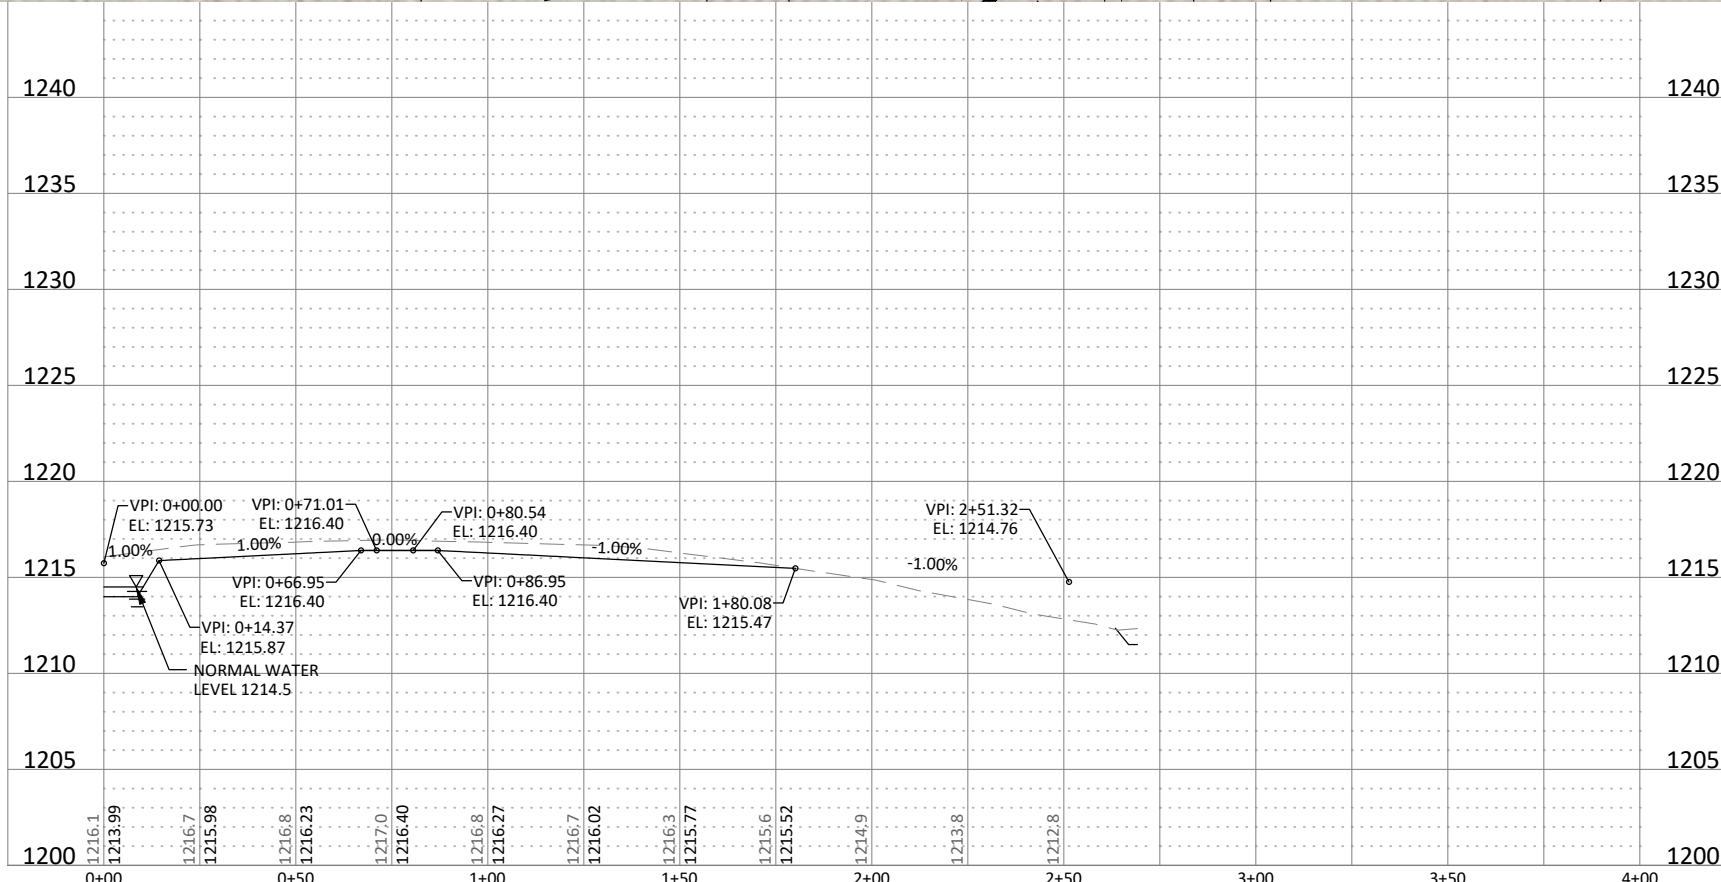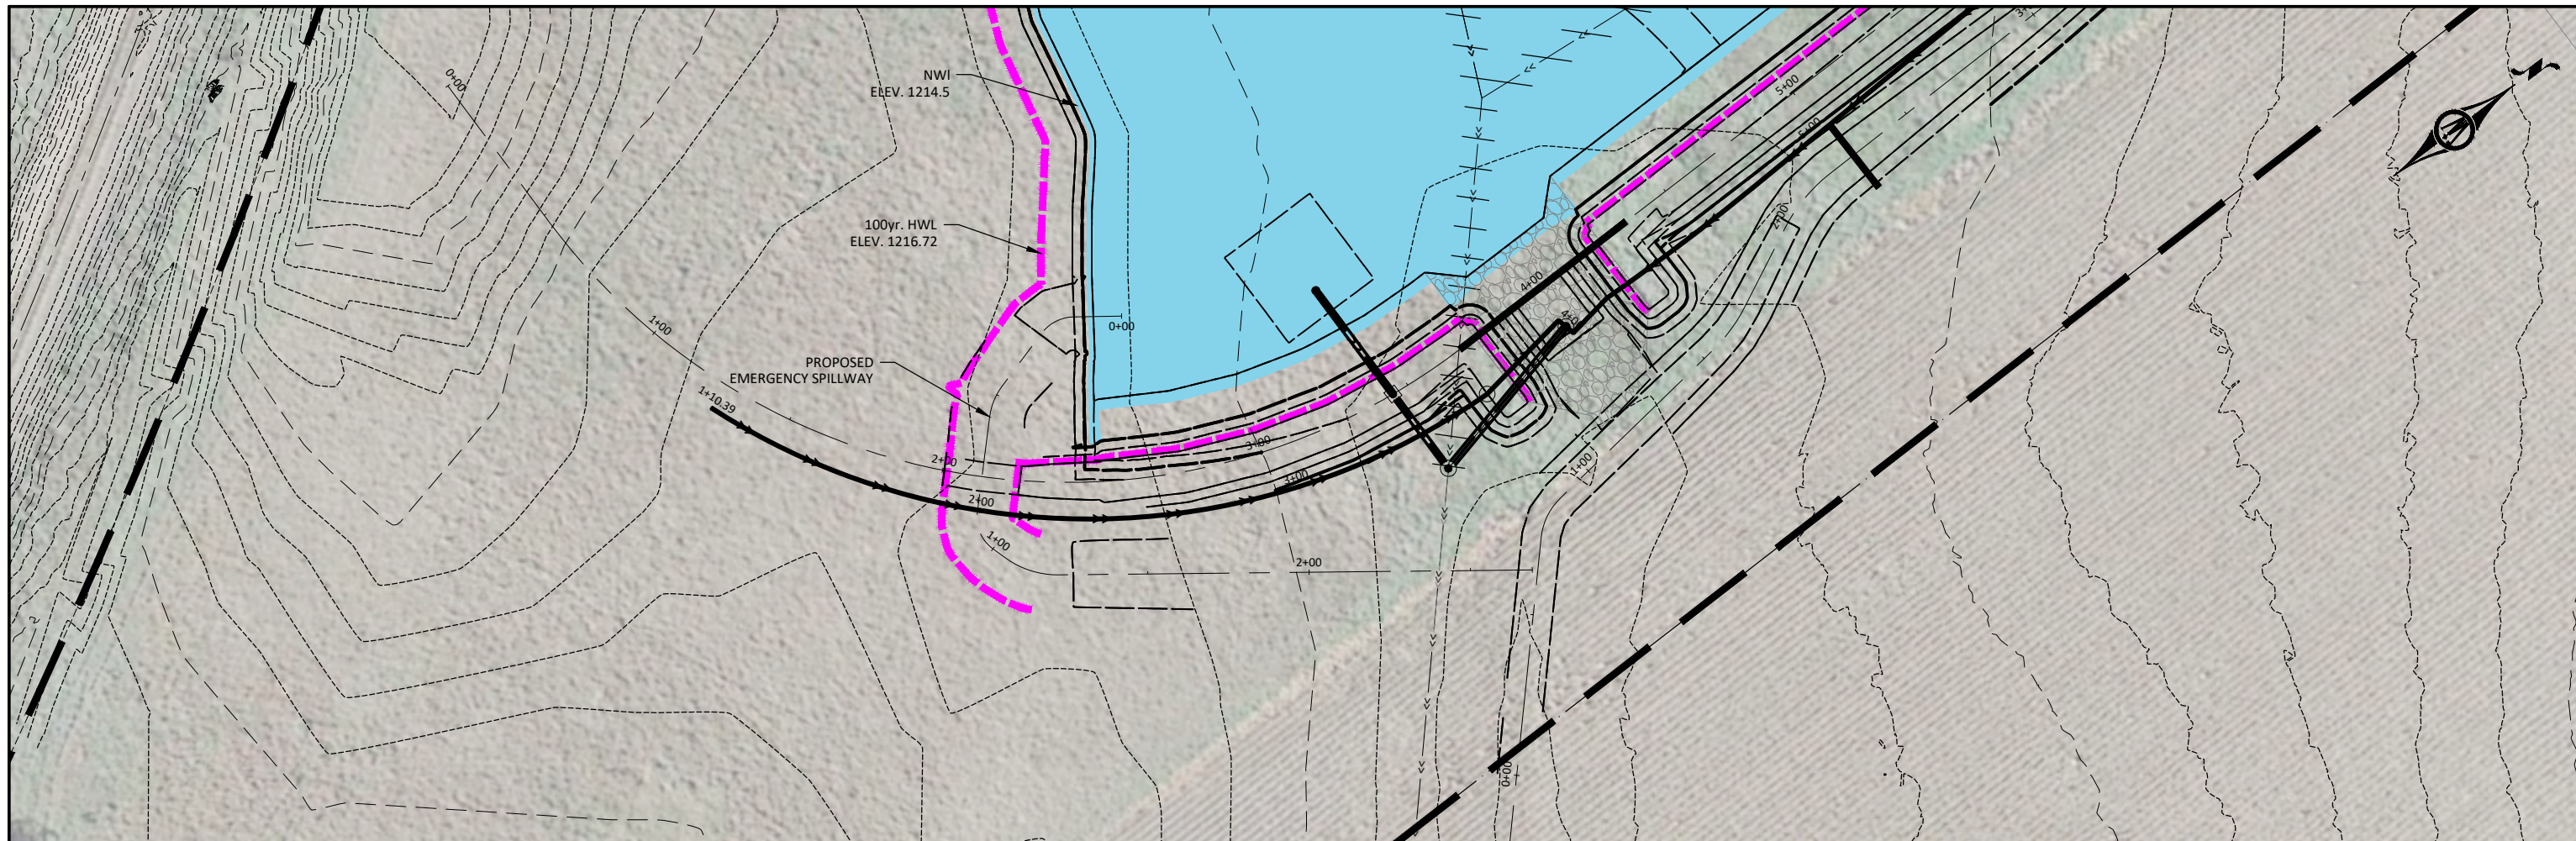




1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			


IDALS WATER RESOURCES BUREAU  
PETERSBURG  
PLAN & PROFILE - EMERGENCY SPILLWAY

SHEET  
D.05

© Bolton & Menk, Inc. 2023. All Rights Reserved. IDALS(2023)1127933 CAD/CADD/127903/501.DWG 2/14/2024 1:22:19 PM

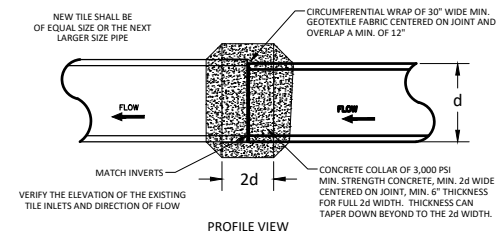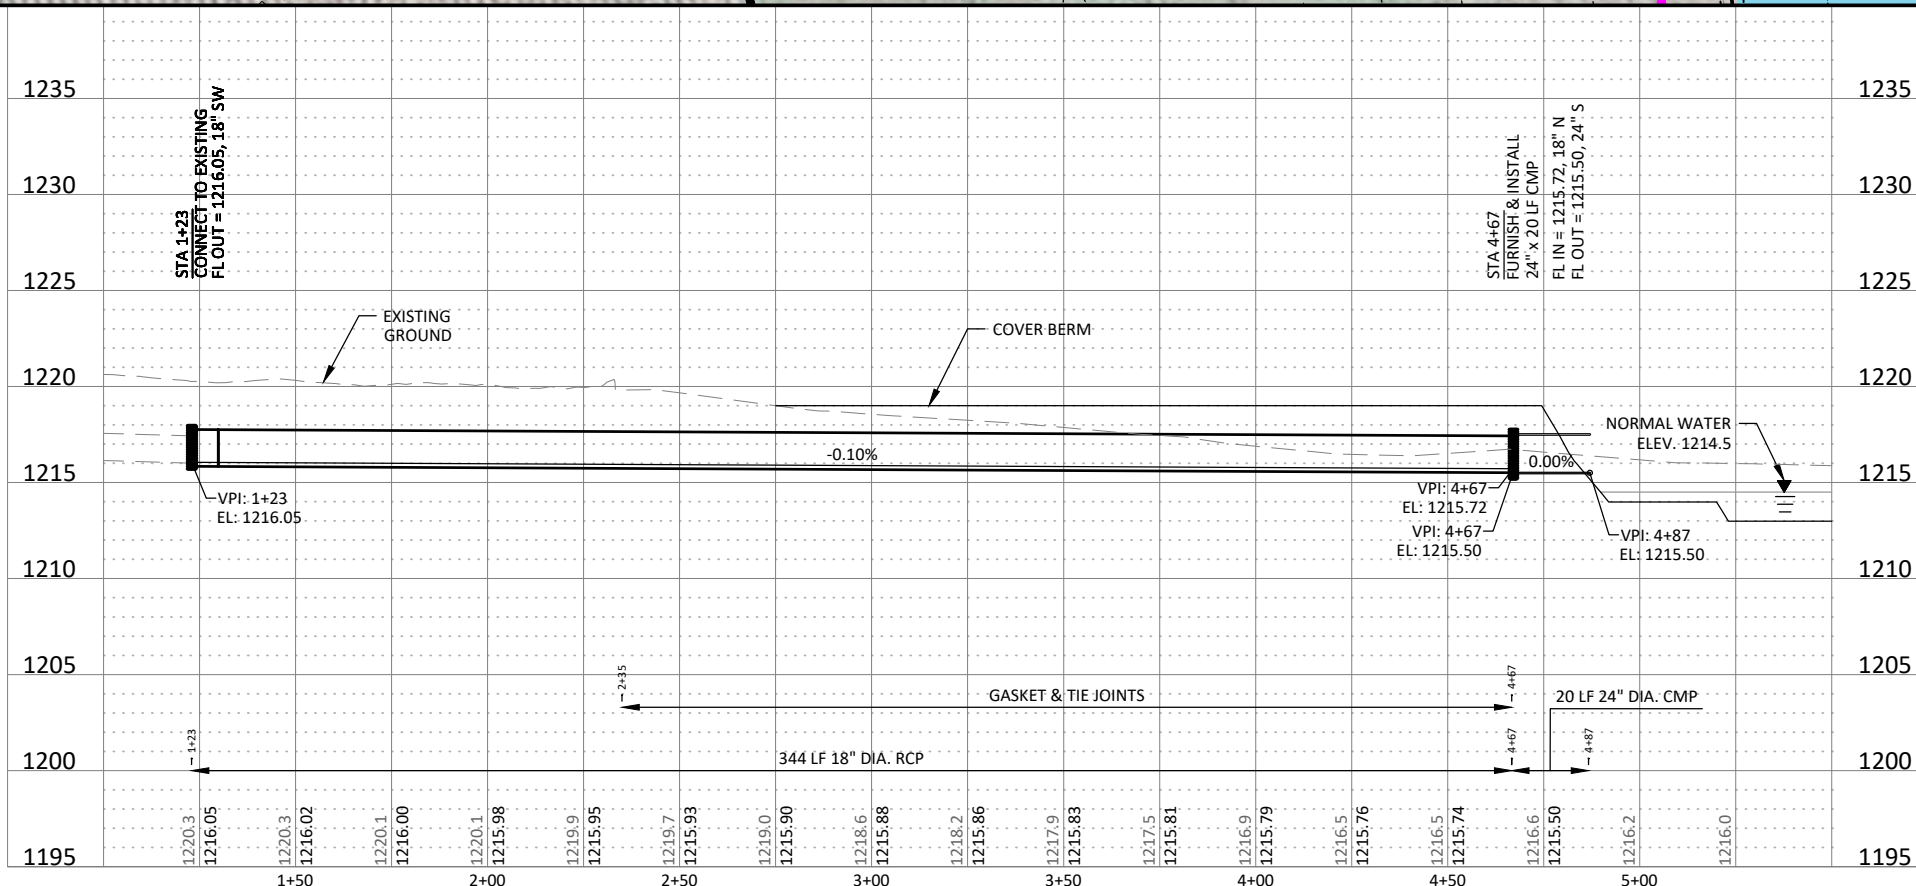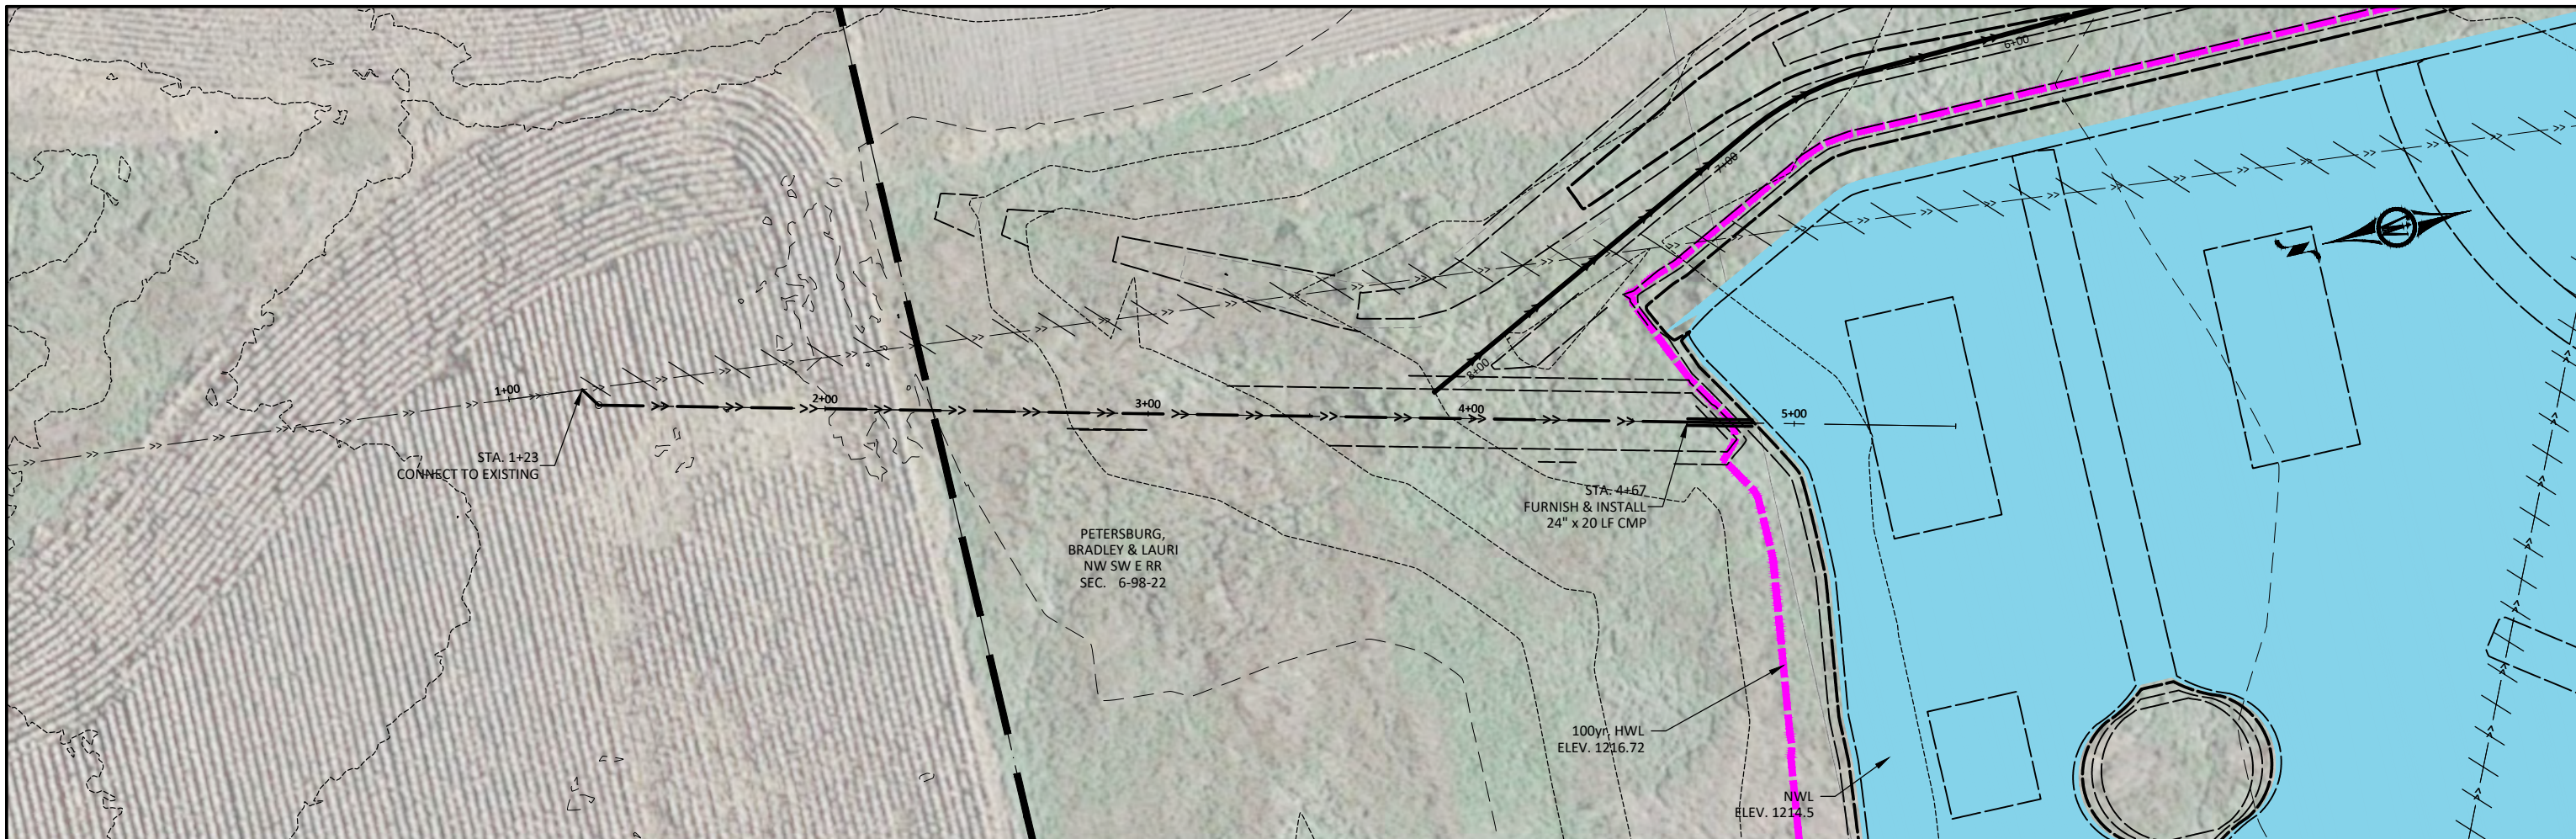

PROFILE VIEW  
FIELD TILE  
REPAIR CONNECTION  
NOT TO SCALE



TYPICAL SECTION  
COVER BERM  
NOT TO SCALE






**BOLTON & MENK**  
1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			


IDALS WATER RESOURCES BUREAU  
PETERSBURG  
PLAN & PROFILE - MAIN OUTLET PIPE

SHEET  
M.01


© Bolton & Menk, Inc. 2023. All Rights Reserved. 11/16/2024 12:24:05 PM

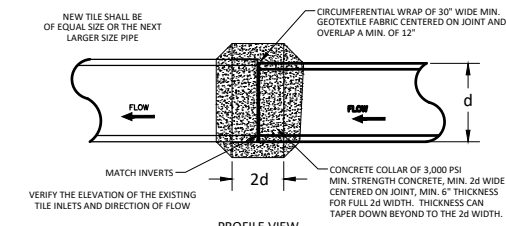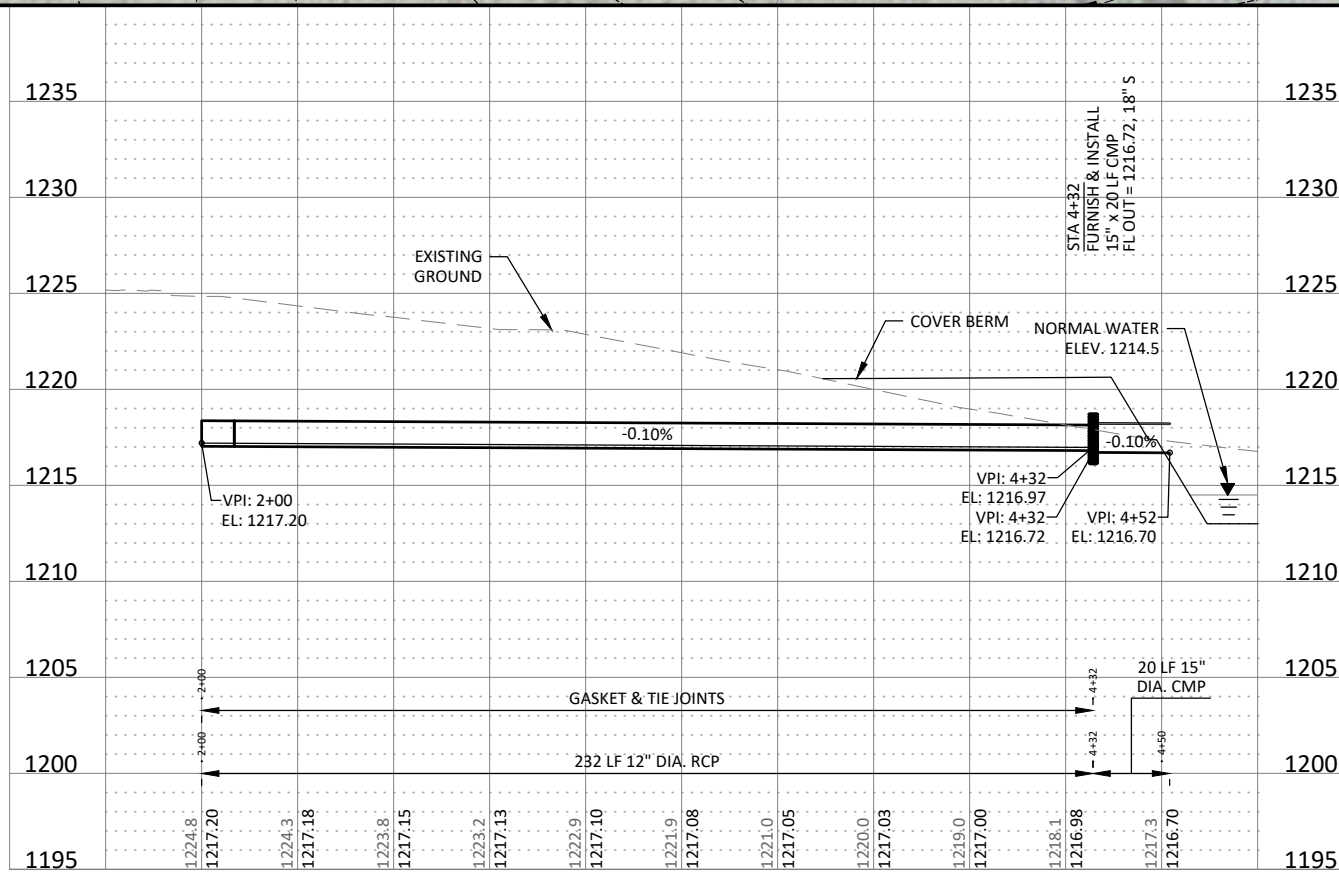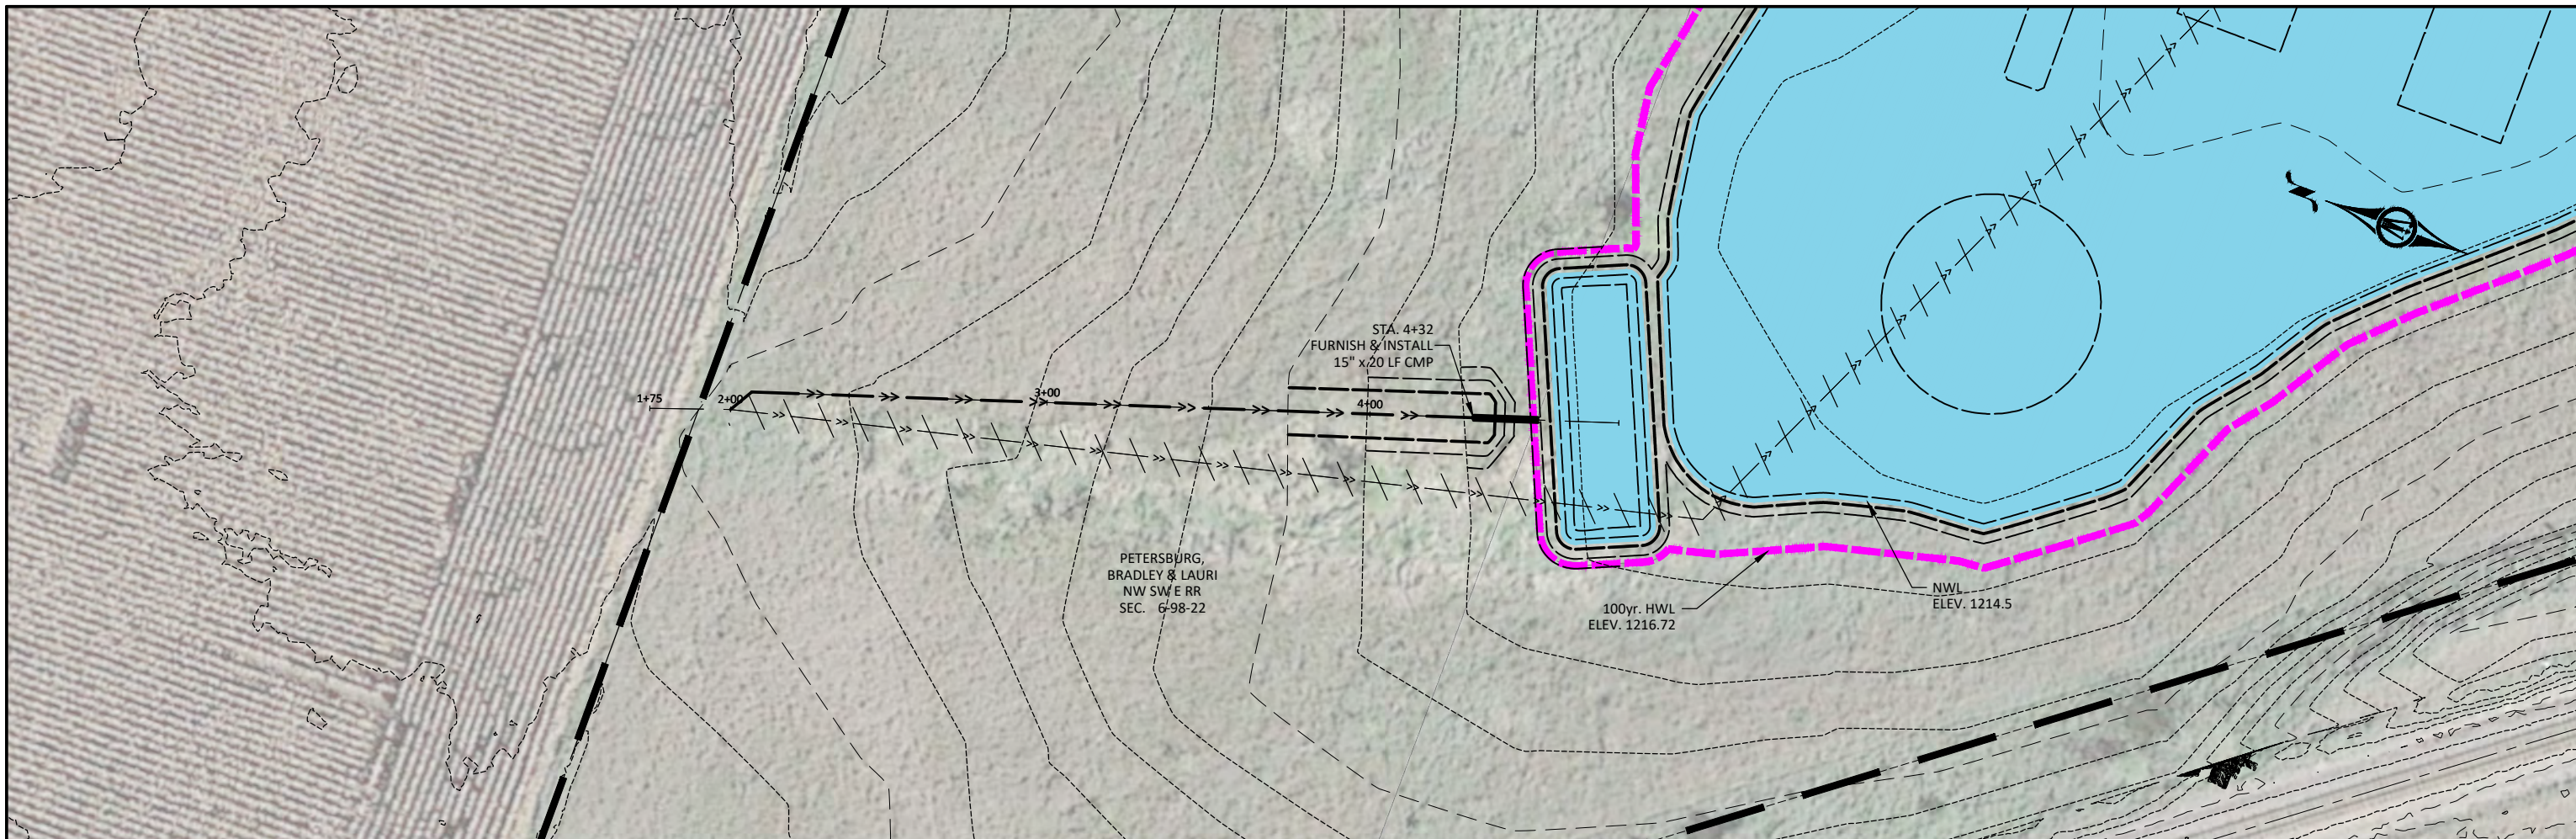

PROFILE VIEW  
FIELD TILE  
REPAIR CONNECTION  
NOT TO SCALE



TYPICAL SECTION  
COVER BERM  
NOT TO SCALE





1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			


IDALS WATER RESOURCES BUREAU  
PETERSBURG  
PLAN & PROFILE - LATERAL OUTLET PIPE

SHEET  
M.02

© Bolton & Menk, Inc. 2023. All Rights Reserved. 11/14/2024 12:24:11 PM

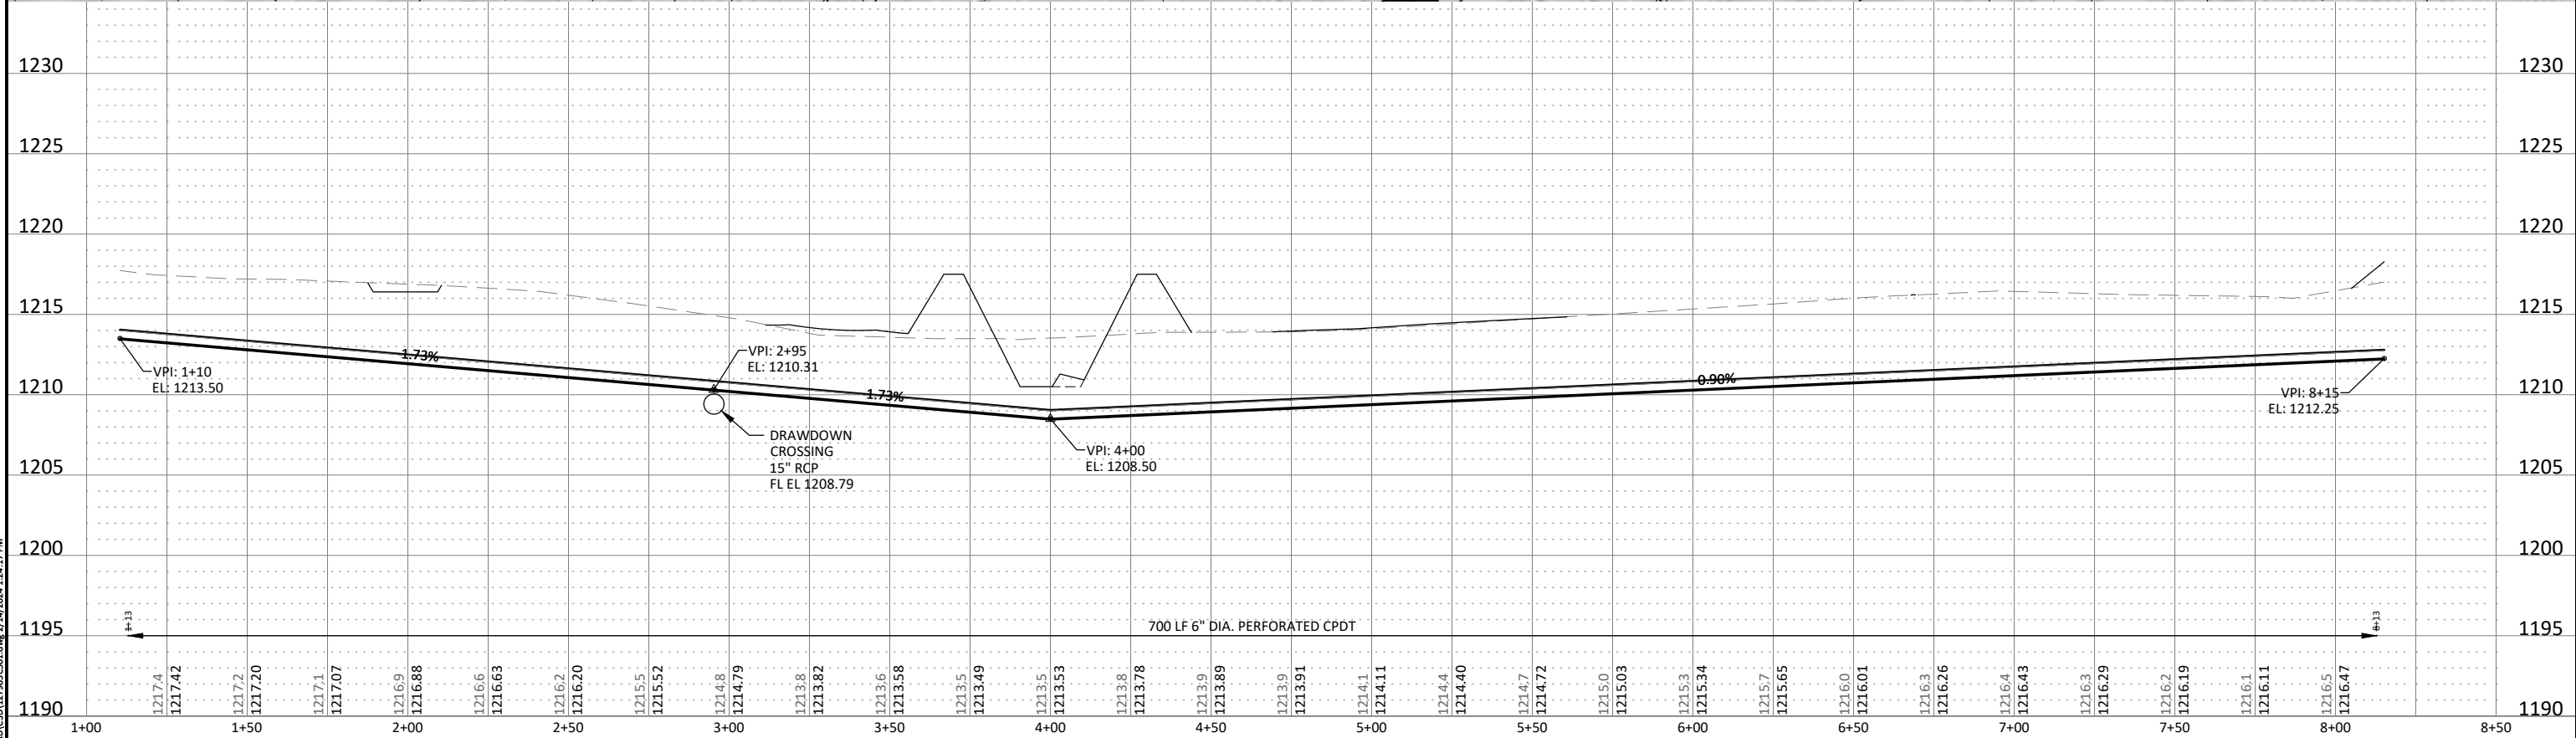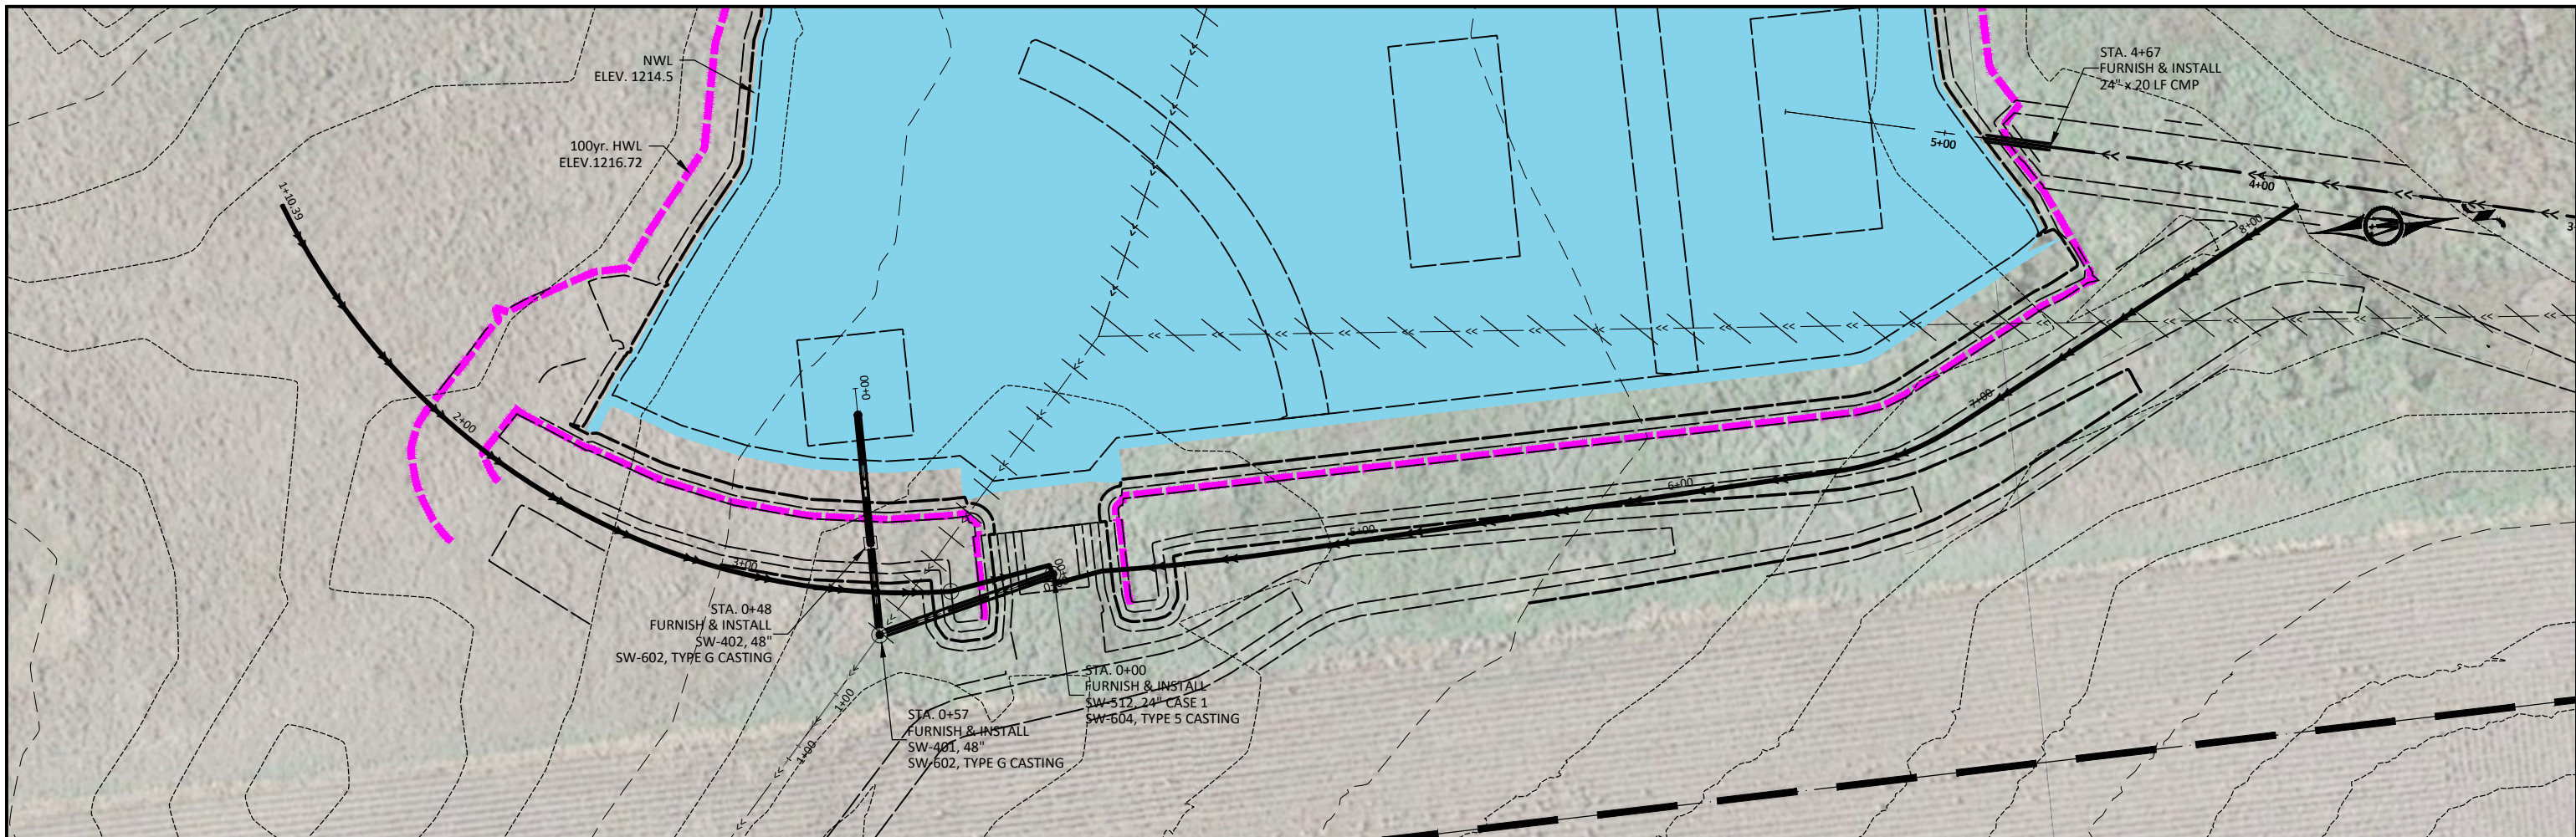

© Bolton & Menk, Inc. 2023. All Rights Reserved. PL1001501127903 CAD/CADD/127903/2/24/2024 12:41:17 PM

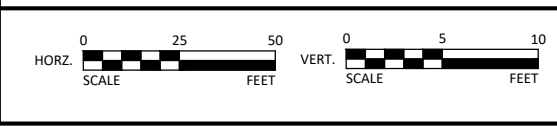





**BOLTON & MENK**  
 1519 BALTIMORE DRIVE  
 AMES, IOWA 50010  
 Phone: (515) 233-6100  
 Email: Ames@bolton-menk.com  
 www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			


**IDALS WATER RESOURCES BUREAU**  
 PETERSBURG  
 PLAN & PROFILE - TOE DRAIN

SHEET  
**M.03**



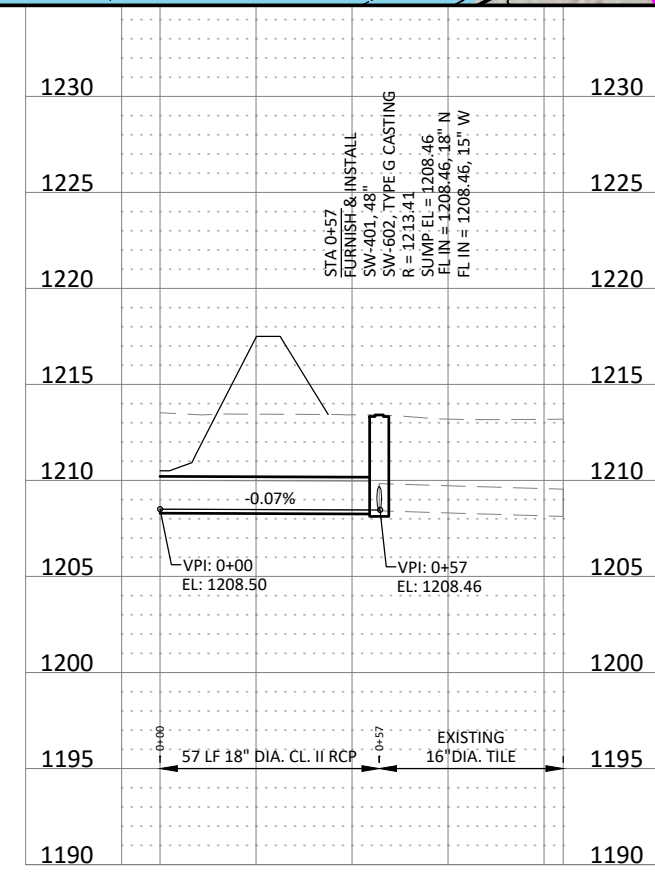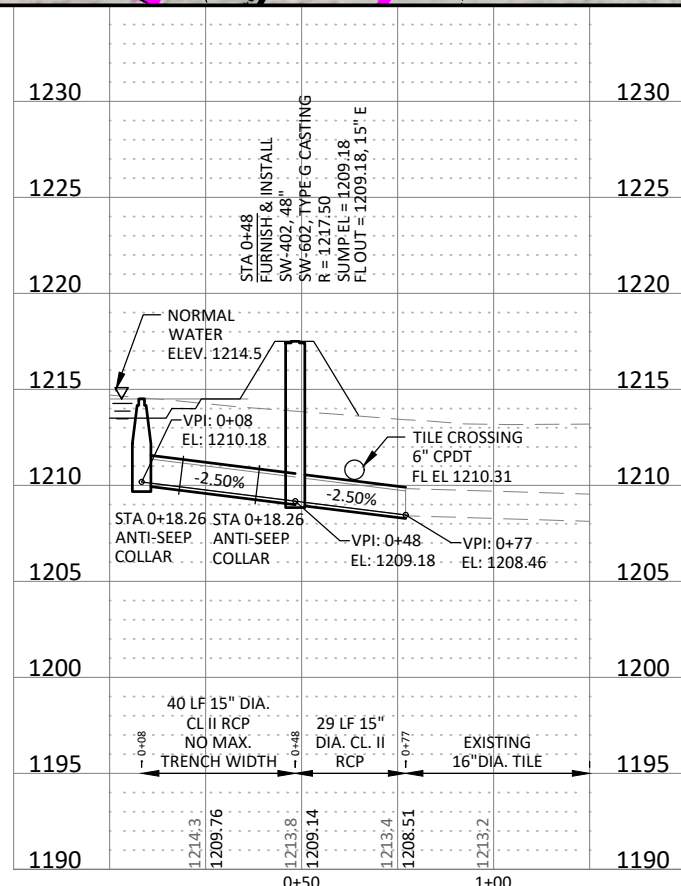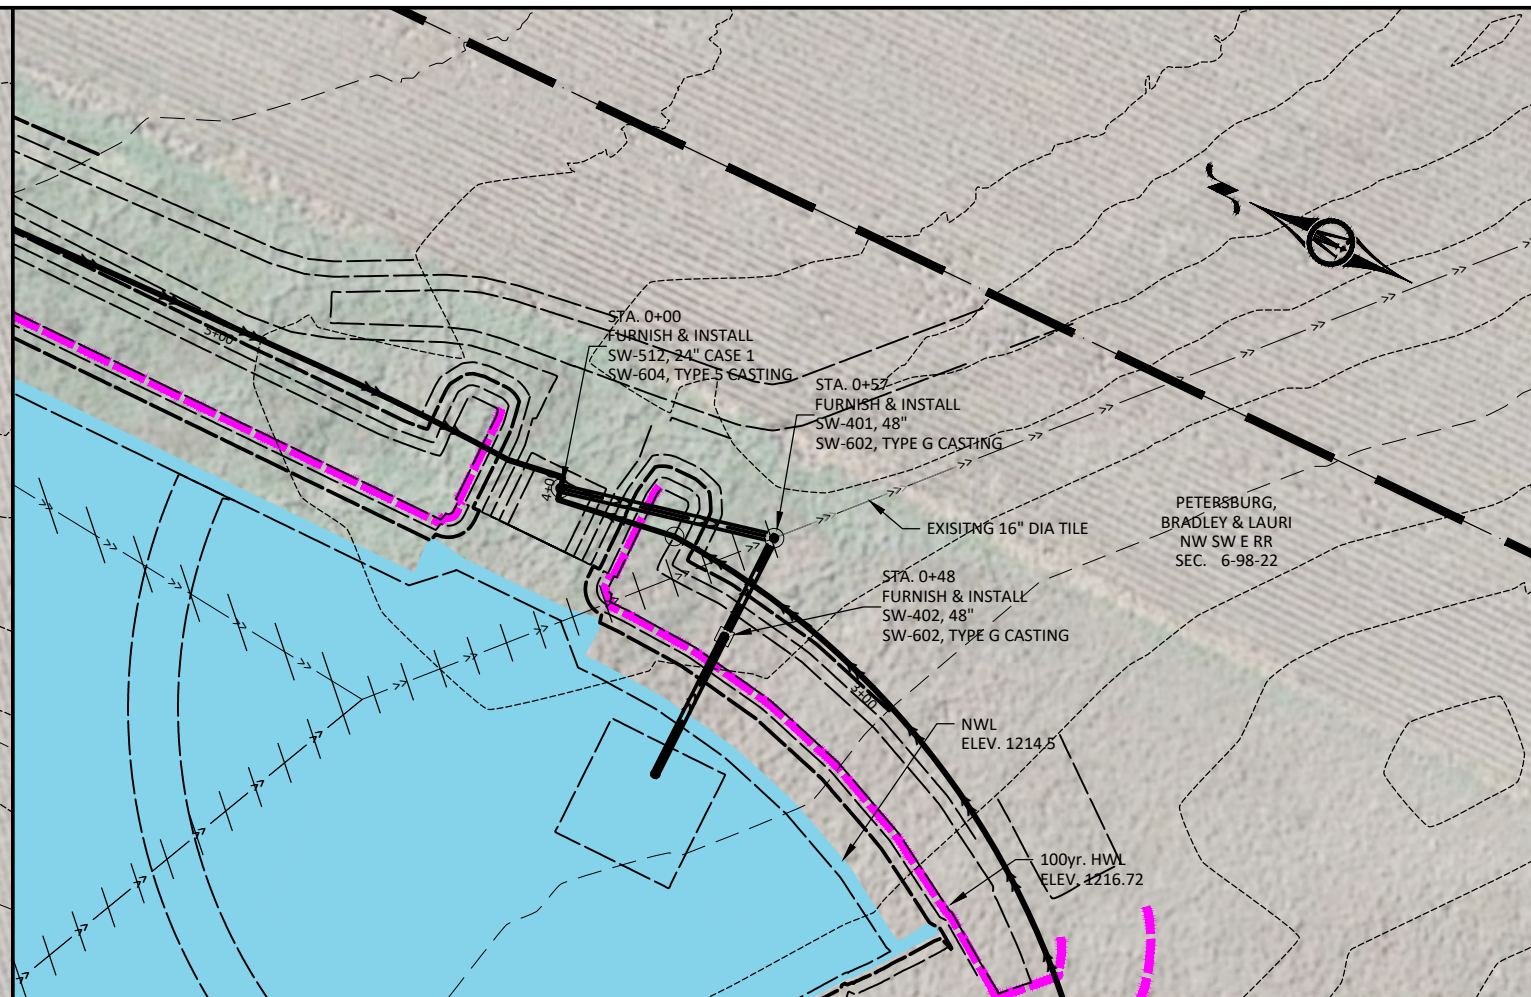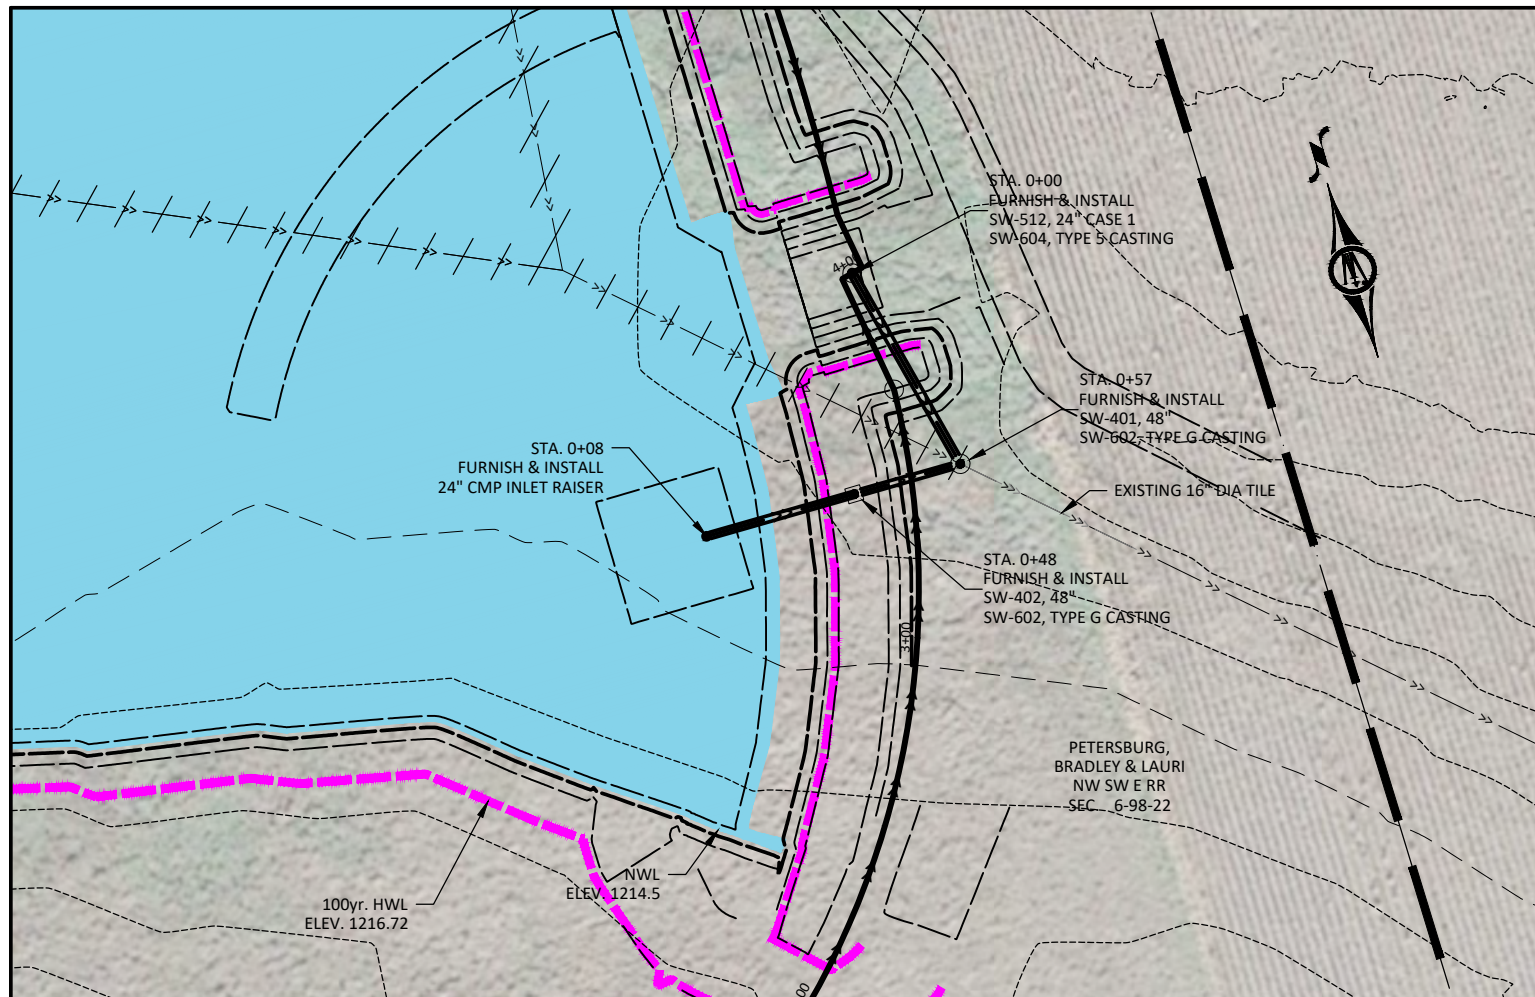

© Bolton & Menk, Inc. 2023. All Rights Reserved. PLANS: 11/27/2024 12:26 PM



1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN		SPM/JKF	
CHECKED		JPR	
CLIENT PROJ. NO.			



IDALS WATER RESOURCES BUREAU

PETERSBURG

PLAN & PROFILE - DRAW DOWN PIPES

SHEET

M.04

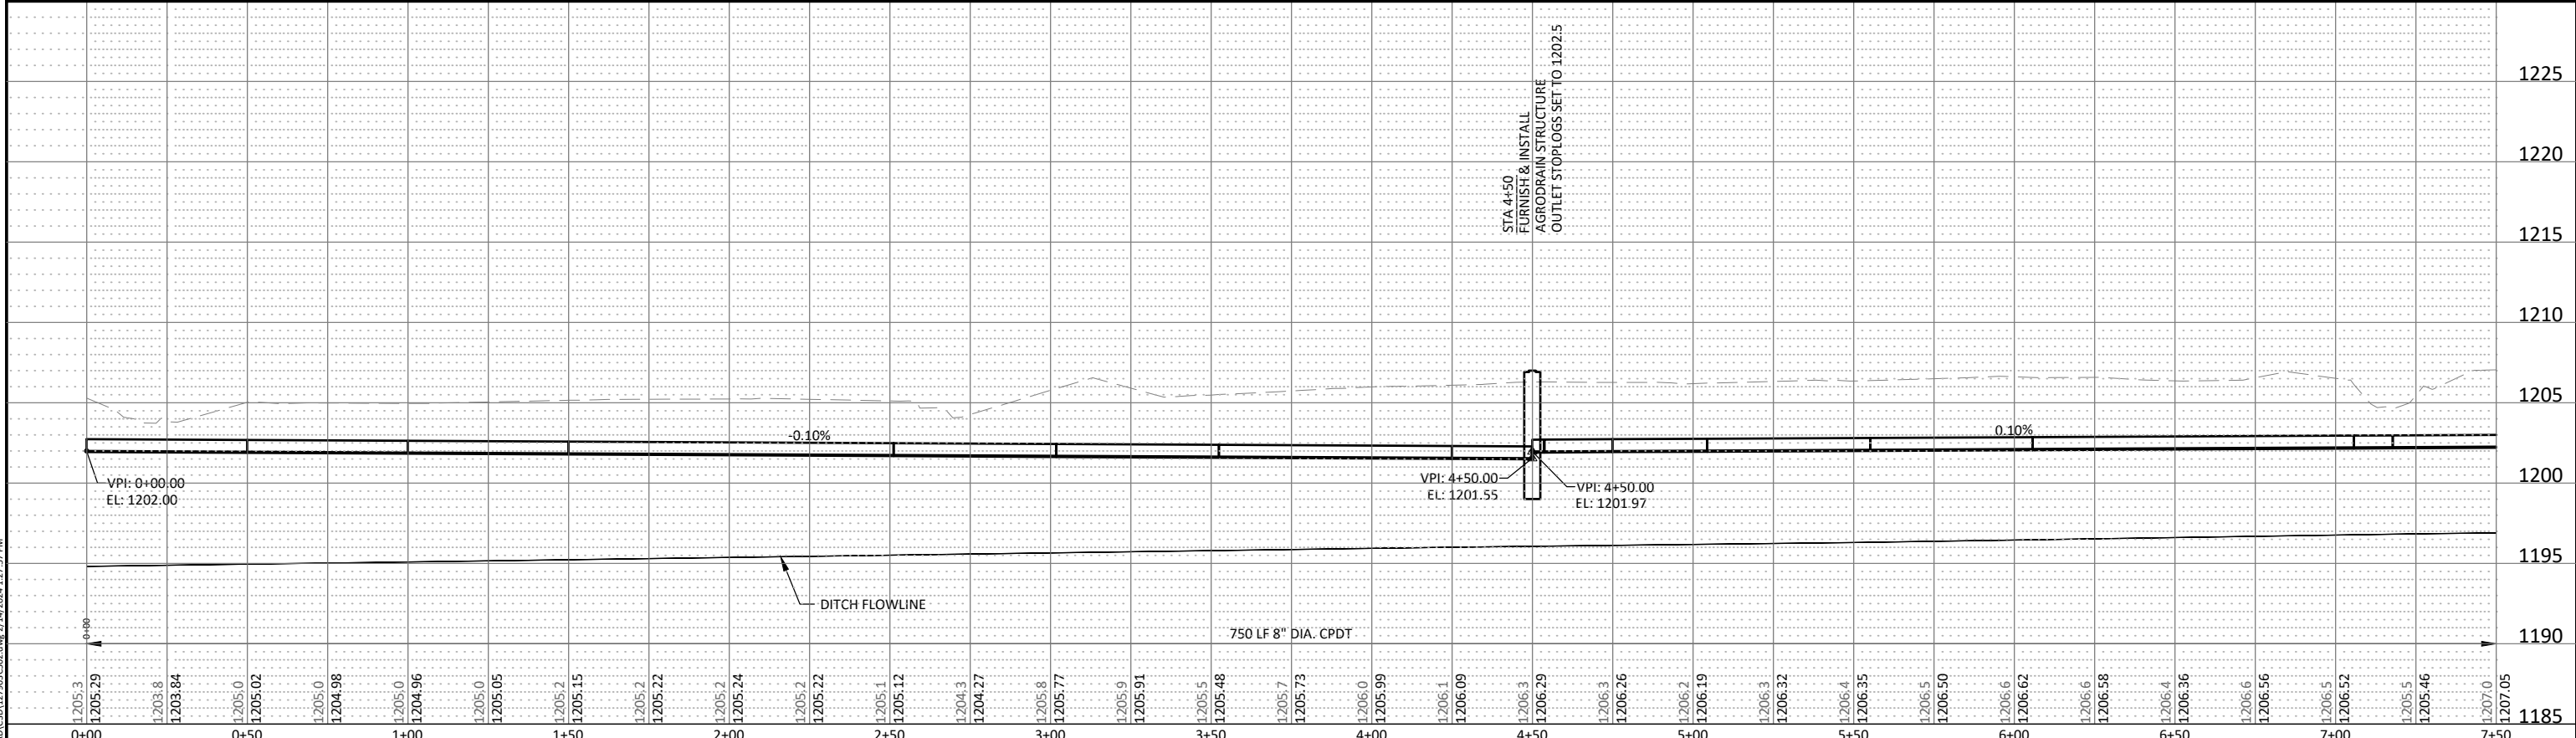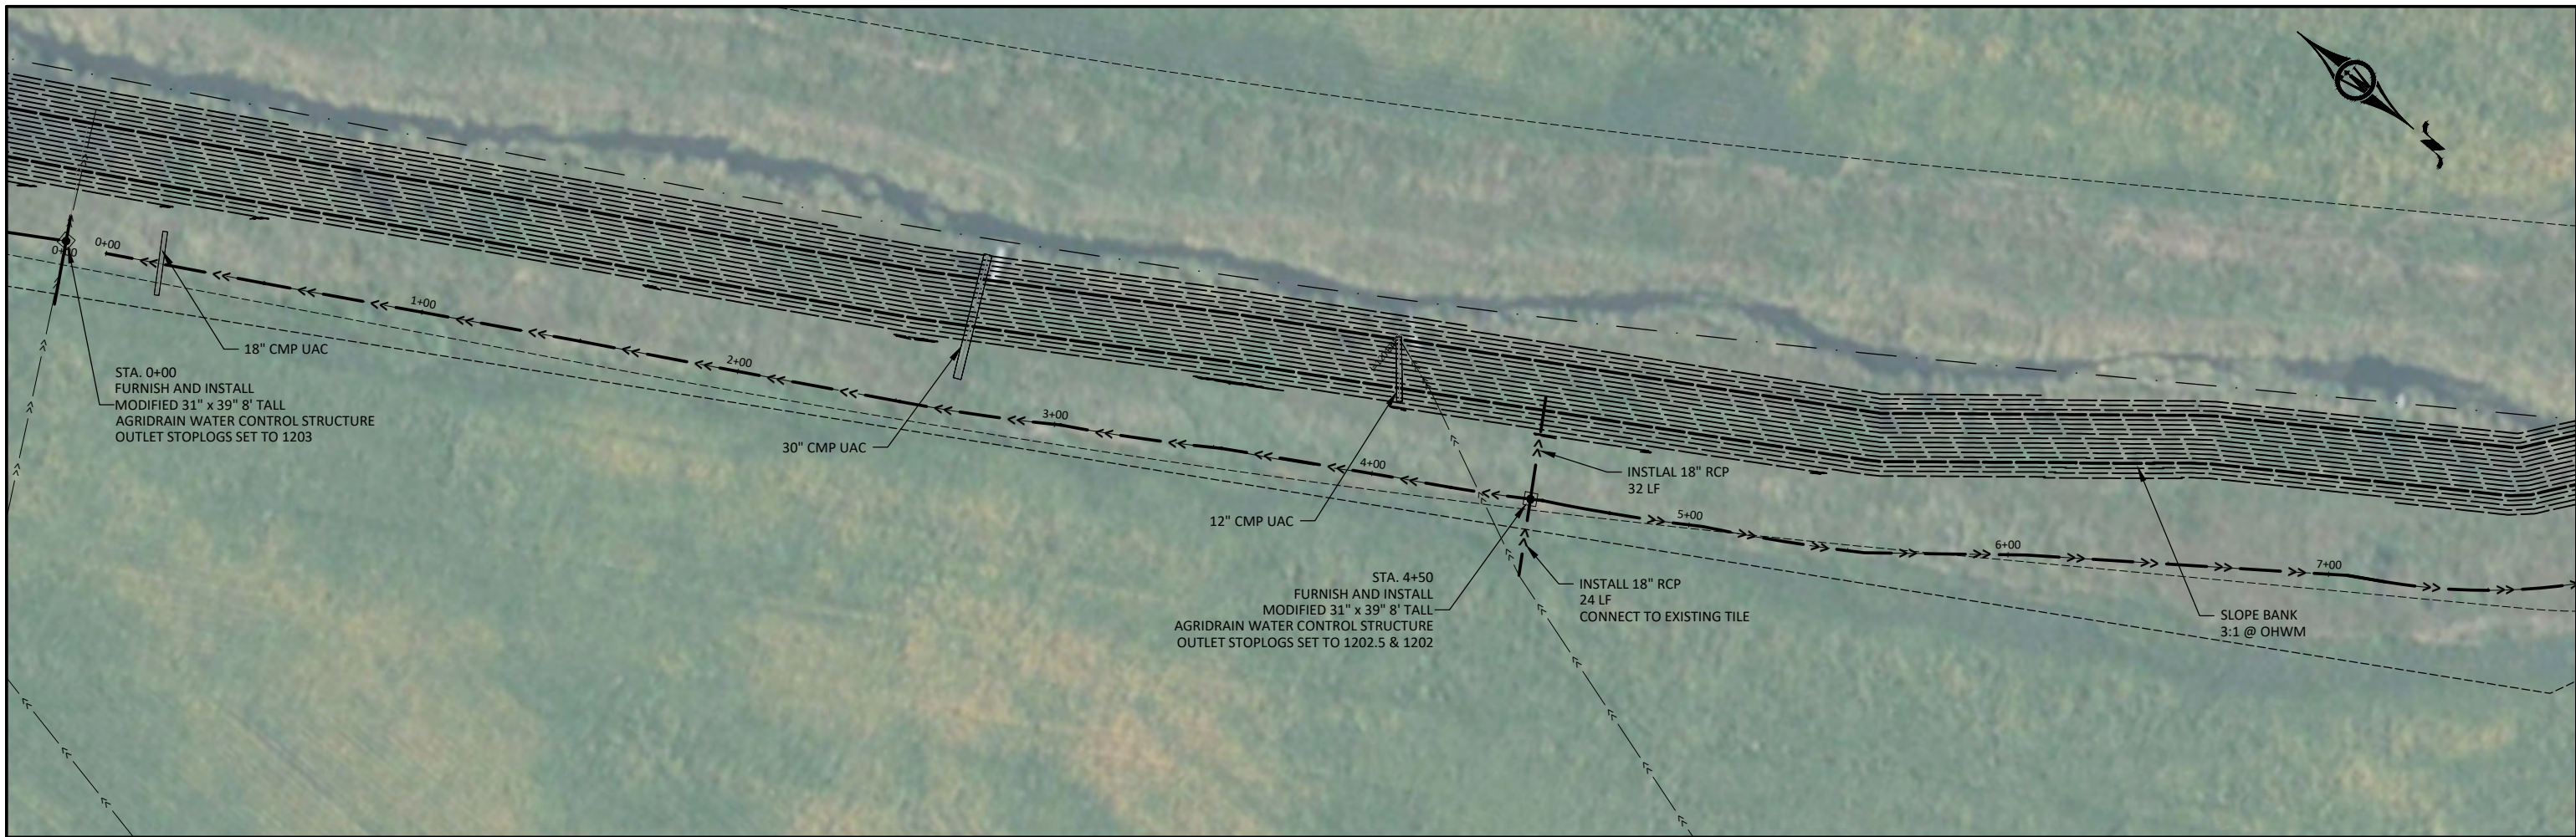

© Bolton & Menk, Inc. 2023. All Rights Reserved.  
 A:\IDALS\11172933\IDALS\11172933\DWG\122902.dwg 2/14/2024 1:27:57 PM



1519 BALTIMORE DRIVE  
 AMES, IOWA 50010  
 Phone: (515) 233-6100  
 Email: Ames@bolton-menk.com  
 www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
SPM/JKF			
JPR			
CLIENT PROJ. NO.			

**IDALS WATER RESOURCES BUREAU**  
 PETERSBURG  
**PLAN & PROFILE - NORTH SATURATED BUFFER**

SHEET  
**M.05**



© Bolton & Menk, Inc. 2023. All Rights Reserved.  
 A:\IDALS\1127203\1127203.dwg 2/14/2024 1:28:00 PM





1519 BALTIMORE DRIVE  
 AMES, IOWA 50010  
 Phone: (515) 233-6100  
 Email: Ames@bolton-menk.com  
 www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

**IDALS WATER RESOURCES BUREAU**  
 PETERSBURG

**PLAN & PROFILE - NORTH SATURATED BUFFER**

SHEET  
**M.06**

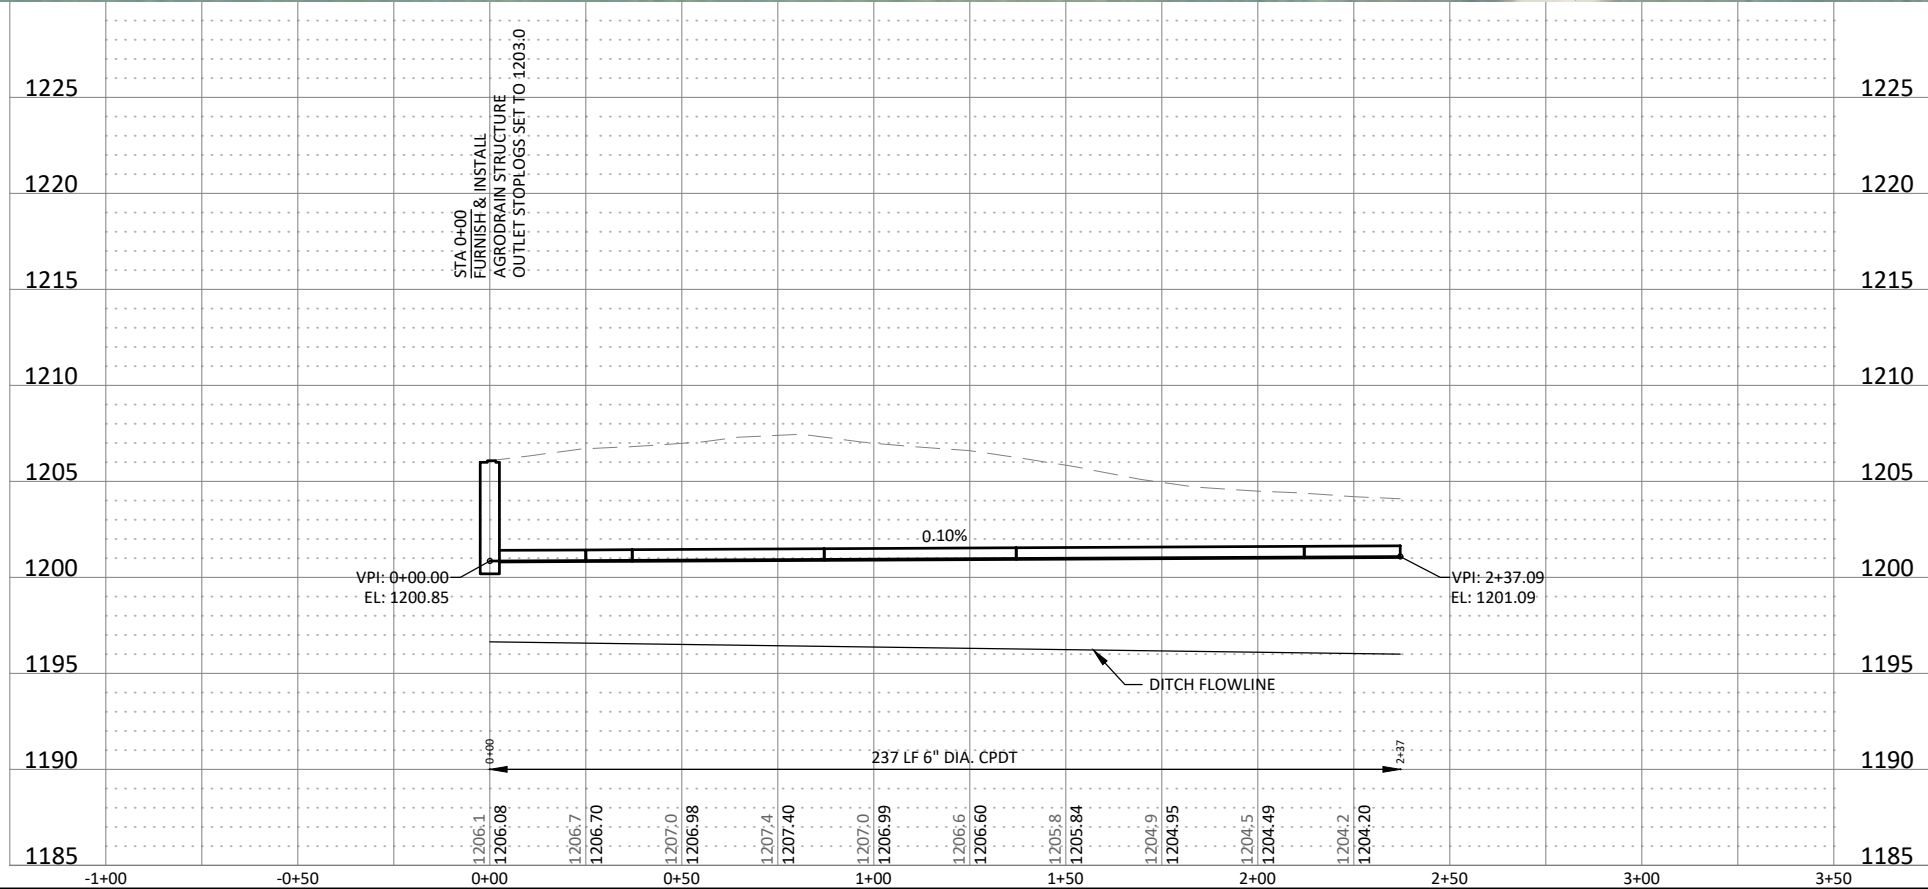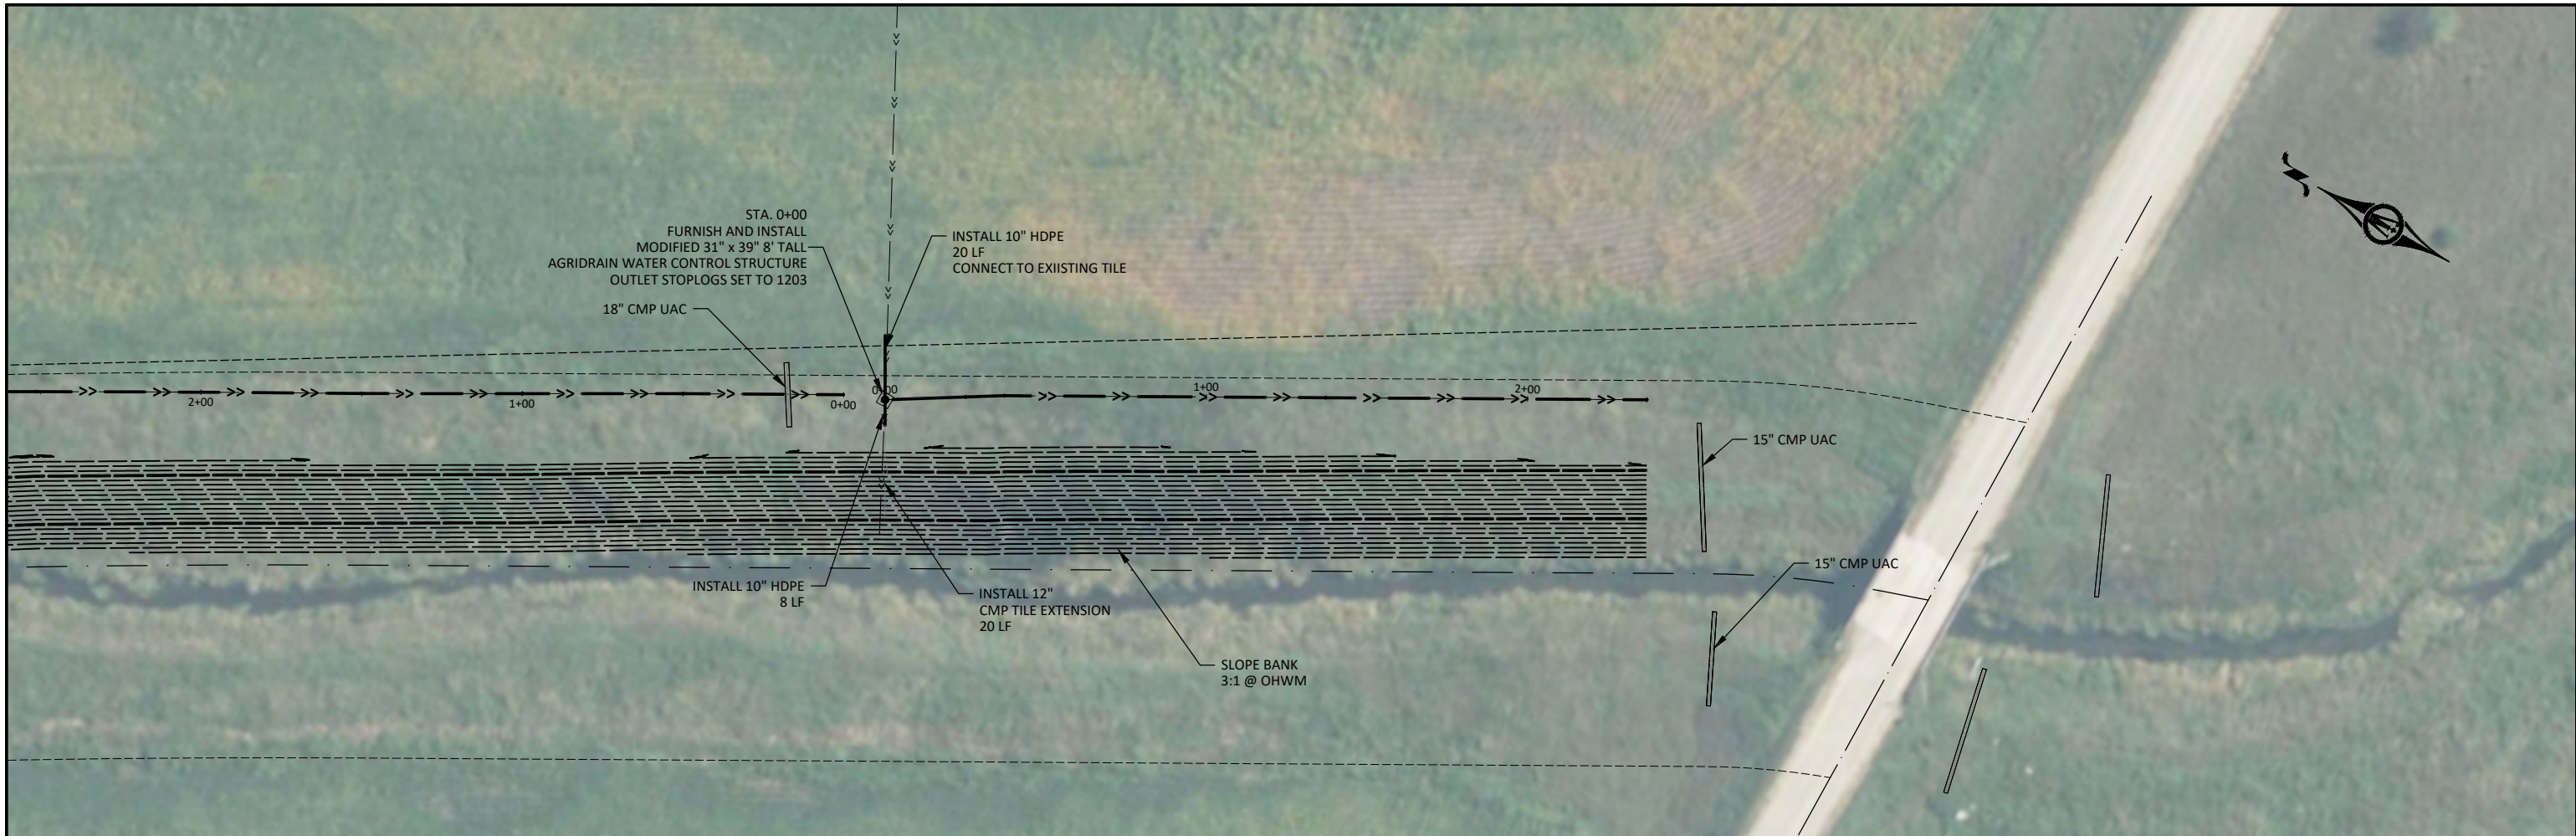

© Bolton & Menk, Inc. 2023. All Rights Reserved. A:\IDALS\1117293\1117293.dwg 2/14/2024 1:28:03 PM




1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			


IDALS WATER RESOURCES BUREAU  
PETERSBURG  
PLAN & PROFILE - SOUTH SATURATED BUFFER

SHEET  
M.07


CROSS-SECTION:  
SOUTH SATURATED BUFFER  
STA. 1+18

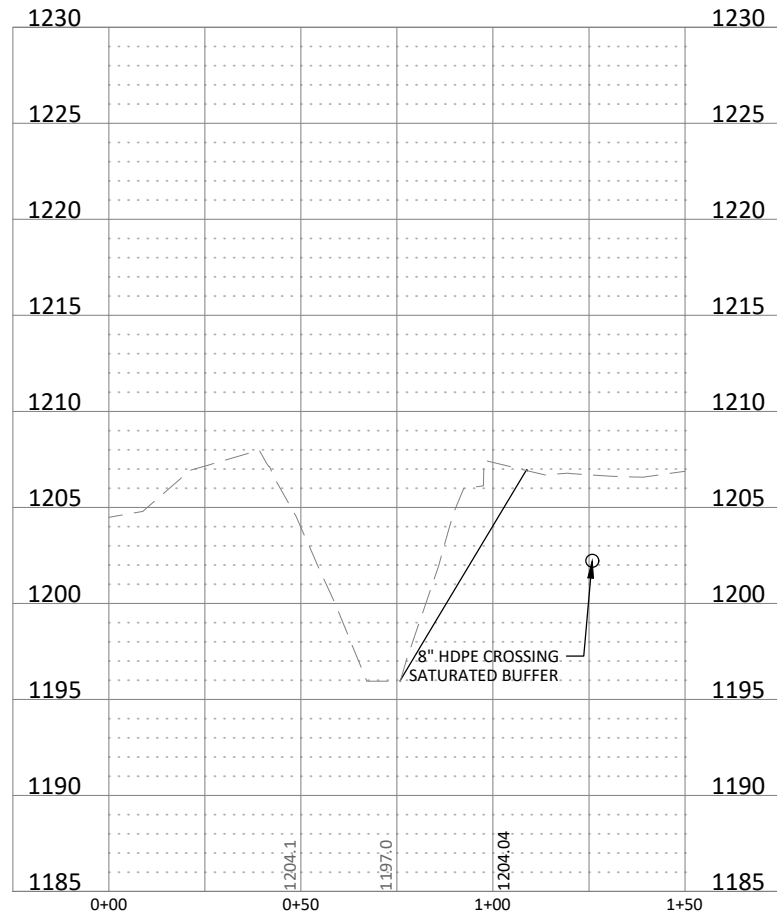


CROSS-SECTION:  
NORTH SATURATED BUFFER  
STA. 2+45

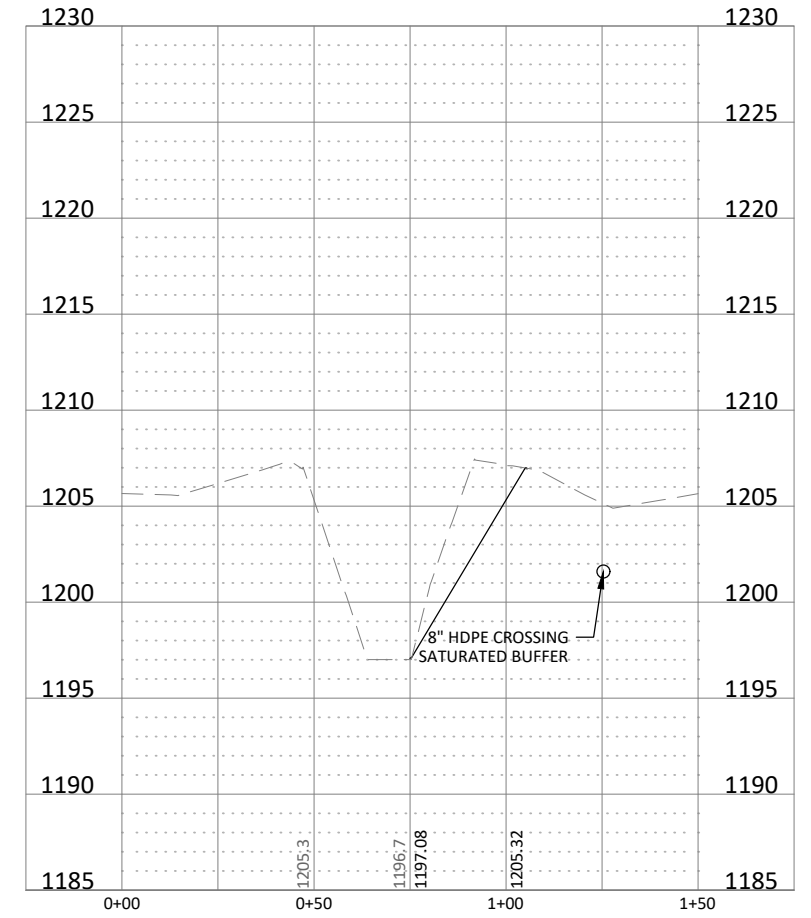

CROSS-SECTION:  
NORTH SATURATED BUFFER  
STA. 4+91

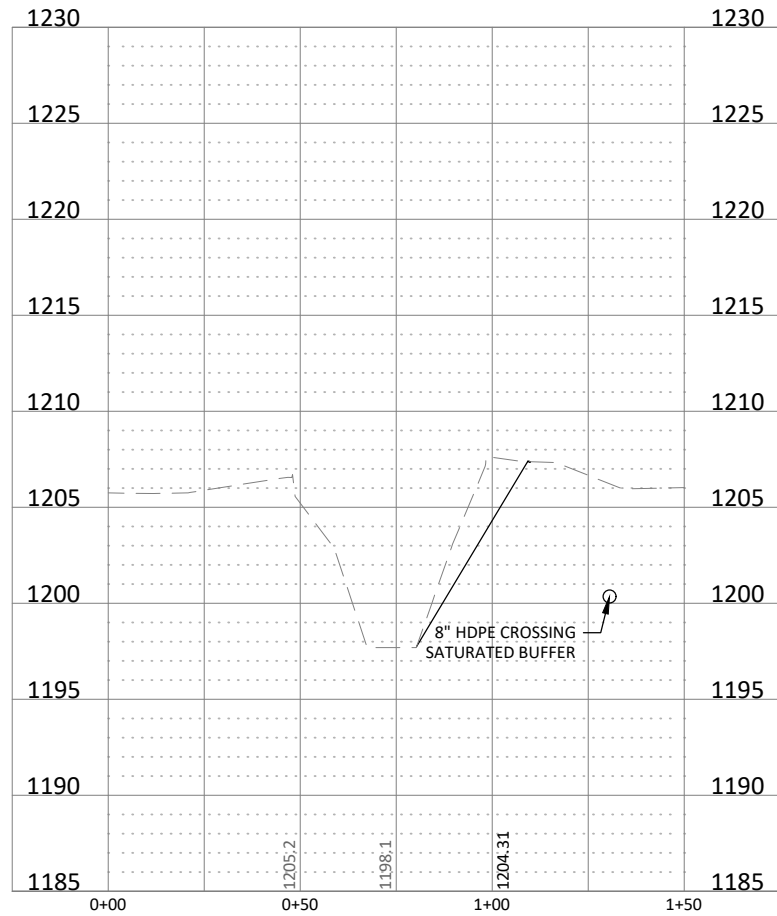

CROSS-SECTION:  
NORTH SATURATED BUFFER  
STA. 7+36

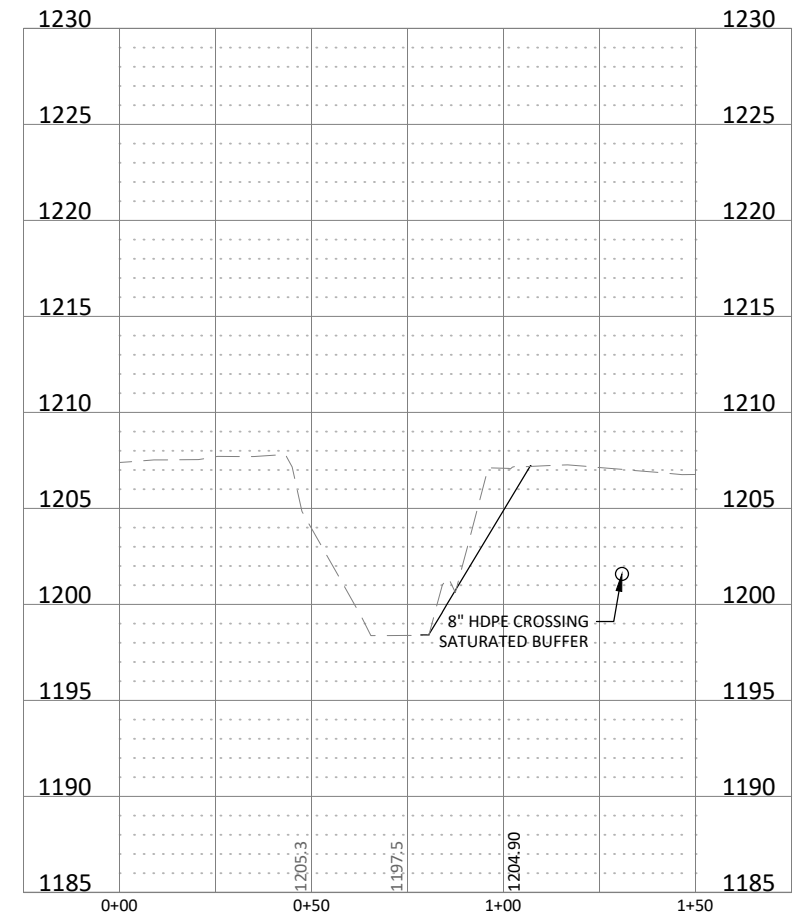

© Bolton & Menk, Inc. 2023. All Rights Reserved. 11/24/2023 11:27:03 AM CAD/CADD/127905\_C:\MISC\_1.dwg 2/14/2024 12:28:32 PM



1519 BALTIMORE DRIVE  
AMES, IOWA 50010  
Phone: (515) 233-6100  
Email: Ames@bolton-menk.com  
www.bolton-menk.com

DESIGNED	REV	DESCRIPTION	DATE
SPM			
DRAWN			
SPM/JKF			
CHECKED			
JPR			
CLIENT PROJ. NO.			

IDALS WATER RESOURCES BUREAU  
PETERSBURG  
DITCH RECONSTRUCTION CROSS-SECTIONS

SHEET

M.08