


----- DISTRIBUTION SYSTEM
 ——— ROADS

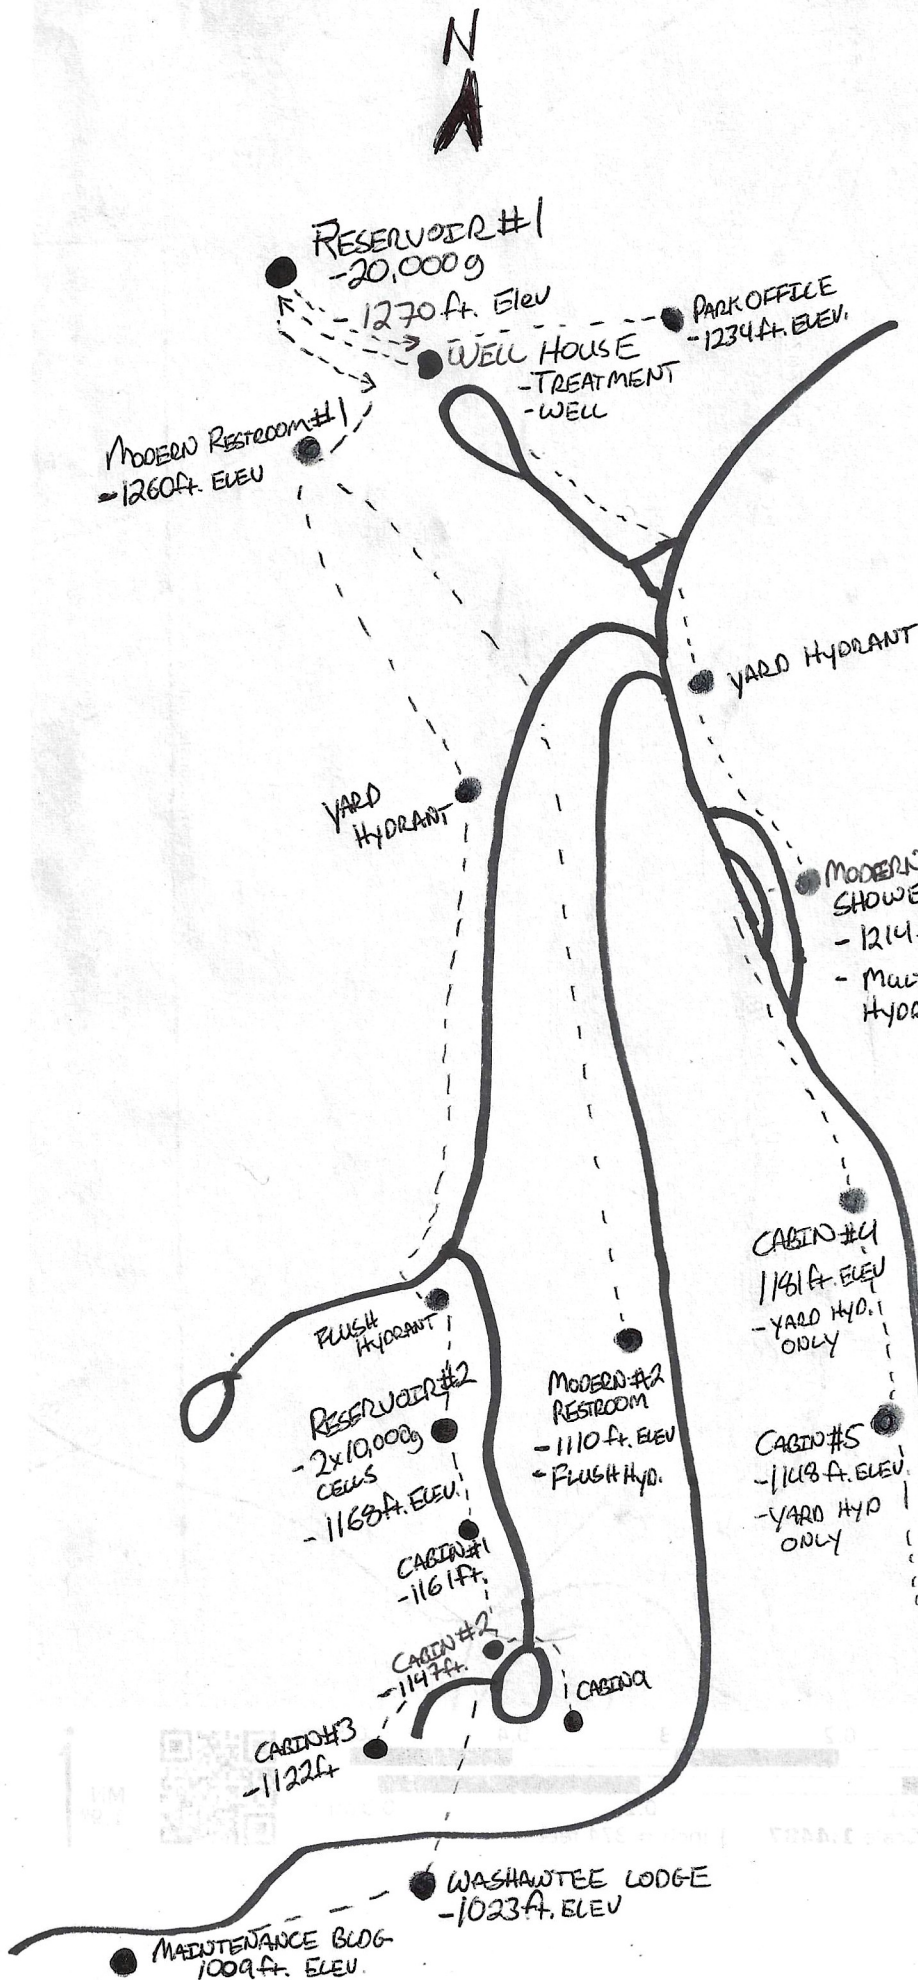

WELL HOUSE, PARK OFFICE,
 MODERN RESTROOM #1, MODERN
 SHOWERS, CABINS 1-3 HAVE
 BOOSTER PUMPS

CABINS 1-3 HAVE RESIDENTIAL
 PLUMBING

CABINS 4-6 HAVE ONLY OUTDOOR
 HYDRANTS

WESTERN DISTRIBUTION LINE
 FROM RESERVOIR #1 TO
 FLUSH HYDRANT IS 2" PVC
 INSTALLED IN 2014.

LINE FROM SAME FLUSH
 HYDRANT TO RESERVOIR #2
 IS 1" POLY.

LINE FROM RESERVOIR #2
 TO WASHAWTEE
 LODGE IS 6" DUCTILE
 IRON SIZED TO
 FILL DEMOLISHED
 SWIMMING POOL.
 INSTALLED 1970'S
 MODERN CONNECTORS
 WERE MADE TO
 THIS LINE.