
Addendum #03 for RFB #911800-02

Project Name: IVH-Mechanical & Electrical Distribution System Replacement

DAS RFB #: 901800-02 DAS

DAS Project #: 9018.00






Date: 6/24/2020

Addendum #3:

- Cover Page (1 page)
- Drawing Revisions (1)
 - M401 MECHANICAL DETAILS

Clarifications/Questions:

- For clarification... Electrically, we do not to include a connection or a feeder over to the Temp Boiler in our estimate because the \$10,000 allowance (for Bid Package 2 Electrical) is supposed to cover this, correct? It is just a little confusing, because I do not understand why electrical information is given about the Temp Boiler if all we are to do is put in a \$10,000 allowance.
 - Base bid shall not include any electrical scope for the temp boiler. The \$10,000 allowance would be used to cover electrical connections/piping as needed if the temp boiler is needed. The electrical information for the temp boiler was provided as it was requested from one of the bidders.

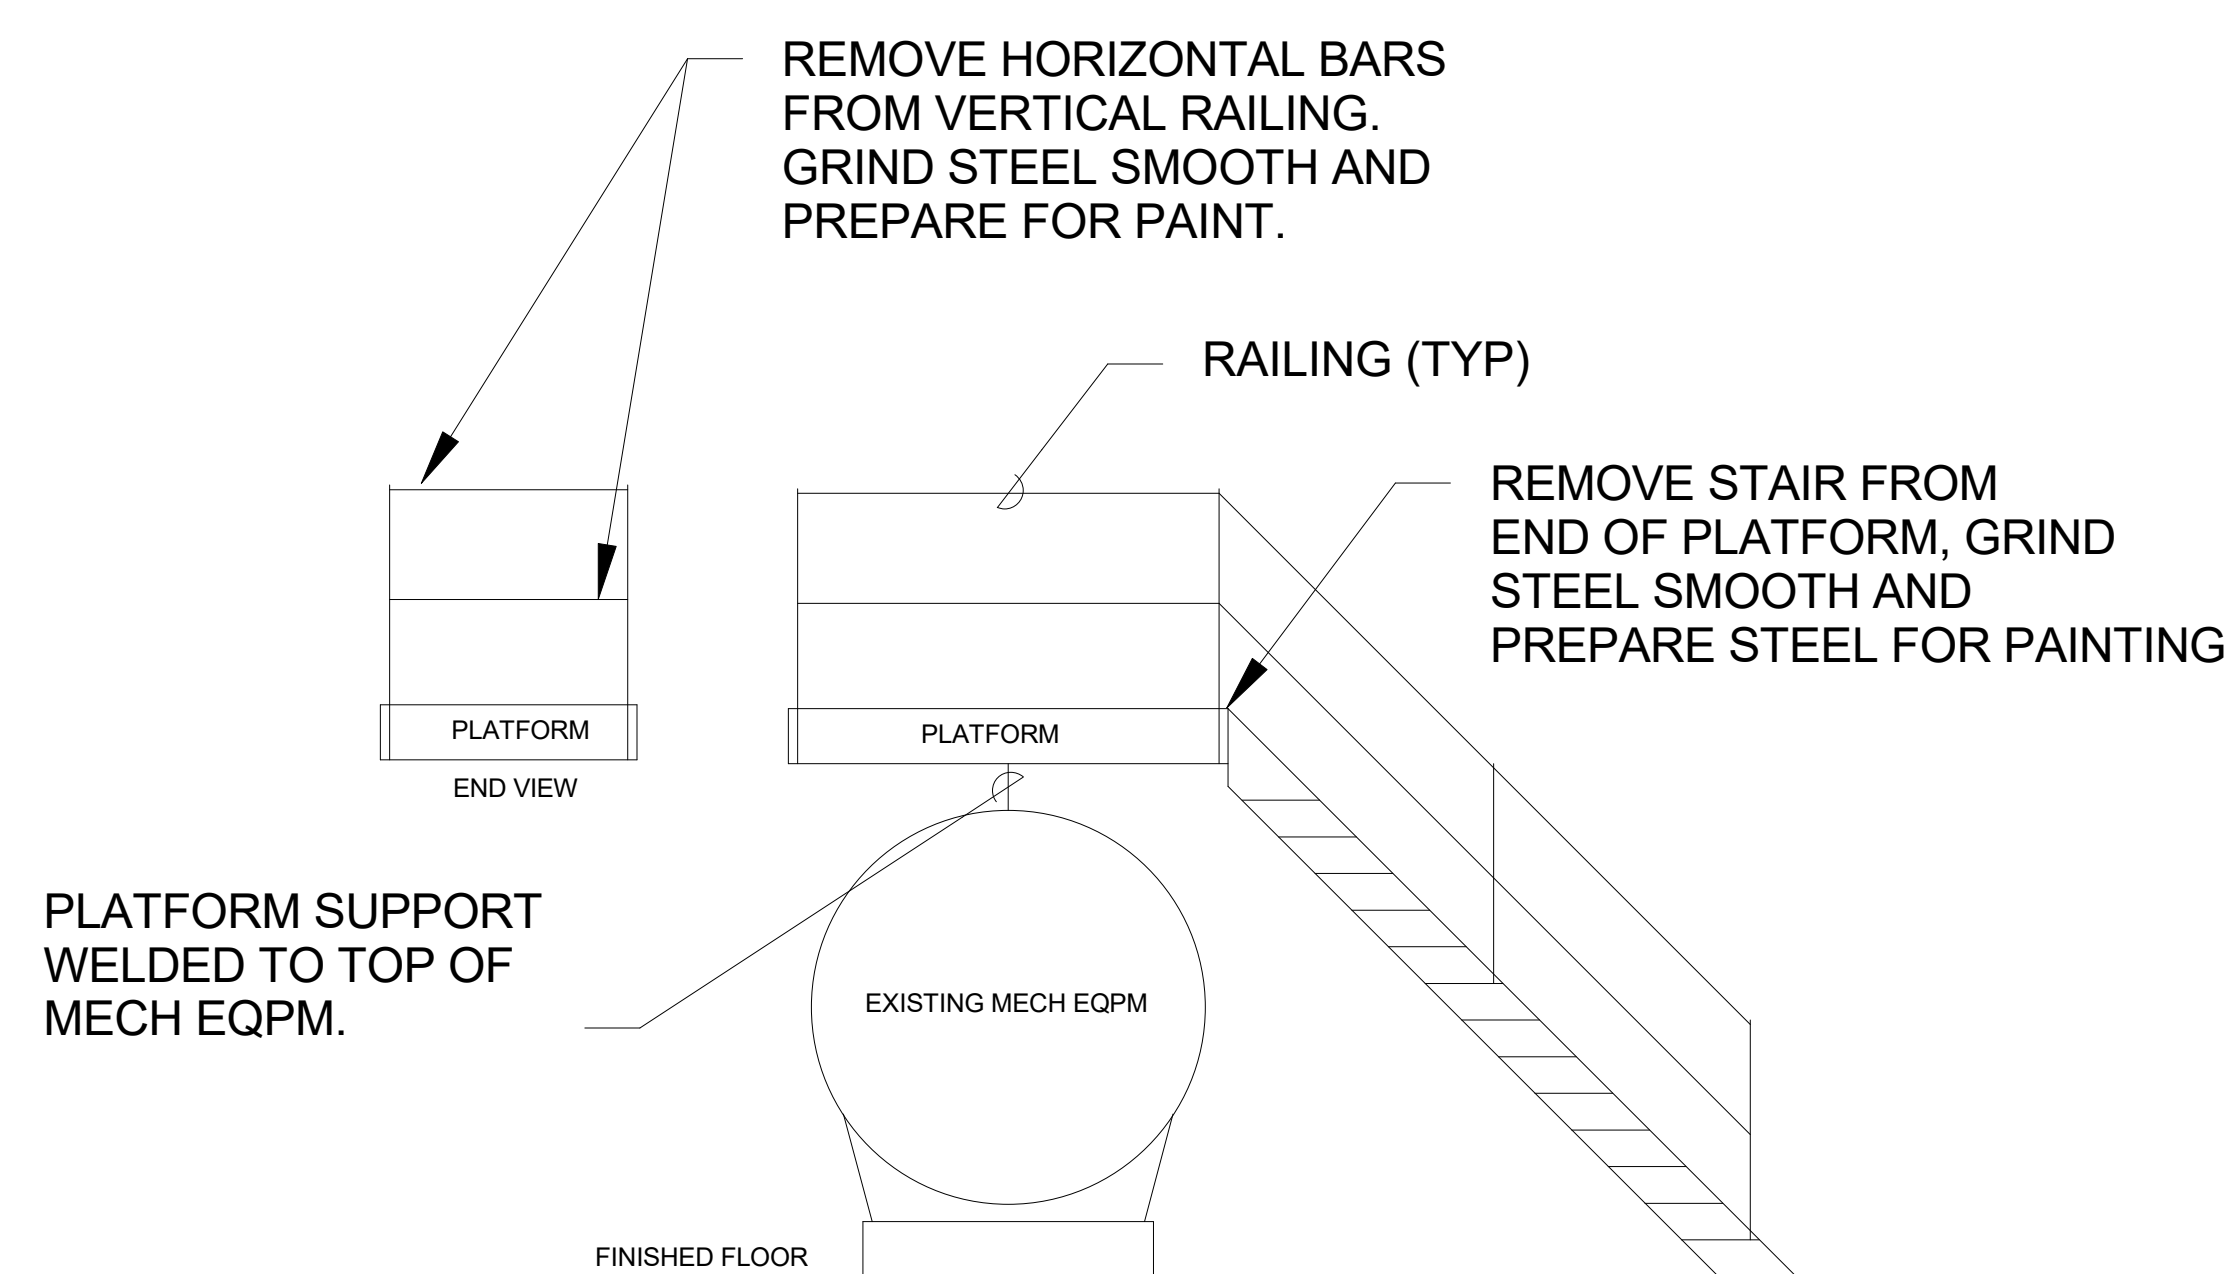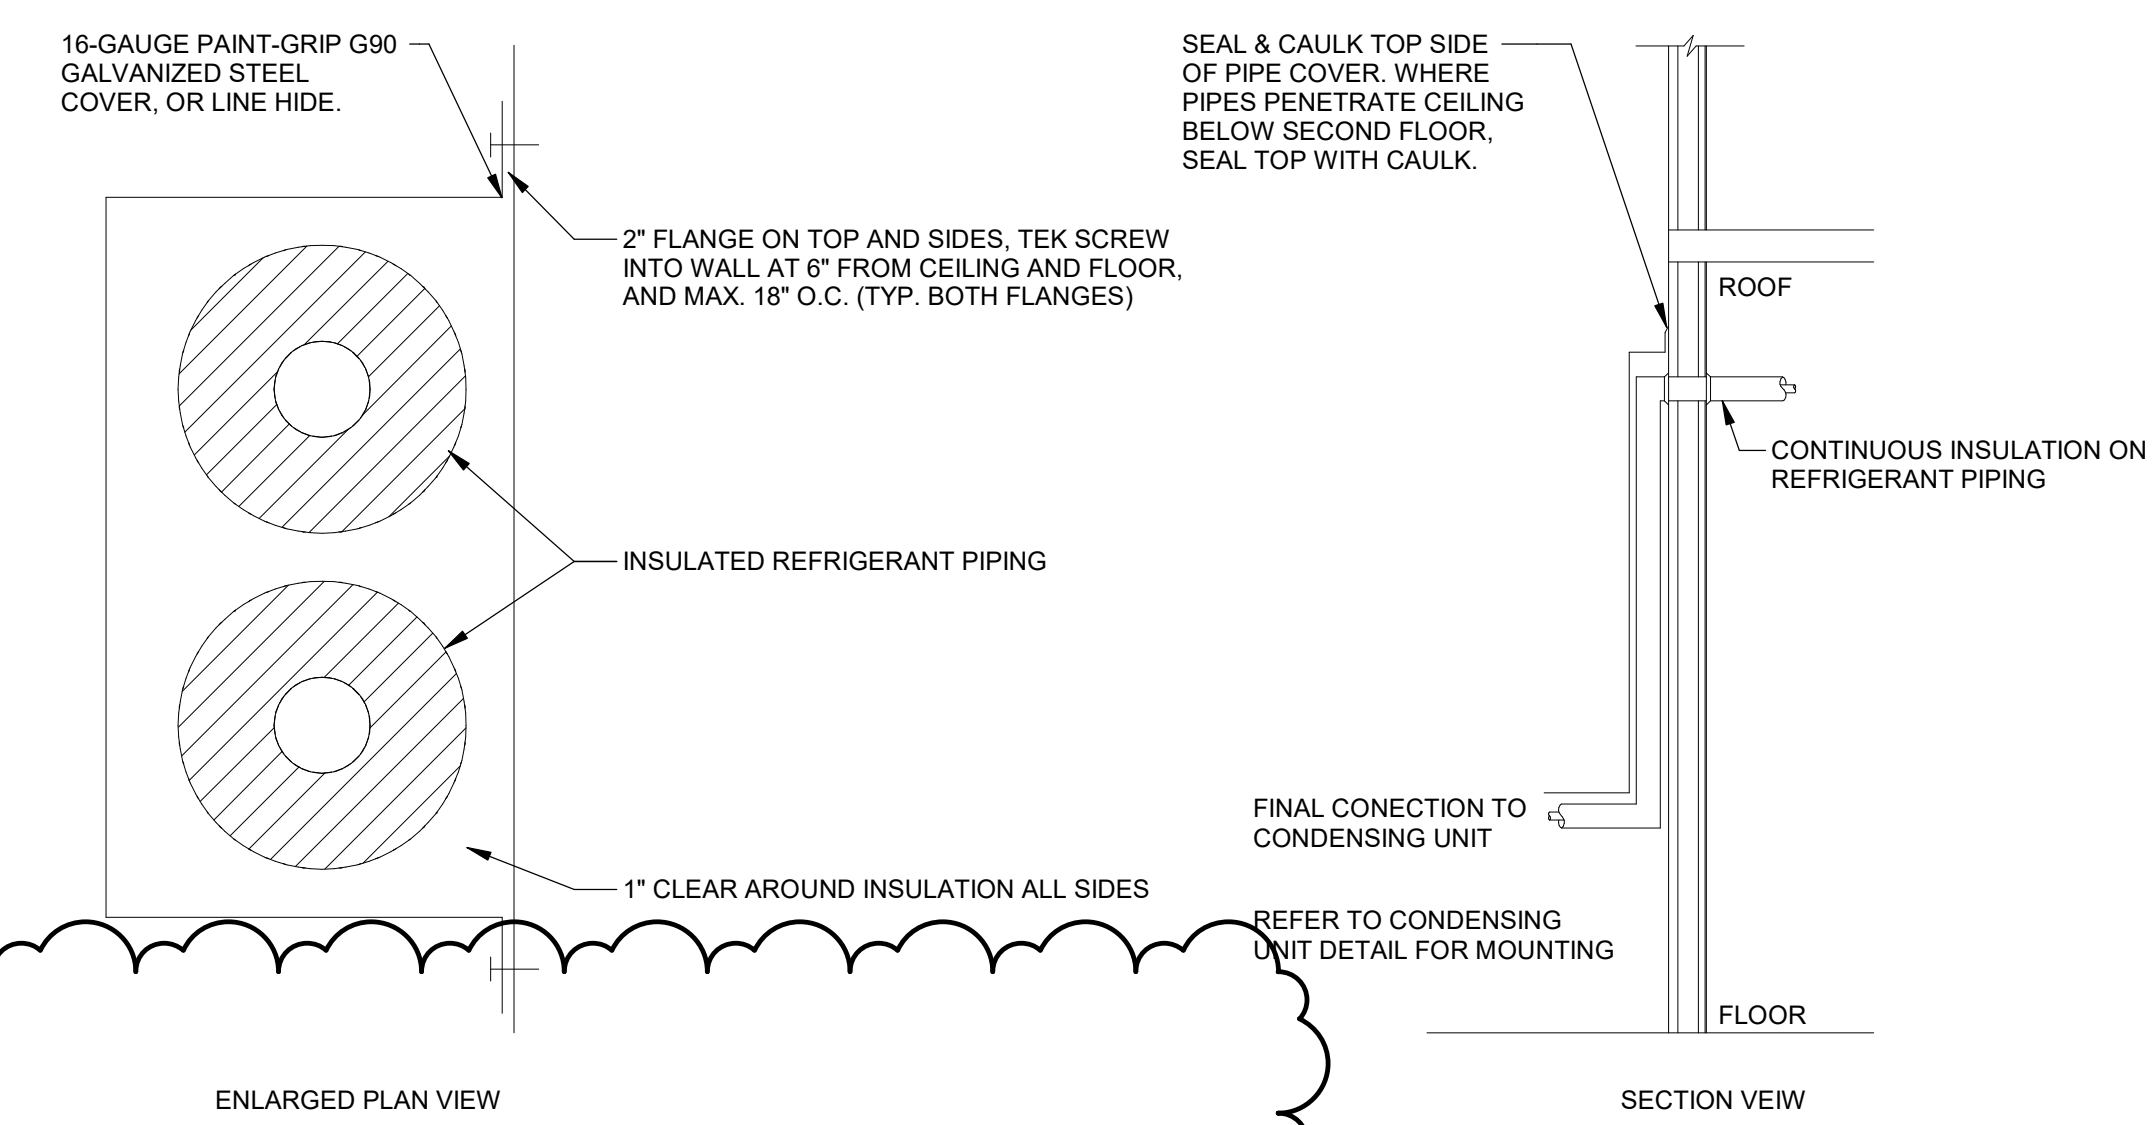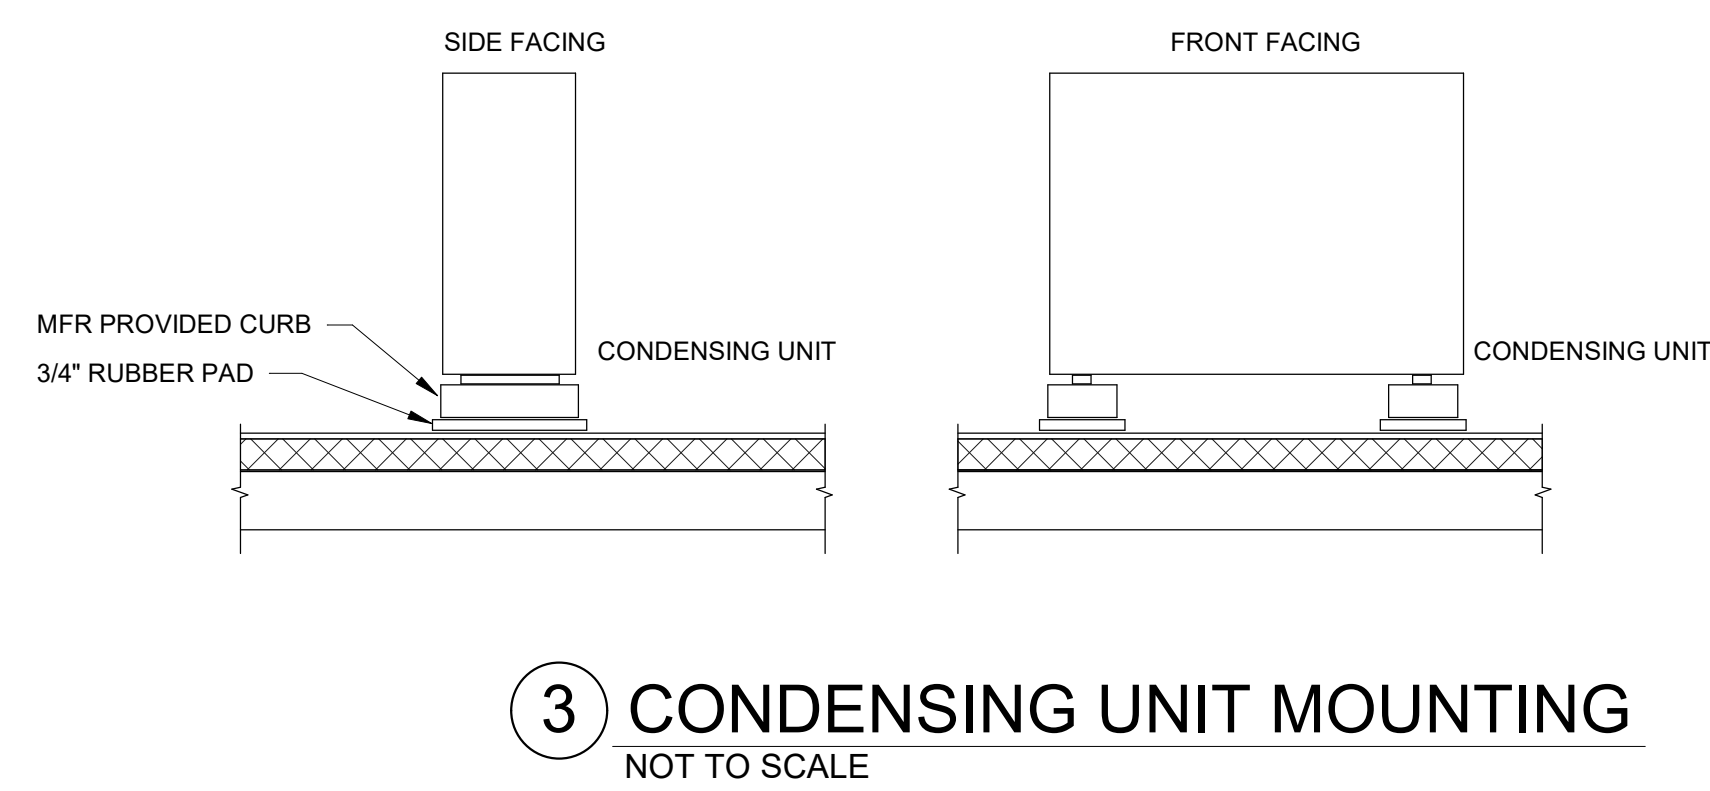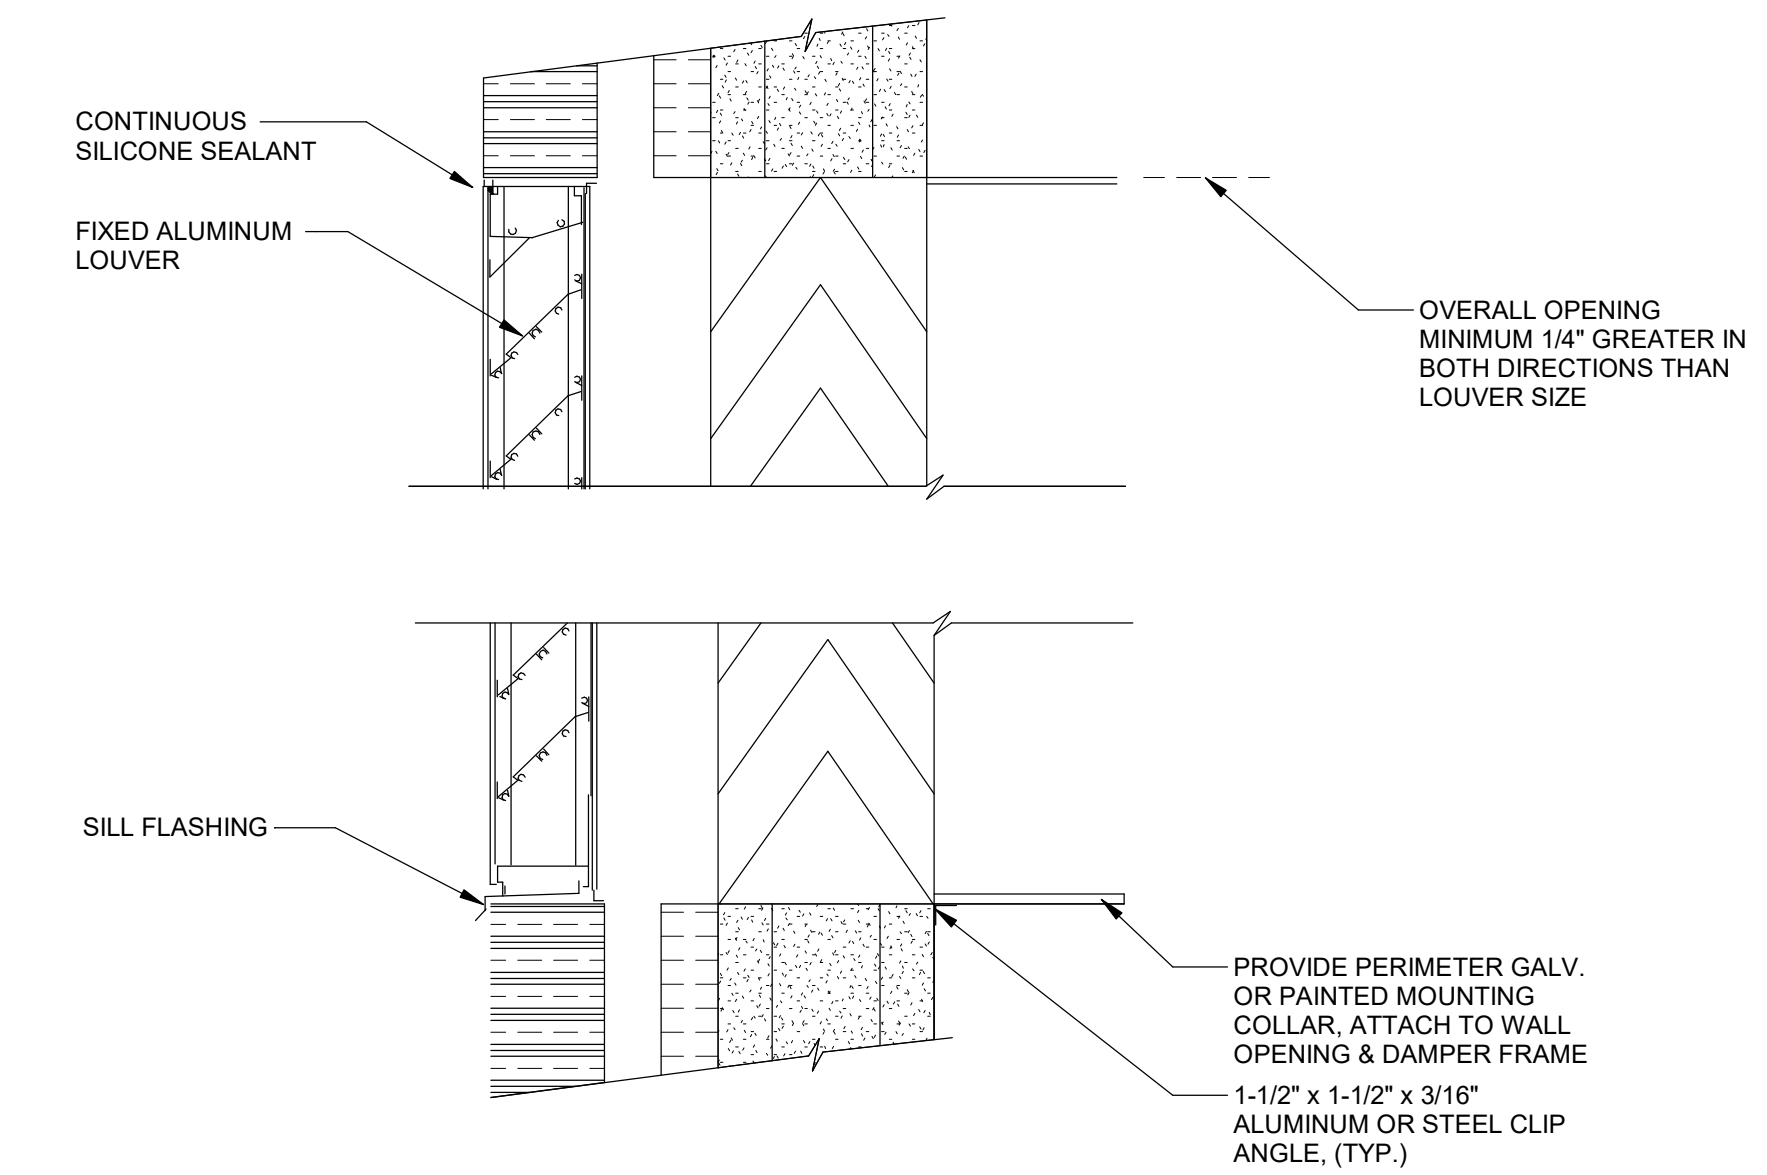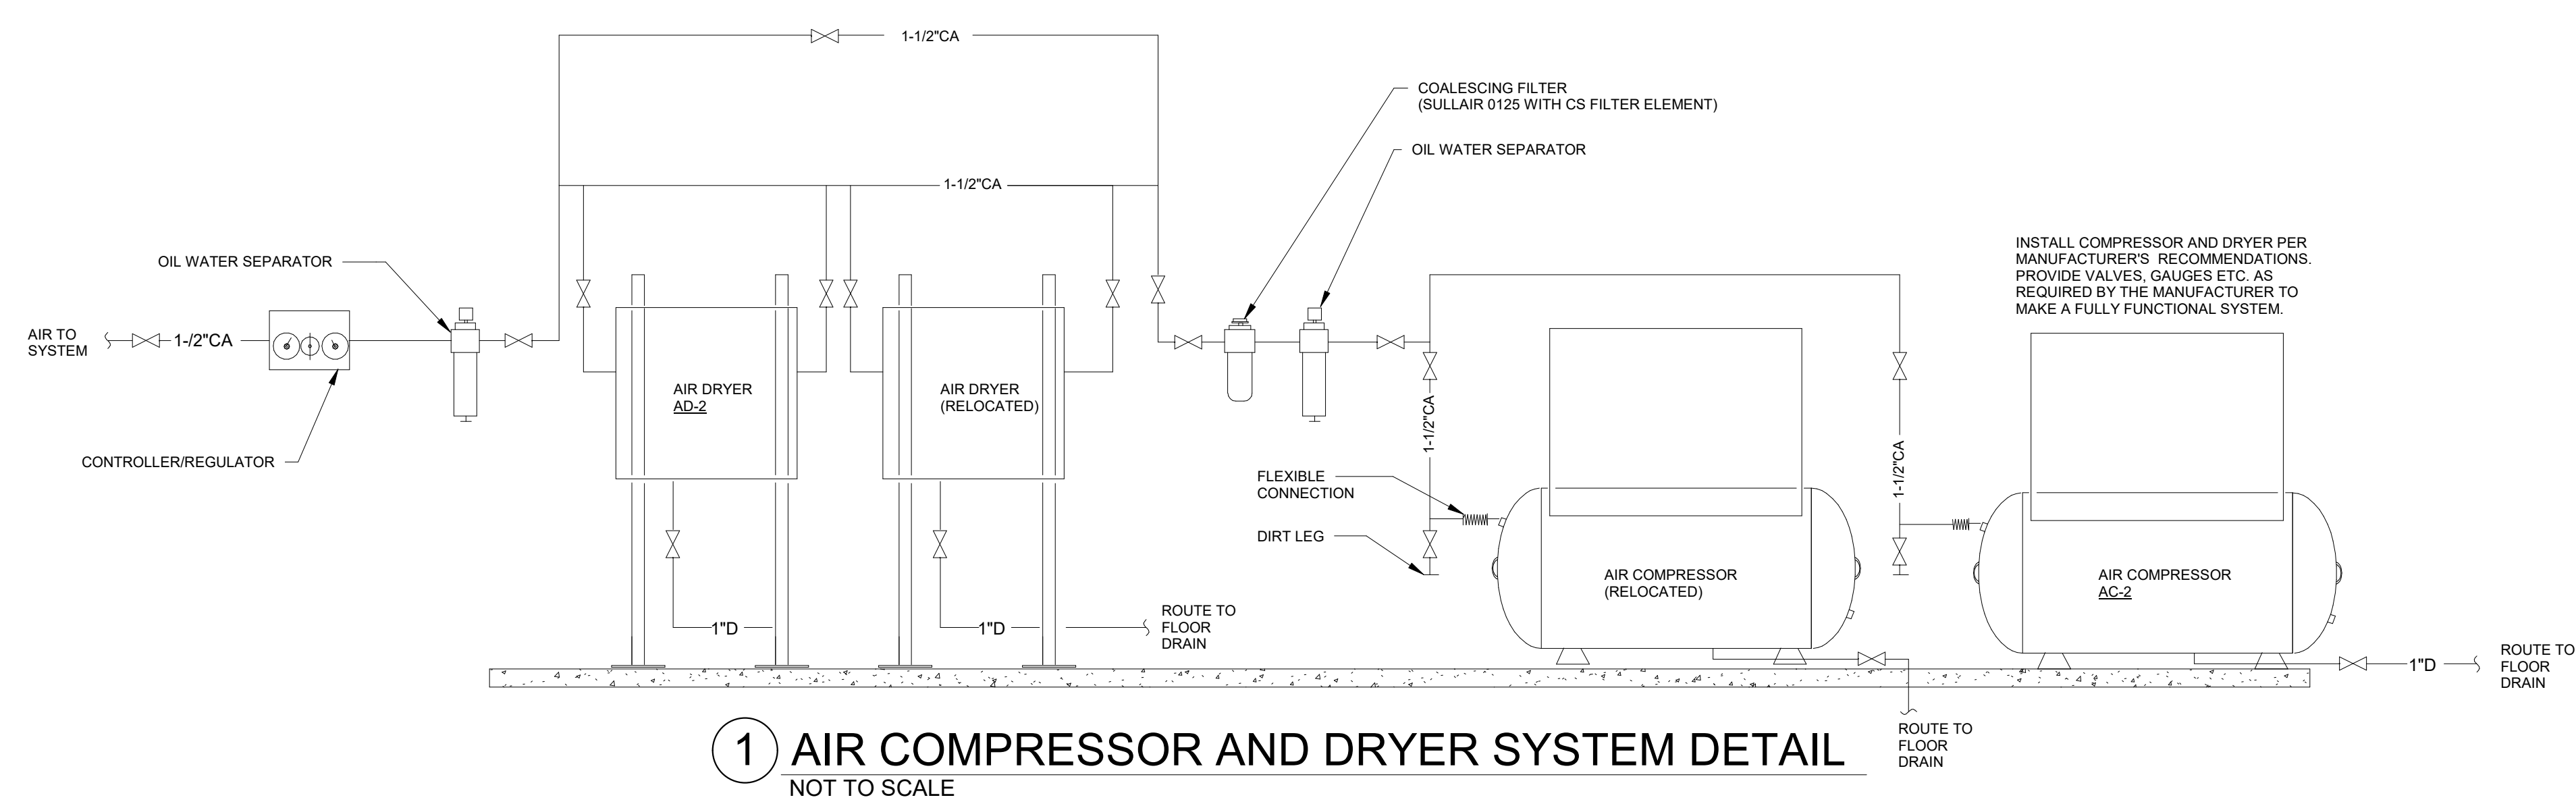


WELD RAILING ON TREAD TO END OF RAILING ON PLATFORM WITH FILLET WELD PER AWS D1.1. GRIND WELD SMOOTH AND PAINT WITH BLACK PAINT.

WELD STAIR TREAD TO PLATFORM BASE WITH TEE FILLET WELD PER AWS D1.1. GRIND WELD SMOOTH AND PAINT WITH BLACK PAINT.

ANCHOR STAIR TREAD BASE TO FLOOR WITH NEW CONCRETE ANCHOR BOLTS.

WELD HORIZONTAL RAILING TO VERTICAL RAILING SUPPORTS AT PLATFORM END WITH TEE FILLET WELDS PER AWS D1.1. GRIND WELDS SMOOTH AND PAINT BLACK.

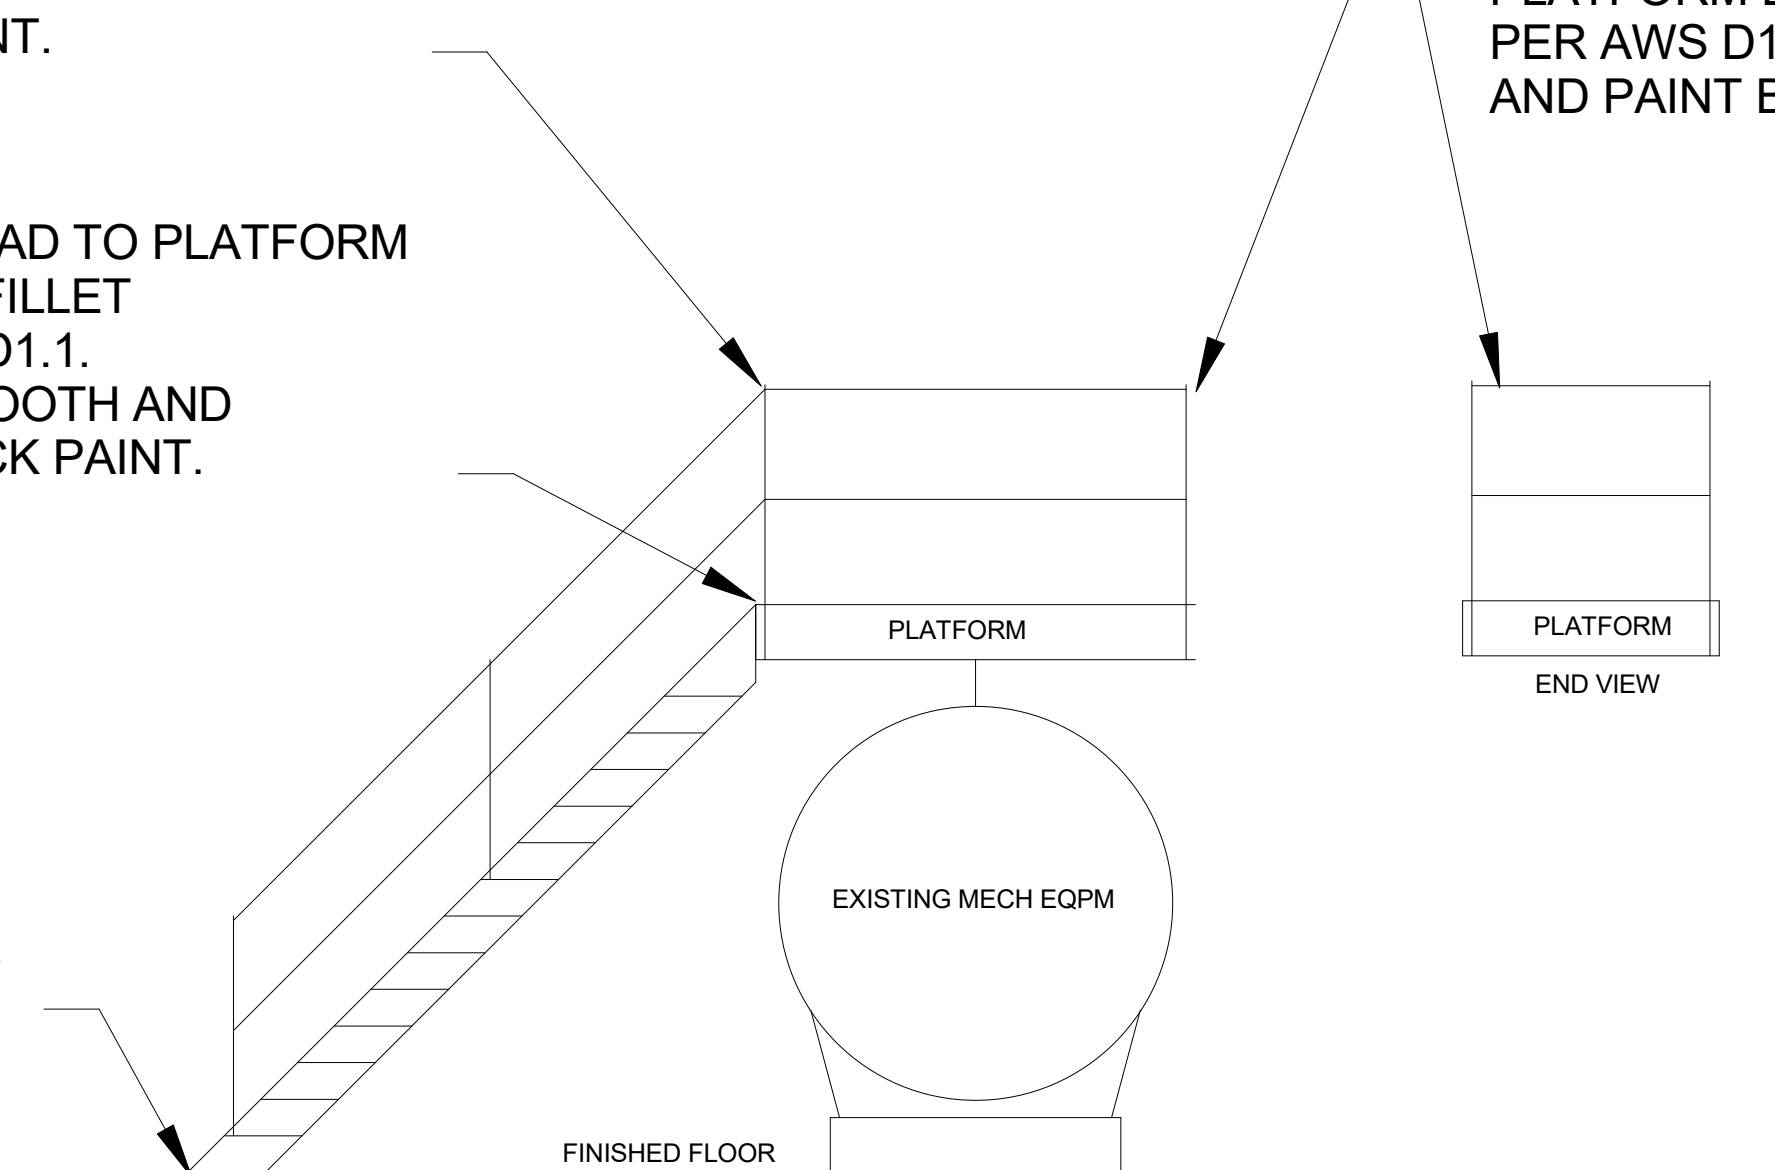

5 BOILER STEEL STAIR AND PLATFORM DEMOLITION AND NEW INSTALLATION
NOT TO SCALE