


HHS STS NEW GARAGE BLDG

3211 Edgington Ave, Eldora, IA 50627

HGM PROJECT NO. 106025 10-10-25

DAS PROJECT NO. 9476.00

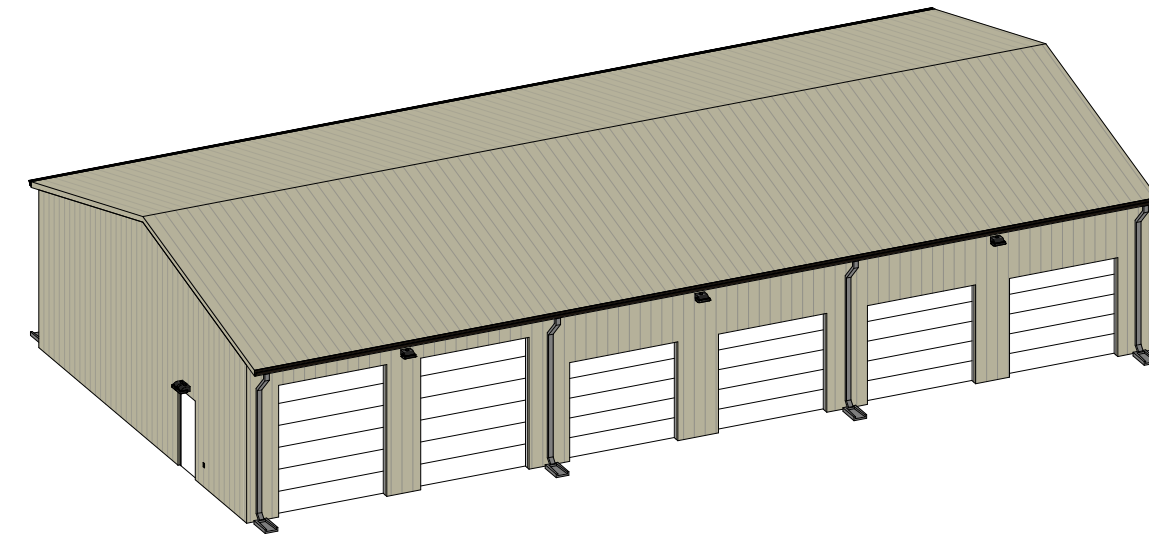

NOTES:

1. DIMENSIONS ARE TO CENTER LINE OF COLUMNS UNLESS OTHERWISE NOTED.
2. WRITTEN DIMENSIONS TAKE PRECEDENCE OVER DRAWING SCALE.
3. IF THE CONTRACTOR FAILS TO OBTAIN WRITTEN CLARIFICATION OF INCONSISTENCIES IN THE BID DOCUMENTS FROM THE ARCHITECT, HE SHALL BID THE MORE EXPENSIVE VERSION.

INDEX OF DRAWINGS

GENERAL

- G1.1 COVER SHEET
- G1.2 ABBREVIATIONS & SYMBOLS
- G1.3 CODE PLAN

CIVIL

- C1.0 TOPOGRAPHIC SURVEY
- C2.0 CIVIL SITE PLAN
- C3.0 GRADING PLAN

ARCHITECTURAL

- A1.1 FLOOR PLAN
- A2.1 EXTERIOR ELEVATIONS

STRUCTURAL

- S1.1 FOUNDATION PLAN & DETAILS
- S2.1 ROOF FRAMING PLAN & DETAILS

GENERAL MECHANICAL

- MGO.0 MECHANICAL GENERAL INFORMATION

MECHANICAL

- M1.1 MECHANICAL PLAN

GENERAL ELECTRICAL

- EGO.0 ELECTRICAL GENERAL INFORMATION

ELECTRICAL

- E1.1 ELECTRICAL PLAN
- E2.1 ELECTRICAL SCHEDULES AND RISERS



LOCATION PLAN
SCALE: NOT TO SCALE



I, Michael Anderson am the responsible professional for the design of the HHS STS NEW GARAGE BLDG

I hereby certify that the portion of this technical submission described below was prepared by me or under my direct supervision and responsible charge. I am a duly registered Architect under the laws of the State of Iowa.

(signature) *Michael J. Anderson* 10-10-25

My registration renewal date is June 30, 2026.

Pages or sheets covered by this seal:
All General Sheets
All Architectural Sheets

I hereby certify that this engineering document was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Iowa.

(signature) *Zachary M. Wheat* 10-10-25

My registration renewal date is December 31, 2026.

Pages or sheets covered by this seal:
All Civil Sheets

I hereby certify that this engineering document was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Nebraska.

(signature) *Mackenzie Jaeger* 10-10-25

My registration renewal date is December 31, 2026.

Pages or sheets covered by this seal:
All Structural Sheets

I hereby certify that this engineering document was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Iowa.

(signature) *Justin L. Veik* 10-10-25

My registration renewal date is December 31, 2025.


Pages or sheets covered by this seal:
All Mechanical Sheets

I hereby certify that this engineering document was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Iowa.

(signature) *Shane M. Hoss* 10-10-25

My registration renewal date is December 31, 2025.

Pages or sheets covered by this seal:
All Electrical Sheets

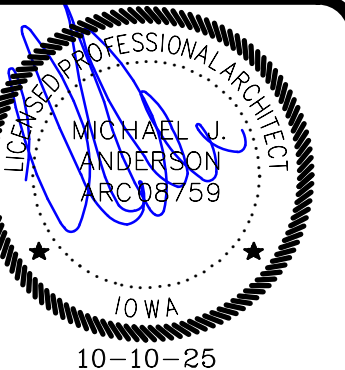

hgm
ASSOCIATES INC.
ENGINEERING ARCHITECTURE SURVEYING
council bluffs omaha

This drawing is being made in accordance with the terms of the agreement between HGM Associates Inc. and the client. HGM Associates Inc. assumes no liability for any use of this drawing for any purpose other than that intended, except in accordance with the terms of the above agreement.

Rev#	Date
HGM drawn	
HGM designed	
HGM approved	
	10-10-25
	date

HHS STS NEW GARAGE BLDG
3211 Edgington Ave, Eldora, IA 50627

project no. 106025
9476.00
sheet

client

sheet

project no.
106025
9476.00
sheet

G1.1


ARCHITECTURAL, STRUCTURAL AND CIVIL ABBREVIATIONS

A/C	AIR CONDITIONING	ELEC	ELECTRICAL	LONG	LONGITUDINAL	SCHE	SCHEDULE
AB	ANCHOR BOLT	ELEV	ELEVATOR	LP	LOW POINT	SD	SOAP DISPENSER
ACM	ALUMINUM COMPOSITE METAL	EMER	EMERGENCY	LSP	LINOLEUM SHEET FLOORING	SECT	SECTION
ACT	ACOUSTIC CEILING TILE	ENTR	ENTRANCE	LT	LIGHT	SEG	SEGMENTAL
ADJ	ADJACENT	EOD	EDGE OF DECK	LVT	LUXURY VINYL TILE	SH	SHELF, SHELVING
ADJT	ADJUSTABLE	EOR	END OF RETURN	M	METER(S)	SHM	SECURITY, HOLLOW METAL
AFF	ABOVE FINISHED FLOOR	EQ	EQUAL	MAS	MASONRY	SHT	SHEET
AGG	AGGREGATE	EQUIP	EQUIPMENT	MATL	MATERIAL	SHTH	SHEATHING
ALT	ALTERNATE	EN	EACH WAY	MB	MARKER BOARD	SIM	SIMILAR
ALUM	ALUMINUM	ENC	ELECTRIC WATER COOLER	MBH	MOP / BROOM HOLDER	SLR	SEALER
ANCH	ANCHOR	EXH	EXHAUST	MECH	MECHANICAL	SND	SANITARY NAPKIN DISPOSAL
ANOD	ANODIZED	EXIST	EXISTING	MED	MEDICINE CABINET	SNT	SEALANT
APC	ACOUSTICAL PANEL CEILING	EXP	EXPANSION	MEPE	MECHANICAL, ELECTRICAL, PLUMBING	SNV	SANITARY NAPKIN VENDOR
ARCH	ARCHITECTURAL	EXPD	EXPOSED	MFR	MANUFACTURER	SPEC	SPECIFICATIONS
ASPH	ASPHALT	EXT	EXTERIOR	MH	MANHOLE	SPF	SPLIT-FACE ROOFING
AUTO	AUTOMATIC	FA	FIRE ALARM	MIN	MINIMUM	SPMR	SINGLE-PLY MEMBRANE ROOFING
B	BOTTOM	FB	FACE BRICK	MIR	MIRROR	SQ	SQUARE
B-B	BACK TO BACK	FBG	FIBERGLASS	MISC	MISCELLANEOUS	SSM	SOLID SURFACING MATERIAL
B/C	BACK OF CURB	FBO	FURNISHED BY OTHERS	MLD	MOLDING	SSTL	STAINLESS STEEL
BBM	BOND BEAM	FCWP	FIBER CEMENT WALL PANEL	MO	MASONRY OPENING	ST	STORM
BD	BOARD	FD	FLOOR DRAIN	MOD	MODULAR	STA	STATION
BEN	BENCH	FE	FIRE EXTINGUISHER	MR	MOISTURE RESISTANT	STD	STANDARD
BLDG	BUILDING	FEC	FIRE EXTINGUISHER CAB	MTD	MOUNTED	STL	STEEL
BLK	BLOCK	FES	FLARED END SECTION	MTL	METAL	STN	STAIN & VARNISH
BLKG	BLOCKING	FF	FINISHED FLOOR	MULL	MULLION	STOR	STORAGE
BM	BEAM	FG	FULL GLASS	N	NORTH	STR	STRUCTURAL
BM	BENCHMARK	FIN	FINISHED	NIC	NOT IN CONTRACT	SUSP	SUSPENDED
BN	BULLNOSE	FIXT	FIXTURE	NOM	NOMINAL	SW	SWITCH
BOS	BOTTOM OF STRUCTURE	FLASH	FLASHING	NTS	NOT TO SCALE	SYM	SYMMETRICAL
BOT	BOTTOM	FLR	FLOOR (ING)	OC	ON CENTER	T	TREAD
BRG	BEARING	FLUR	FLUORESCENT	OD	OUTSIDE DIAMETER	T/B	TOP AND BOTTOM
BRK	BRICK	FND	FOUNDATION	OFF	OFFICE	T/G	TONGUE AND GROOVE
BS	BOTH SIDES	FR	FRAMING	OH	OVERHEAD	TB	TONEL BAR
BSMT	BASEMENT	FRP	FIBERGLASS REINF PLASTIC	OPG	OPENING	TC	TOP OF CURB
BUR	BUILT UP ROOF	FTS	FLOOR TRANSITION STRIP	P	PAINT	TEL	TELEPHONE
BN	BOTH WAYS	FUR	FURRING	PAF	POWDER ACTIVATED FASTENER	TEMP	TEMPERED
C/G	CURB AND GUTTER	FURN	FURNACE	PAVMT	PAVEMENT	TER	TERRAZZO
CAB	CABINET	FV	FIELD VERIFY	PBD	PARTICLE BOARD	TERM	TERMINAL
CE	COVER ELEVATION	GA	GAGE	PC	POINT OF CURVATURE	TEX	TEXTURED
CH	CHAIR	GALV	GALVANIZED	PCC	PORTLAND CEMENT CONCRETE	TH	THICK (NESS)
CIP	CAST IRON PIPE	GB	GRAB BAR	PCWP	PREGAST WALL PANEL	THR	THRESHOLD
CIR	CIRCLE	GD	GRADE, GRADING	PERF	PERFORATED	TOM	TOP OF MASONRY
CJ	CONTROL JOINT	GFB	GLASS FIBER BLANKET/BATT	PERIM	PERIMETER	TOS	TOP OF SLAB
CLG	CEILING	GFT	GLAZED FLOOR TILE	PFN	PREFABRICATED	TOSTL	TOP OF STEEL
CLOS	CLOSET	GL	GLASS, GLAZING	PFN	PREFINISHED	TOW	TOP OF WALL
CLR	CLEAR (ANCE)	GPDW	GYPSPUM DRYWALL	PI	POINT OF INTERSECTION	TP	TOP OF PAVEMENT
CMP	CORRUGATED METAL PIPE	GRAN	GRANULAR	PL	PLATE	TPTN	TOILET PARTITION
CMU	CONCRETE MASONRY UNIT	GRD	GROUND	PLAM	PLASTER LAMINATE	TR	TONEL RING
COL	COLUMN	GRT	GROUT	PLAS	PLASTER	TRD	TREATED
CONC	CONCRETE	HB	HOSE BIB	PNL	PANEL	TTD	TOILET TISSUE DISPENSER
CONST	CONSTRUCTION	HBD	HARDBOARD	POB	POINT OF BEGINNING	TV	TELEVISION
CONT	CONTINUOUS/CONTINUE	HC	HANDICAP	POL	POLISHED	UC	UNDER COUNTER
CONTR	CONTRACTOR	HCS	HOLLOW CORE SLAB	PR	PAIR	UG	UNDERGROUND
COORD	COORDINATE	HDWR	HARDWARE	PRHT	PARTIAL HEIGHT	UNFIN	UNFINISHED
CORR	CORRIDOR	HJR	HORIZONTAL JOINT REINF	PSF	POUNDS PER SQUARE FOOT	UNO	UNLESS NOTED OTHERWISE
CPT	CARPET	HM	HOLLOW METAL	PSI	POUNDS PER SQUARE INCH	UR	URINAL
CRS	COURSE	HORZ	HORIZONTAL	PT	POINT OF TANGENCY	VB	VAPOR BARRIER
CS	COUNTER SHUTTER	HP	HIGH POINT	PTD	PAPER TOWEL DISPENSER	VCP	VITREOUS CLAY PIPE
CSH	CONCRETE SLAB HARDENER	HR	HOUR	PTN	PARTITION	VCT	VINYL COMPOSITION TILE
CSMT	CASEMENT	HT	HEIGHT	PVC	POLYVINYL CHLORIDE	VERT	VERTICAL
CT	CERAMIC TILE	HTG	HEATING	PWD	PLYWOOD	VIN	VINYL
CTR	COUNTER	HVAC	HEATING/VENTILATING AIR CONDITIONING	QTY	QUANTITY	VTR	VENT THRU ROOF
CJ	CONCRETE UNDERLAYMENT	HW	HOT WATER	R	RADIUS	VVC	VINYL WALL COVERING
CA	COLD WATER	HND	HARDWOOD	R	RISER	W	WEST
CY	CUBIC YARD	ID	INSIDE DIAMETER	RA	RETURN AIR	W	WITH
DBL	DOUBLE	IDS	INTEGRATED DOOR SYSTEMS	RAF	RESILIENT ATHLETIC FLOORING	W/O	WITHOUT
DGS	DIAPER CHANGING STATION	IE	INVERT ELEVATION	RB	RUBBER BASE	WC	WATER CLOSET
DF	DRINKING FOUNTAIN	INCL	INCLUDING	RCP	REFLECTED CEILING PLAN	WD	WOOD
DH	DOUBLE HUNG	INST	INSTALLED	RD	ROOF DRAIN	WDM	WINDOW
DIA	DIAMETER	INSUL	INSULATION	REF	REFERENCE	WH	WATER HEATER
DIAG	DIAGONAL	INT	INTERIOR	REFR	REFRIGERATOR	WKP	WORKING POINT
DIM	DIMENSION	INV	INVERT	REINF	REINFORCEMENT	WR	WASTE RECEPTACLE
DIP	DUCTILE IRON PIPE	IRWP	IMPACT RESISTANT WALL PANEL	REQD	REQUIRED	WSCOT	WAINSCOT
DISP	DISPENSER	JFB	JOINT FILLER BOARD	REV	REVERSE	WT	WEIGHT
DN	DOWN	JST	JOIST	RH	RIGHT HAND	WWF	WELDED WIRE FABRIC
DP	DEEP	JT	JOINT	RH	ROBE HOOK	XL	EXIT LIGHT
DR	DOOR	KIT	KITCHEN	RLT	RESILIENT LANDING TILE	YD	YARD
DS	DOWN SPOUT	KO	KNOCKOUT	RM	ROOM		
DTL	DETAIL	LAM	LAMINATE(D)	RO	ROUGH OPENING		
DN	DISHWASHER	LAV	LAVATORY	ROW	RIGHT OF WAY		
DWG	DRAWING	LBS	POUNDS	S	SOUTH		
DWR	DRAWER	LDR	LADDER	SAN	SANITARY		
E	EAST	LH	LEFT HAND	SBLK	SPLASH BLOCK		
EF	EACH FACE	LL	LIVE LOAD	SC	SHOWER CURTAIN		
EJ	EXPANSION JOINT						
EL	ELEVATION						


ARCHITECTURAL SYMBOLS

Name	ROOM NAME / NUMBER
101	101
(100)	DOOR NUMBER
(A)	WALL TAG
(W)	WINDOW TAG

SECTION IDENTIFICATION

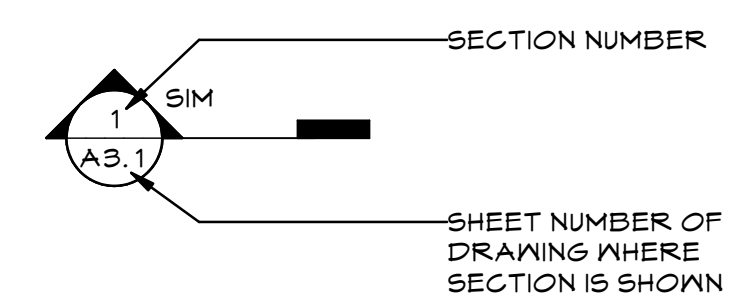


ELEVATION IDENTIFICATION

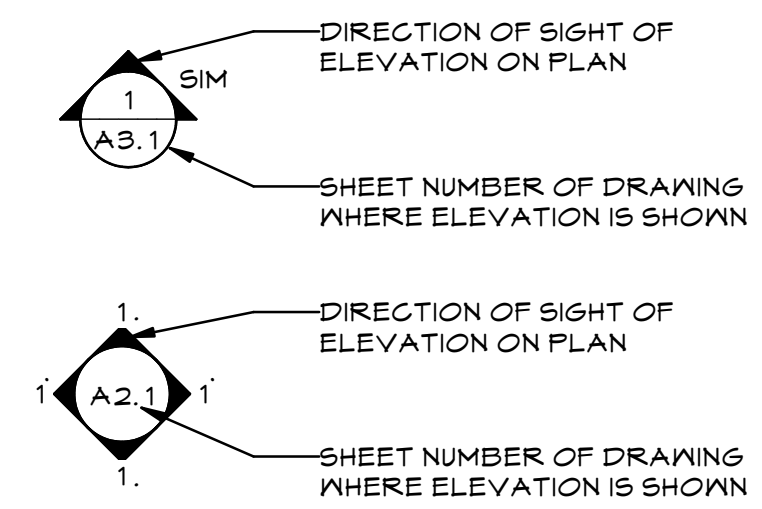


ARCHITECTURAL LEGEND

	GLASS
	INSULATION
	RIGID INSULATION
	GPDW
	WOOD (FINISH)
	WOOD (ROUGH)
	MASONRY VENEER
	CMU (PLAN)
	CMU (SECTION)
	CONCRETE
	EARTH

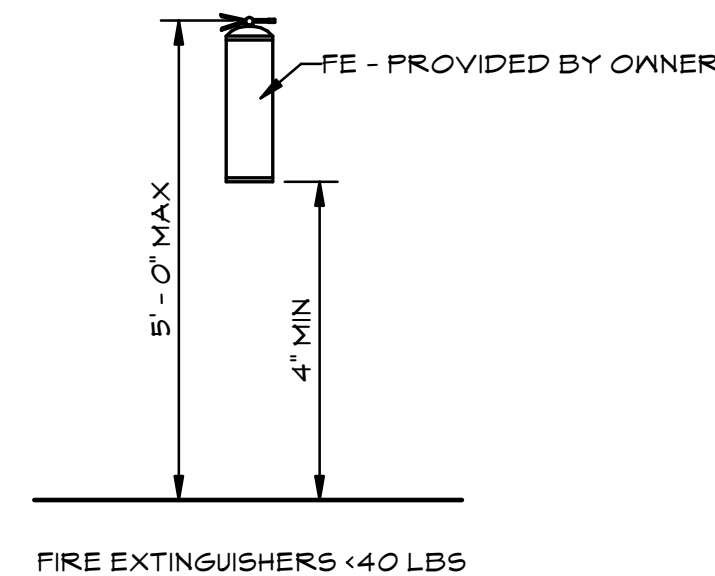

1 TYP MOUNTING HEIGHTS
SCALE: 1/2" = 1'-0"

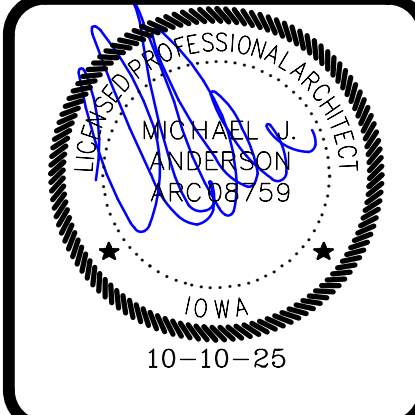

hgm ASSOCIATES INC.
ENGINEERING ARCHITECTURE SURVEYING
council bluffs omaha

This drawing is being made for use on this project in accordance with hgm standards and specifications for professional services. hgm associates inc. assumes no liability for any use of this drawing in accordance with the terms of the above agreement.

Rev#	Date
HGM	
drawn	
HGM	
designed	
HGM	
approved	
10-10-25	date

HHS STS NEW GARAGE BLDG
3211 Edgington Ave., Eldora, IA 50027

ABBREVIATIONS & SYMBOLS

project no. 106025
client 9476.00
sheet

project no. 106025
client 9476.00
sheet

G1.2

CODE ANALYSIS

DESIGN CODES

2024 INTERNATIONAL BUILDING CODE
 2015 NFPA 101 LIFE SAFETY CODE
 2012 INTERNATIONAL ENERGY CONSERVATION CODE
 2024 INTERNATIONAL FIRE CODE
 2024 UNIFORM PLUMBING CODE
 2023 NATIONAL ELECTRICAL CODE
 2024 INTERNATIONAL MECHANICAL CODE

OCCUPANCY CLASSIFICATION

OCCUPANCY TYPE = S-2 - STORAGE
 NO HAZARDOUS MATERIALS ARE TO BE STORED WITHIN THIS BUILDING.
 LOW-HAZARD STORAGE FOR FLEET VEHICLE STORAGE

TYPE OF CONSTRUCTION

TYPE "VB"
 SPRINKLER - NO
 FIRE ALARM SYSTEM - NO
 DRAFT STOPS - NOT REQUIRED
 MAXIMUM TRAVEL DISTANCE BETWEEN FIRE EXTINGUISHERS IS NOT TO EXCEED 75 FEET.

ALLOWABLE AREA

ALLOWABLE NUMBER OF FLOORS - 2 STORIES
 ALLOWABLE AREA PER FLOOR - 13,500 SF

ALLOWABLE HEIGHT - 40 FT

Gross Building Area	
Name	Area
First Floor	3364 SF
	3364 SF
Number of Floors - 1	
Actual Height - 11'-11 1/8"	

EXIT ACCESS AND EGRESS

300 FT. MAX TRAVEL DISTANCE

ILLUMINATED EXIT SIGNS SHALL BE PROVIDED FOR EGRESS DOORS

DOORS SHALL PROVIDE MINIMUM CLEAR WIDTH OF 32 INCHES

EGRESS ILLUMINATION OF 1 FOOTCANDLE SHALL BE PROVIDED

LIFE SAFETY NOTES:


1. FOR EXIT LIGHTS AND EMERGENCY LIGHTING, SEE ELECTRICAL LIGHTING DRAWINGS (E SERIES).

LIFE SAFETY SYMBOLS:

EXIT DOOR TAG

- A PROVIDED CLEAR DOOR WIDTH (INCHES)
- B OCCUPANT LOAD CAPACITY (NO. OF PEOPLE)

LINE TYPES FOR MEANS OF EGRESS:

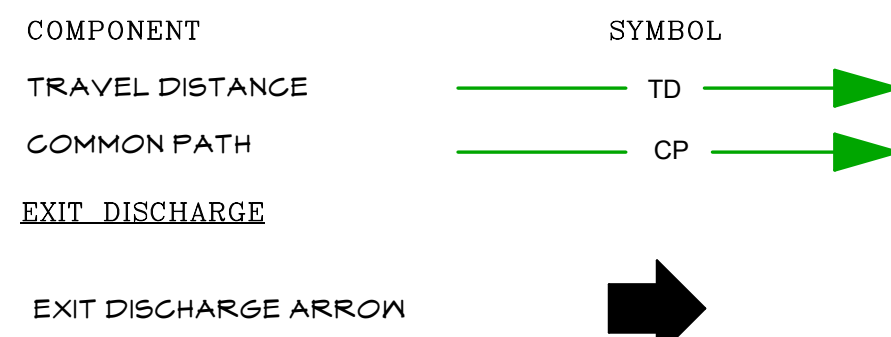

IBC 2024 Occupancy Loads by Room					
Rm#	Room Name	Area	Function of Space	Load Factor	Occupants
FIRST FLOOR					
100	GARAGE	3196 SF	Parking Garage - Low Hazard	300 SF	1.1
FIRST FLOOR					
	Grand total				1.1

NOTE: BUILDING IS A FLEET VEHICLE STORAGE GARAGE, NOT A PUBLIC PARKING STRUCTURE. OCCUPANT LOAD CALCULATED PER S-2 STORAGE, TABLE 1004.1.2


PROJECT DESCRIPTION:

THIS PROJECT INVOLVES THE CONSTRUCTION OF A NEW, SINGLE-STORY POST-FRAME VEHICLE STORAGE BUILDING LOCATED ON THE STATE TRAINING SCHOOL FOR BOYS CAMPUS IN ELDORA, IOWA. THE STRUCTURE MEASURES APPROXIMATELY 82'-6" x 39'-4" (APPROXIMATELY 3,250 SF) AND IS CLASSIFIED AS AN S-2 OCCUPANCY (LOW-HAZARD STORAGE). THE FACILITY IS INTENDED SOLELY FOR THE STORAGE OF SCHOOL FLEET VEHICLES AND IS UNMANNED, WITH LIMITED AND INFREQUENT STAFF ACCESS.

STAFF PERSONNEL WILL DRIVE TO THE SITE, PARK STAFF VEHICLES OUTSIDE, AND THEN USE DESIGNATED SCHOOL FLEET VEHICLES STORED WITHIN THE BUILDING. NO VEHICLE REPAIR, FUELING, OR MAINTENANCE OPERATIONS WILL OCCUR INSIDE THE FACILITY.

THE BUILDING INCLUDES SIX (6) OVERHEAD DOORS, ONE (1) EGRESS DOOR, AND A ROCK INTERIOR FLOOR. THE SPACE IS UNCONDITIONED, WITH NO INSULATION AND NO HEATING OR COOLING SYSTEMS PROVIDED. THE ONLY MECHANICAL SYSTEM INCLUDED IS A VENTILATION EXHAUST SYSTEM INTERLOCKED WITH A TOXIC GAS DETECTION SYSTEM TO MAINTAIN SAFE AIR QUALITY CONDITIONS DURING VEHICLE OPERATION. PLUMBING SYSTEMS ARE NOT PROVIDED. ELECTRICAL SERVICE IS LIMITED TO CODE-REQUIRED LIGHTING AND POWER FOR DOOR OPERATORS.

AT THE SOUTH EGRESS DOOR, A CAST-IN-PLACE CONCRETE STOOP PROVIDES A STABLE EXIT DISCHARGE IMMEDIATELY OUTSIDE THE DOORWAY. THE STOOP TRANSITIONS DIRECTLY TO THE SITE SURFACE CONSISTING OF GRASS AND GRAVEL. WITH NO ADDITIONAL PAVING PROPOSED, THE GRASS AND GRAVEL SURFACES PROVIDE A STABLE AND UNOBSTRUCTED MEANS OF EGRESS TO GRADE CONSISTENT WITH THE LIMITED-USE, UNMANNED NATURE OF THE BUILDING.

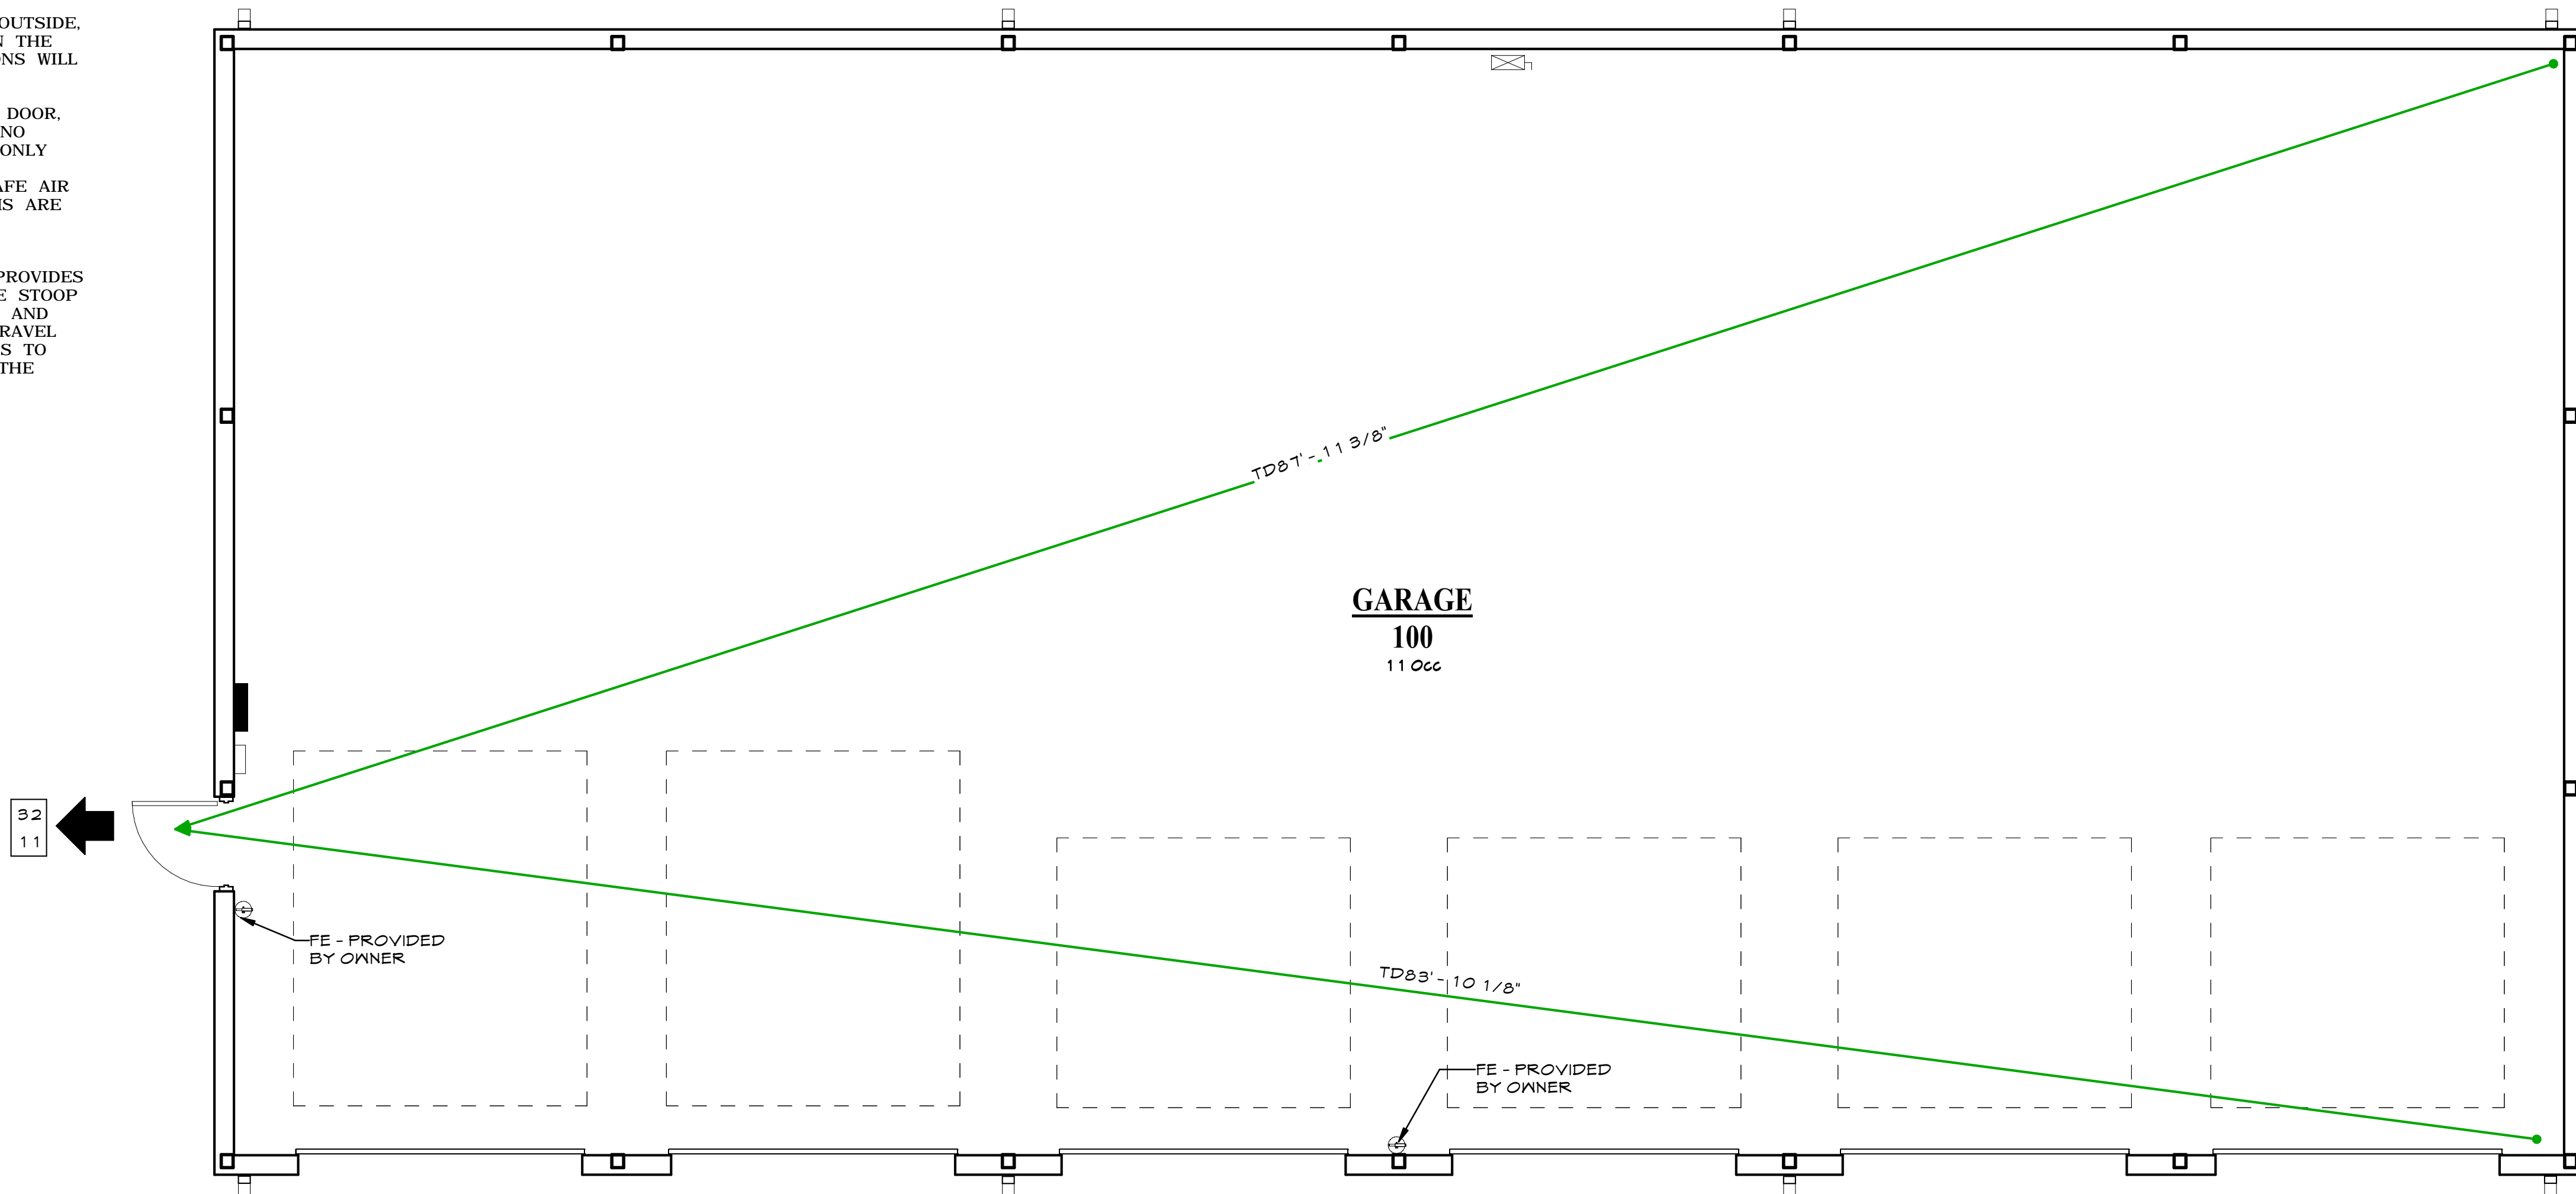

1 CODE FLOOR PLAN
 SCALE: 1/4" = 1'-0"



hgm ASSOCIATES INC.
 ENGINEERING ARCHITECTURE SURVEYING
 council bluffs omaha

This drawing is being made available for use on this project in accordance with the terms of the professional services agreement between HGM Associates Inc. and the client. HGM Associates Inc. assumes no liability for any use of this drawing for any purpose other than that intended, except in accordance with the terms of the above agreement.

Rev#	Date
HGM	
drawn	
HGM	
designed	
HGM	
approved	
10-10-25	date


project **HHS STS NEW GARAGE BLDG**
 3211 Edgington Ave, Eldora, IA 50027
 client
 sheet **CODE PLAN**

project no. **106025**
9476.00
 sheet
G1.3

10/9/2025 3:07:16 PM \\SRV28\Users\hjk\Documents\106025 IDAS STS Garage RVT24_hkjeldgaard.rvt

FILENAME: S:\ARCH\Projects\106025 DAS HHS STS New Garage Bldg\CIVIL_Engineering\Drawings\Design\106025 DESIGN.dwg
 DRAWN BY: jns, SAVE DATE: Oct 9, 2025 10:39 AM, DATE PLOTTED: 10/9/2025 2:28 PM, PLOT SCALE: 1:1

IOWA
ONE CALL

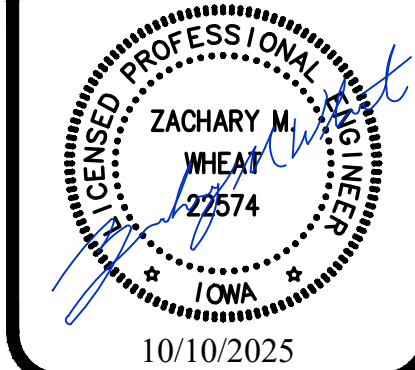


hgm
ASSOCIATES INC.
 ENGINEERING ARCHITECTURE SURVEYING
 council bluffs omaha

This drawing is to be used only for the project and site conditions shown. It is not to be used for any other project or site conditions without the written consent of hgm Associates Inc. hgm Associates Inc. assumes no liability for any errors or omissions in this drawing or any part thereof except in accordance with the terms of the above agreement.


date	revision	date
10-10-25		

project **HHS STS NEW GARAGE BLDG**
 client **IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES**
 sheet **TOPOGRAPHIC SURVEY**

project no. **106025**
 sheet **C1.0**

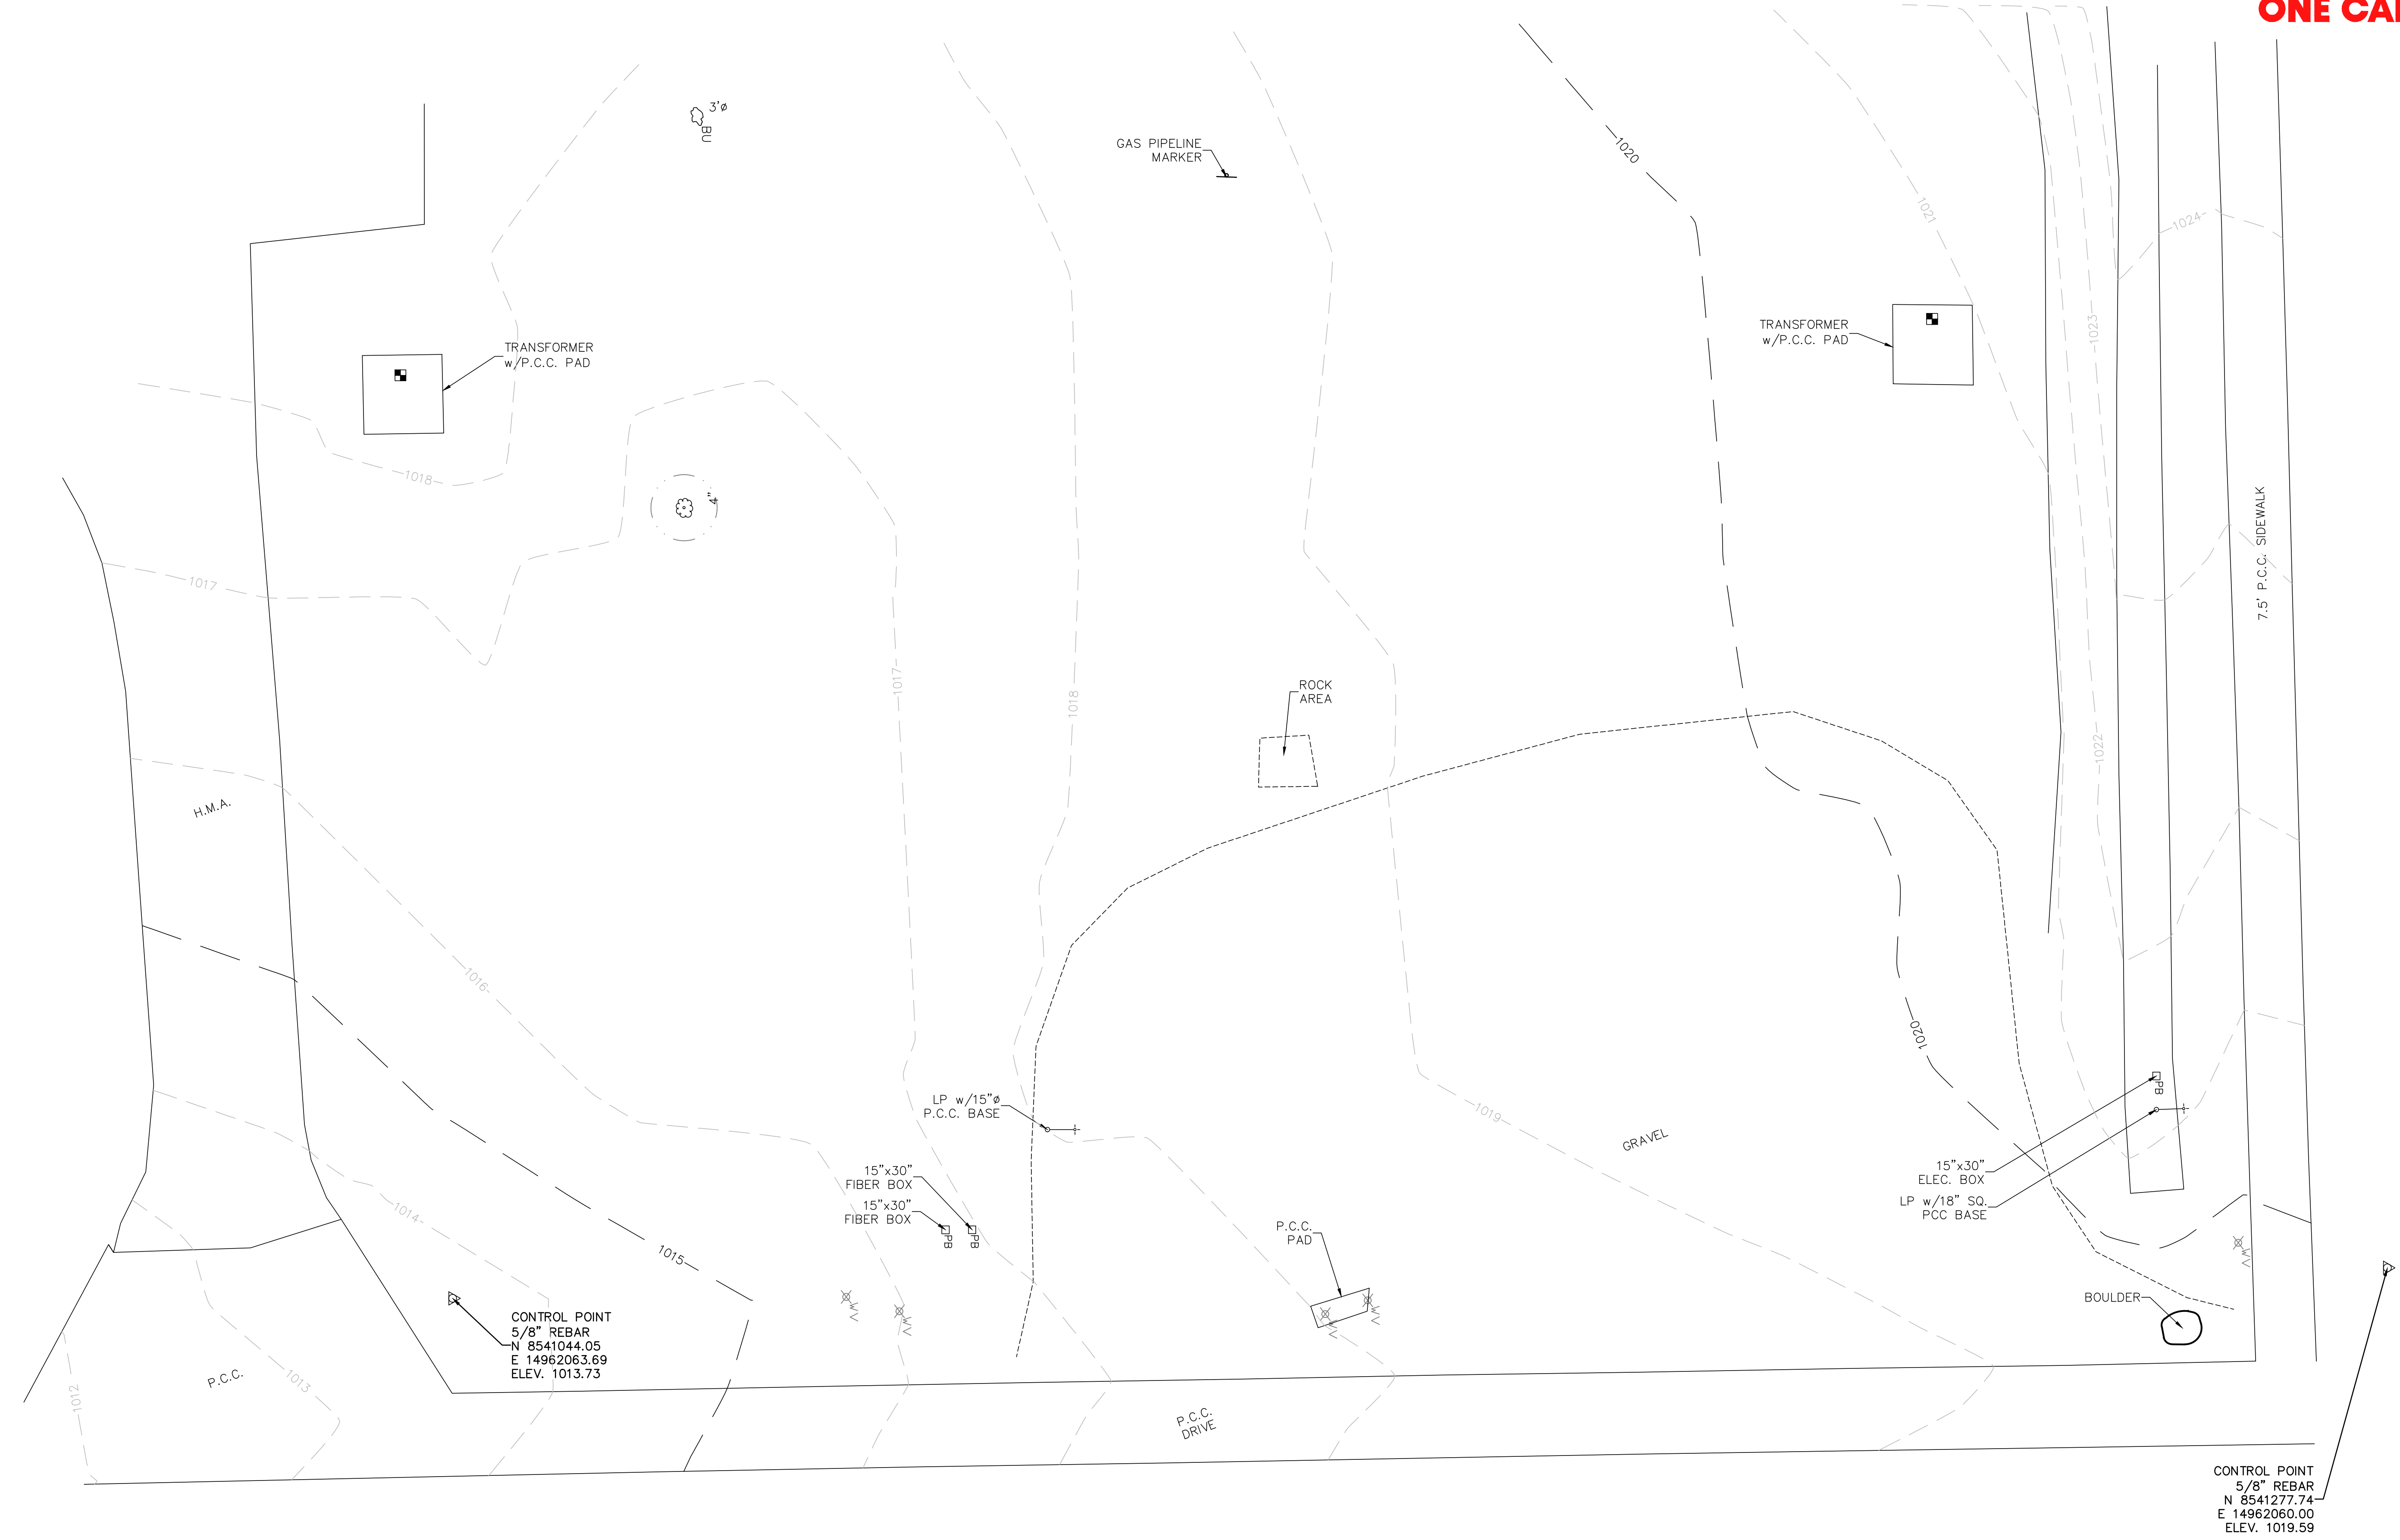


CONTROL POINT
 5/8" REBAR
 N 8541277.74
 E 14962060.00
 ELEV. 1019.59

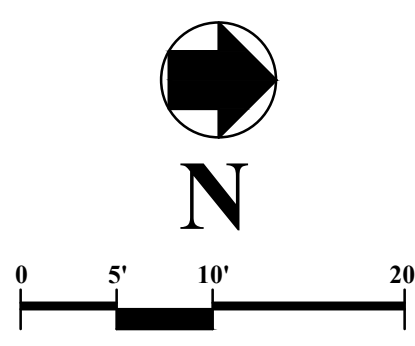

1 TOPOGRAPHIC SURVEY
 SCALE: 1" = 10'-0"

FILENAME: S:\ARCH\Projects\106025 DAS HHS STS New Garage Bldg\CIVIL_Engineering\Draws\Design\106025 DESIGN.dwg
 DRAWN BY: jns, SAVE DATE: Oct 9, 2025 10:39 AM, DATE PLOTTED: 10/9/2025 2:29 PM, PLOT SCALE: 1:1

IOWA ONE CALL

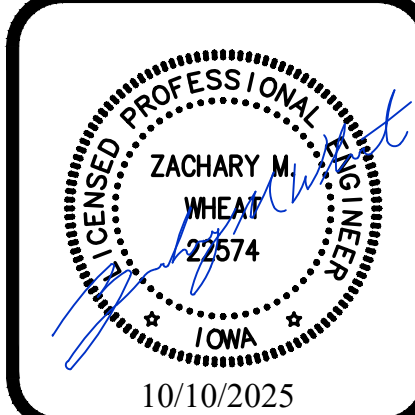


hgm ASSOCIATES INC.
 ENGINEERING ARCHITECTURE SURVEYING
 council bluffs omaha

This drawing is being made available by hgm associates inc. for use on this project in accordance with hgm associates inc. assumes no liability for any past, present or future errors or omissions except in accordance with the terms of the above agreement.


date	revision	date
JNS	drawn	
ZMW	designed	
ZMW	approved	10-10-25

project **HHS STS NEW GARAGE BLDG**
 client **IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES**
 sheet **CIVIL SITE PLAN**

project no. **106025**
 sheet **C2.0**

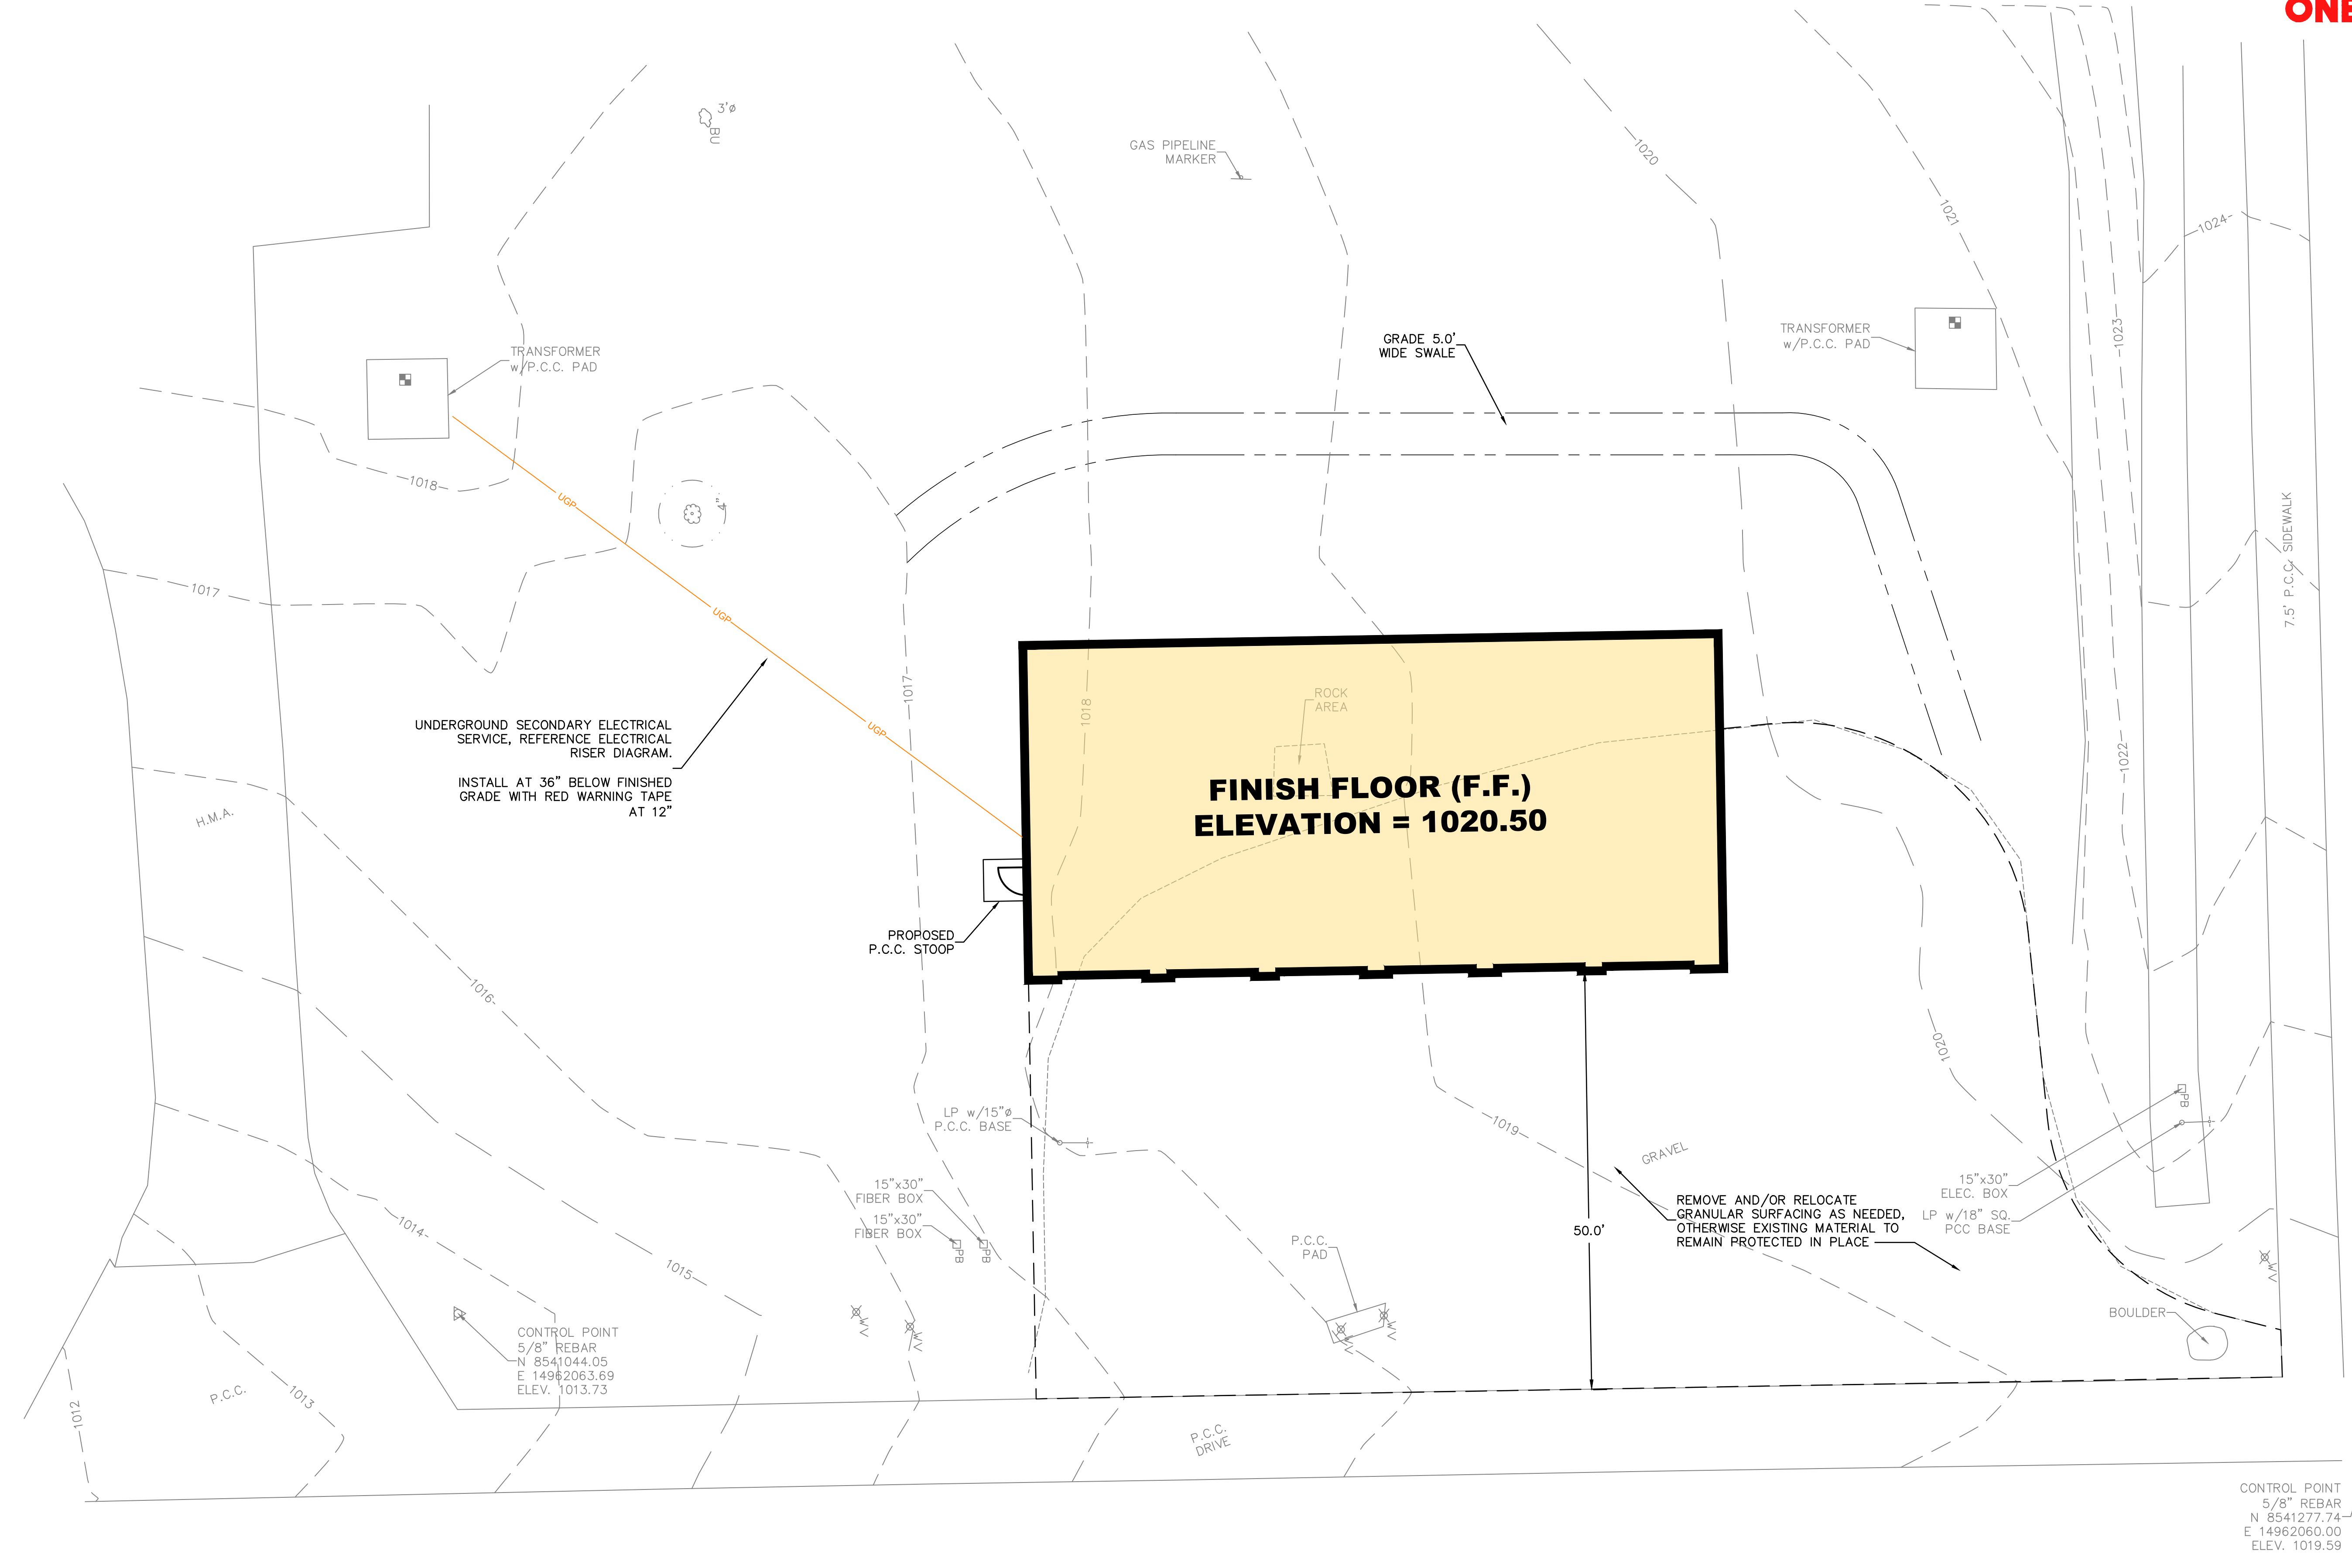

1 CIVIL SITE PLAN
 SCALE: 1" = 10'-0"

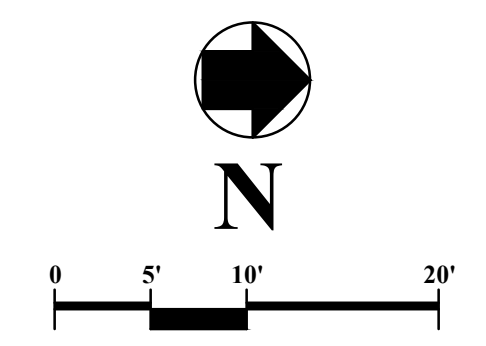

CONTROL POINT
 5/8" REBAR
 N 8541277.74
 E 14962060.00
 ELEV. 1019.59


10/9/2025 3:07:32 PM \\SRV28\Users\hjk\Documents\106025 IDAS STS Garage RVT24_hkjeldgaard.rvt

DOOR SCHEDULE											
DOOR NUMBER	ROOM	DOOR					FRAME			FIRE RATING	NOTES
		SIZE (WxHxT)	TYPE	MAT'L	FINISH	TYPE	MAT'L	FINISH			
100A	GARAGE	3'-0" x 7'-0" x 1 3/4"	F	HM	PRIMED	F1	HM	PAIN	-	NOTES 1 & 2	
100B	GARAGE	10'-0" x 12'-0" x 2"	OH	-	PFN	-	-	-	-	-	
100C	GARAGE	10'-0" x 12'-0" x 2"	OH	-	PFN	-	-	-	-	-	
100D	GARAGE	10'-0" x 9'-0" x 2"	OH	-	PFN	-	-	-	-	-	
100E	GARAGE	10'-0" x 9'-0" x 2"	OH	-	PFN	-	-	-	-	-	
100F	GARAGE	10'-0" x 9'-0" x 2"	OH	-	PFN	-	-	-	-	-	
100G	GARAGE	10'-0" x 9'-0" x 2"	OH	-	PFN	-	-	-	-	-	

NOTES:
 1. DOOR PAINT BY OWNER
 2. LOCKSET PROVIDED BY OWNER AND INSTALLED BY CONTRACTOR, HINGES PROVIDED AND INSTALLED BY CONTRACTOR

MATERIAL NOTES:

- METAL WALL PANELS SHALL BE IN THE COLOR SIERRA TAN.
- METAL ROOF PANELS SHALL BE IN THE COLOR WHITE.
- SOFFITS, GUTTERS, AND DOWNSPOUTS SHALL BE IN THE COLOR WHITE.
- METAL WALL PANELS SHALL BE 29 GA
- METAL ROOF PANELS SHALL BE 26 GA MIN

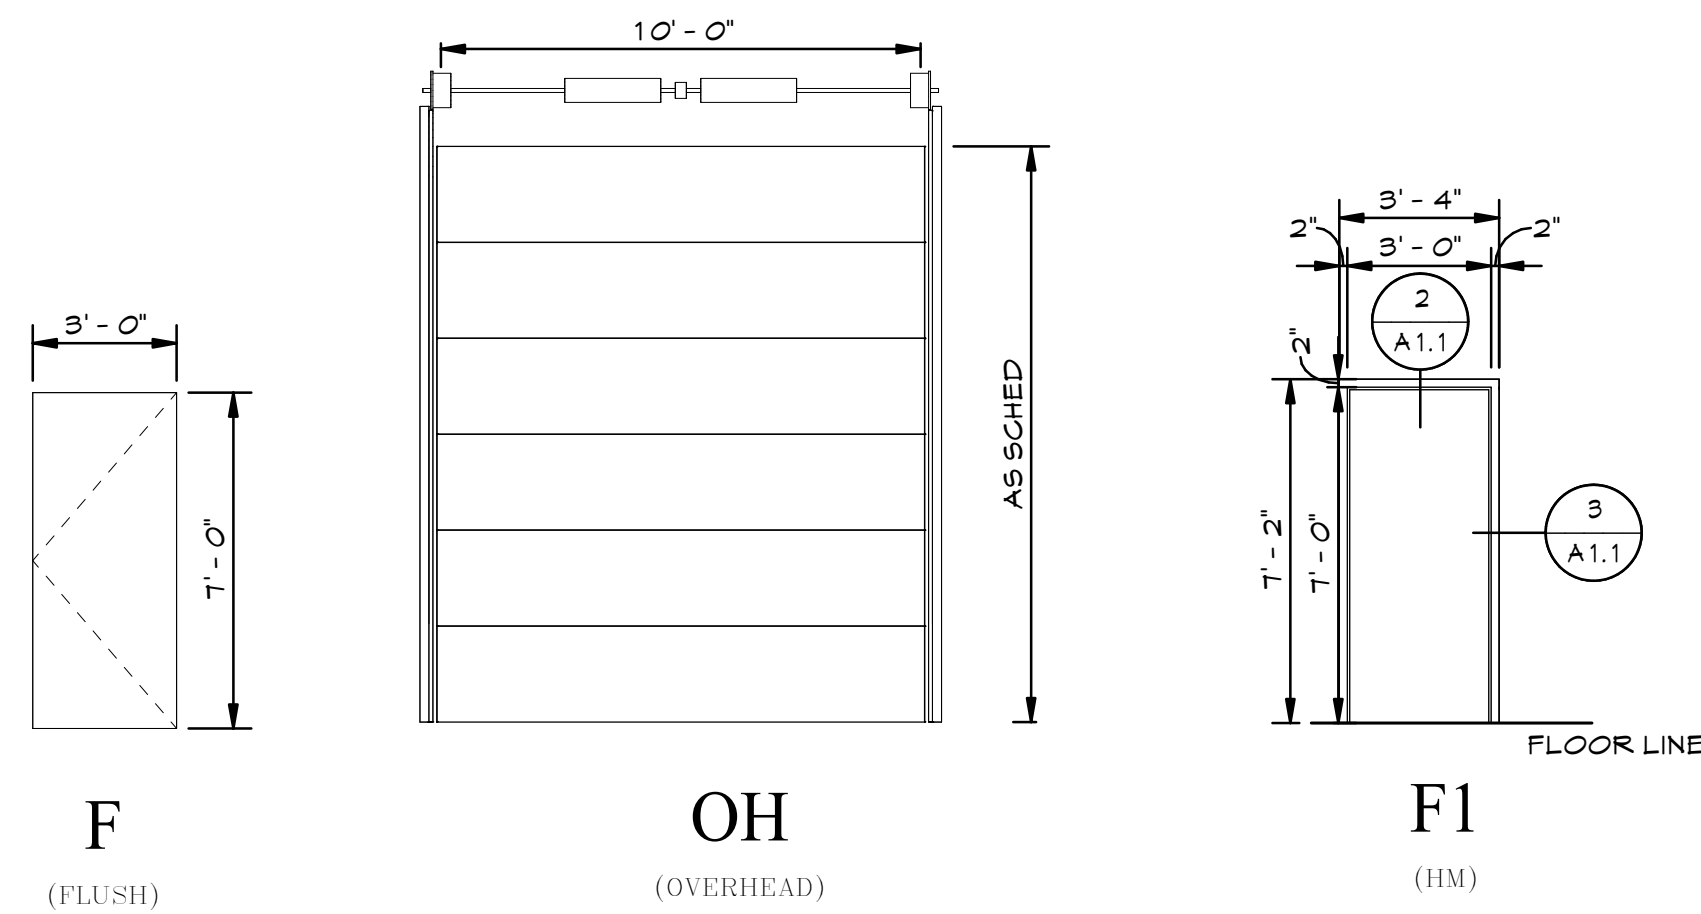



DOOR TYPES
SCALE: 1/4" = 1'-0"

DOOR FRAME TYPES
SCALE: 1/4" = 1'-0"


FLOOR PLAN NOTES:

- DIMENSIONS SHOWN ON FLOOR PLANS ARE TO CENTER LINE OF COLUMNS UNLESS OTHERWISE NOTED. WRITTEN DIMENSIONS TAKE PRECEDENCE OVER DRAWINGS SCALE.
- DOWNSPOUTS, GUTTERS AND SPLASHBLOCKS SHALL BE SUBMITTED AS AN ALTERNATE. IF ALTERNATE IS ACCEPTED: DOWNSPOUTS OUTLET TO GRADE, PROVIDE SPLASHBLOCK.
- DOOR 100A LOCKSET SHALL BE PROVIDED BY OWNER AND INSTALLED BY CONTRACTOR. CONTRACTOR SHALL SUPPLY TEMPORARY LOCKSET DURING CONSTRUCTION AND SHALL COORDINATE FINAL LOCKSET INSTALL WITH OWNER.

WALL TYPE LEGEND

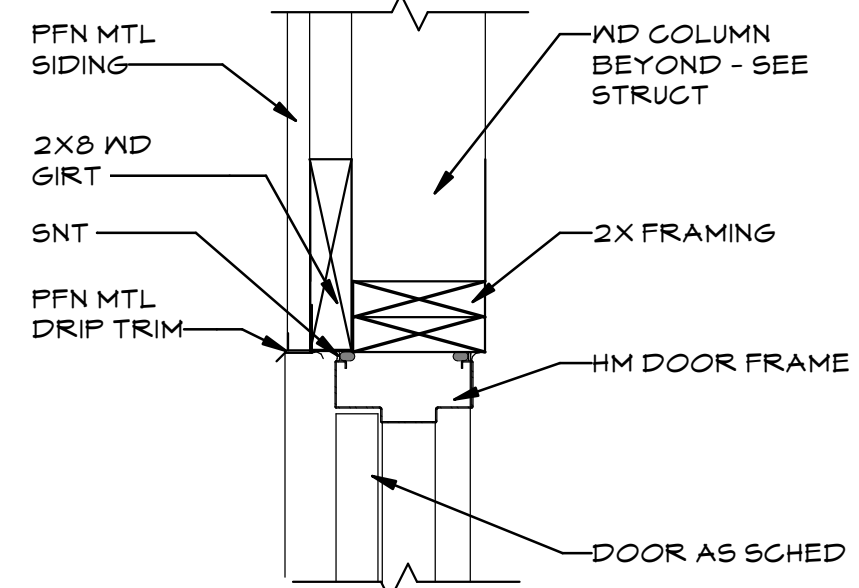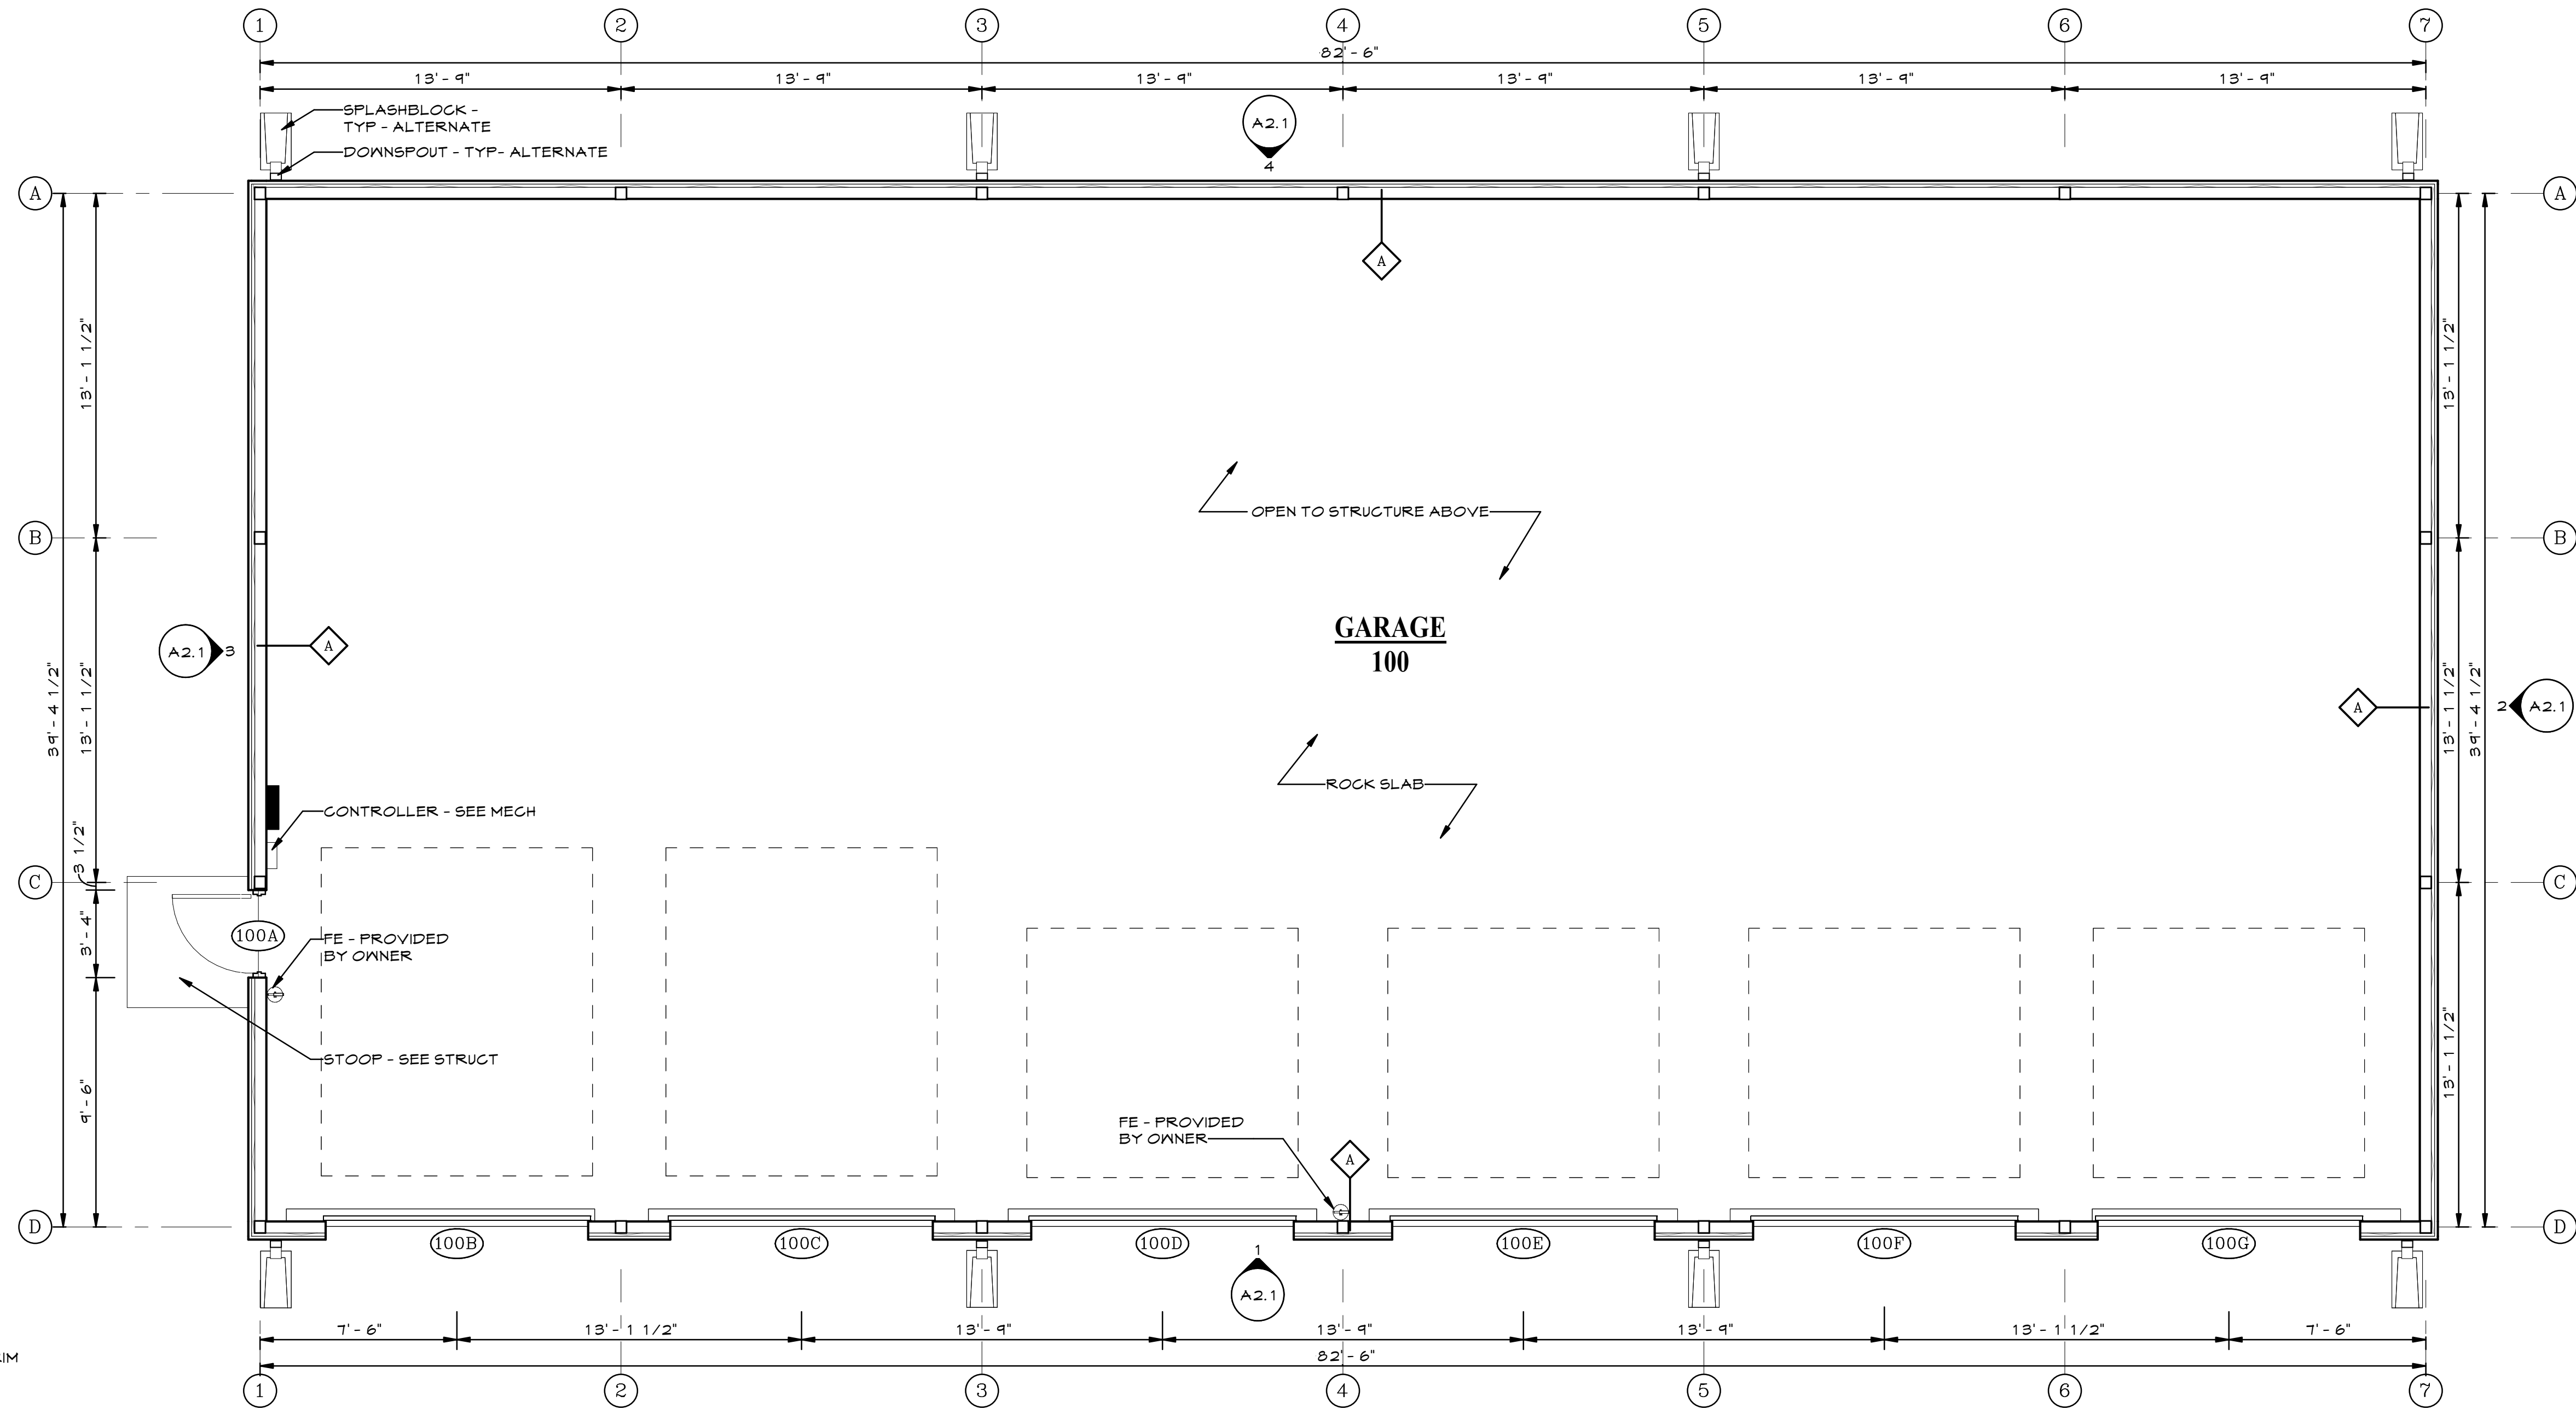


2 HM DOOR HEAD
SCALE: 1 1/2" = 1'-0"

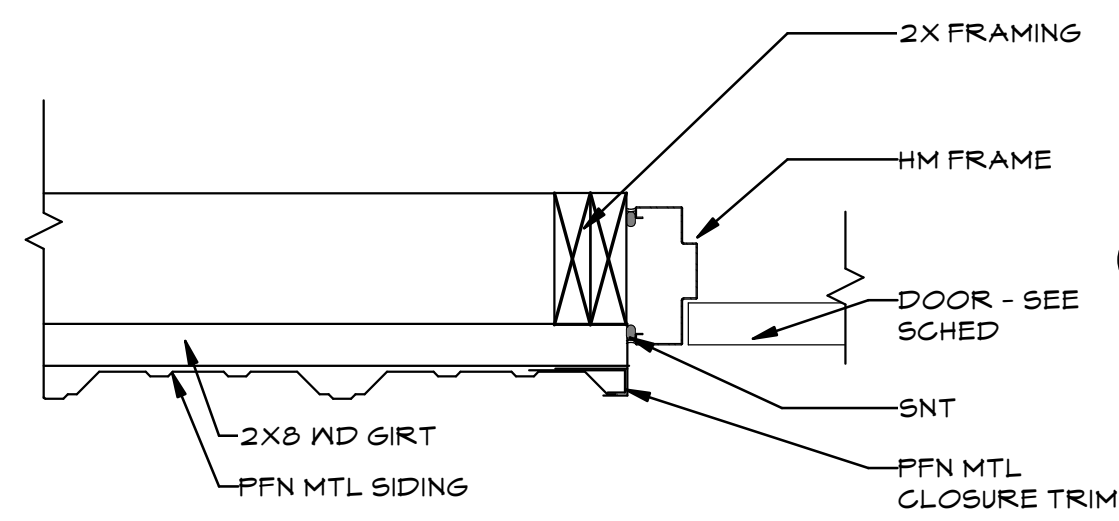

3 HM DOOR JAMB
SCALE: 1 1/2" = 1'-0"

1 FLOOR PLAN
SCALE: 1/4" = 1'-0"
NORTH

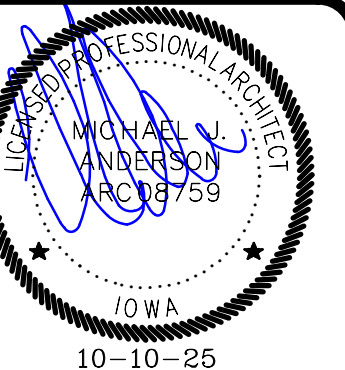

hgm ASSOCIATES INC.
ENGINEERING ARCHITECTURE SURVEYING
councilbluffs omaha


This drawing is being made in accordance with the professional seal of HGM Associates Inc. HGM Associates Inc. assumes no liability for any use of this drawing except in accordance with the terms of the above agreement.

Rev#	Date
HGM drawn	
HGM designed	
HGM approved	
10-10-25	date


HHS STS NEW GARAGE BLDG
3211 Edgington Ave, Eldora, IA 50027
project no. 106025
client 9476.00
sheet A1.1

A1.1

10/9/2025 3:07:45 PM \\SRV28\Users\hjk\Documents\106025 IDAS STS Garage RVT24_hkjeldgaard.rvt

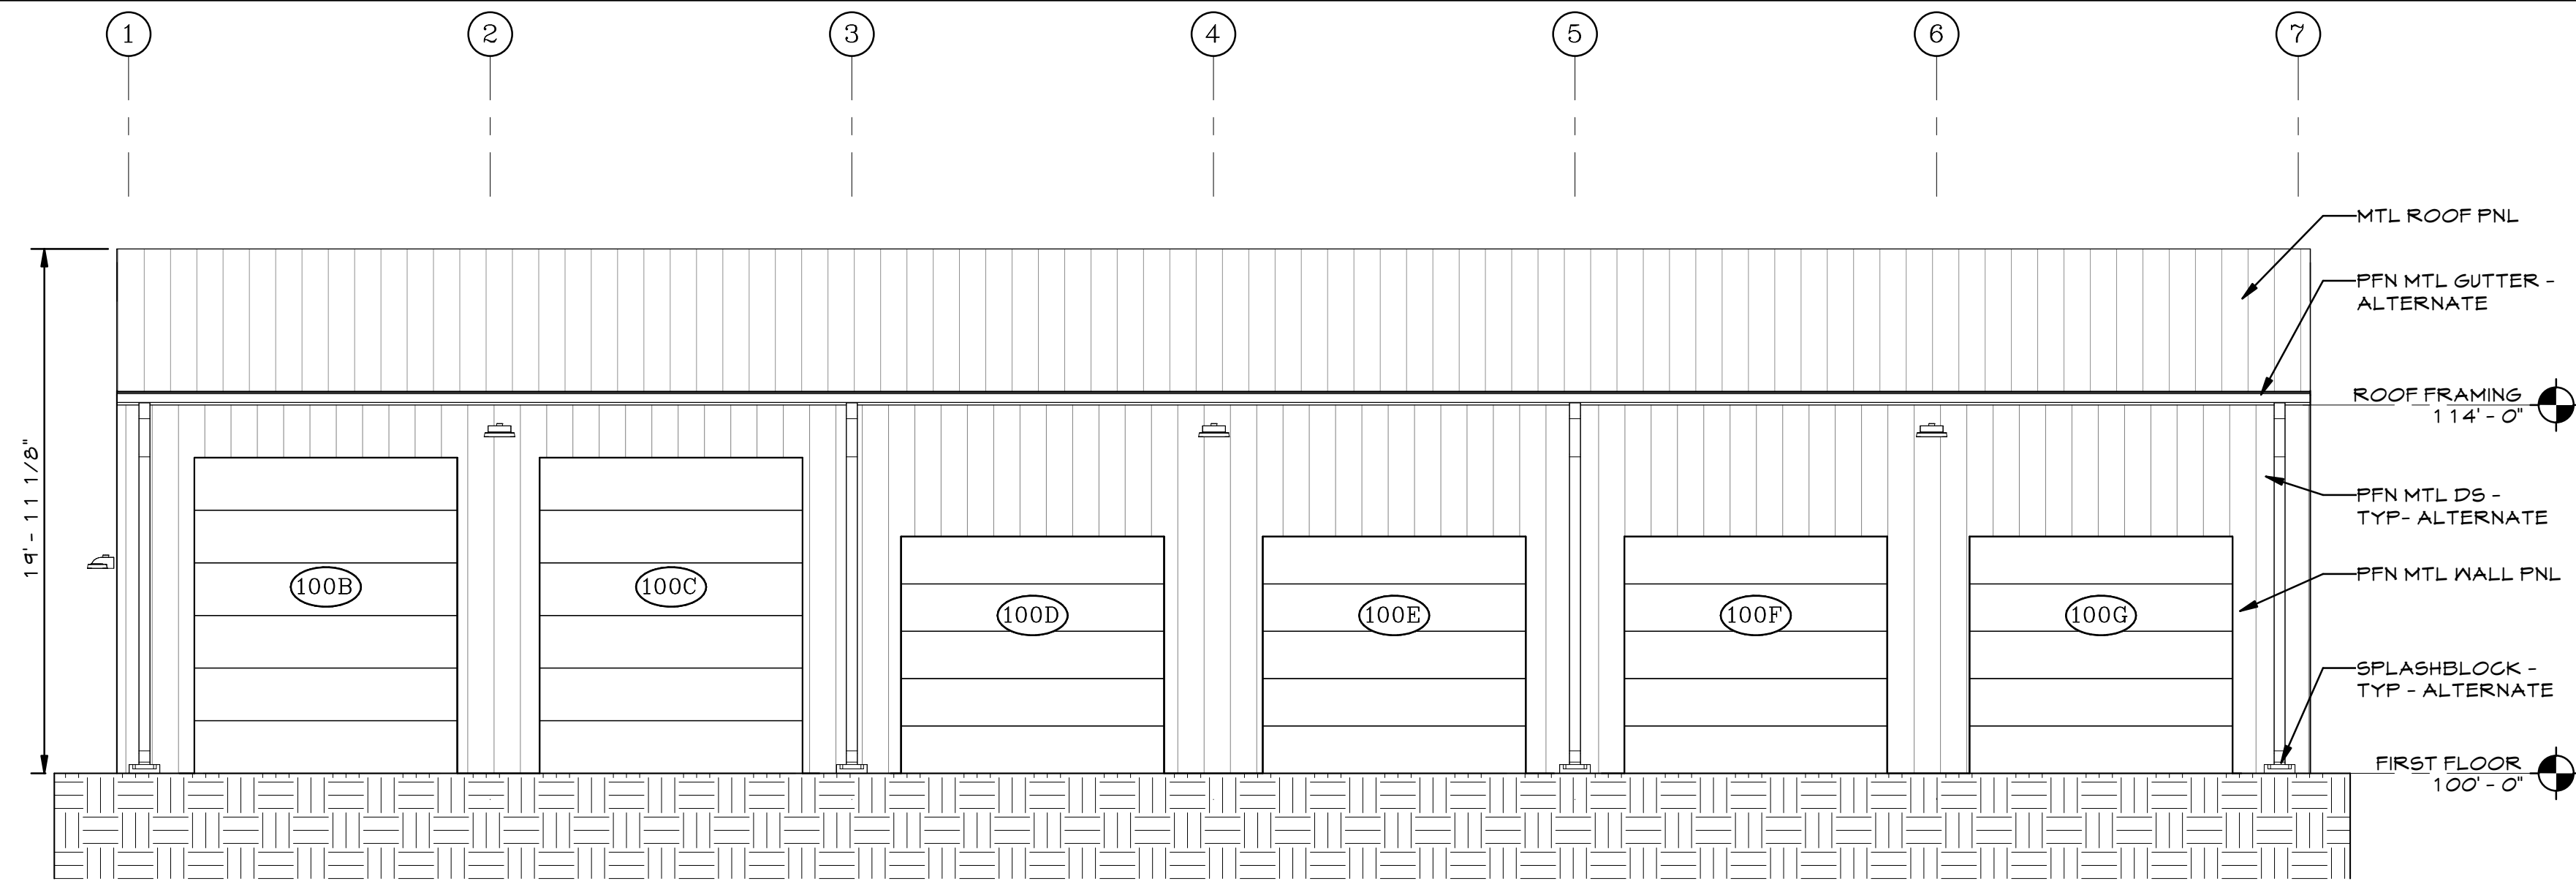


1 EAST ELEVATION
SCALE: 3/16" = 1'-0"

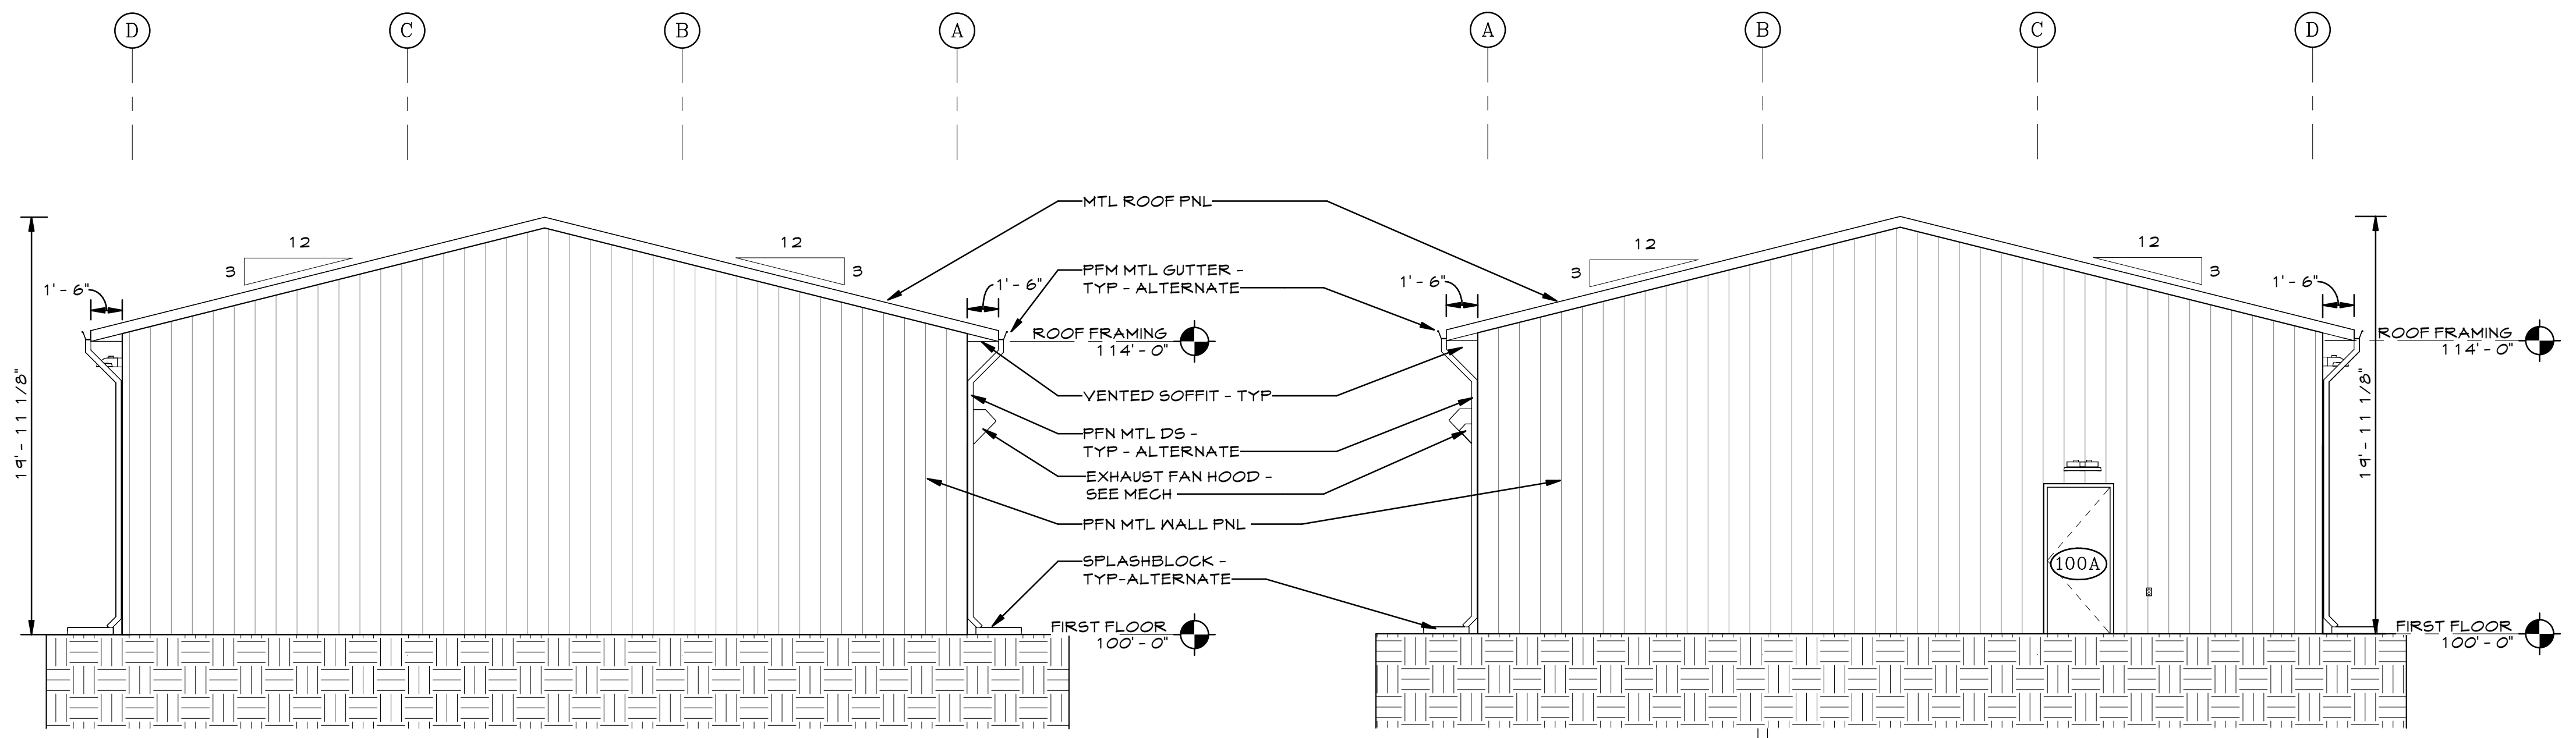


2 SOUTH ELEVATION
SCALE: 3/16" = 1'-0"

3 NORTH ELEVATION
SCALE: 3/16" = 1'-0"

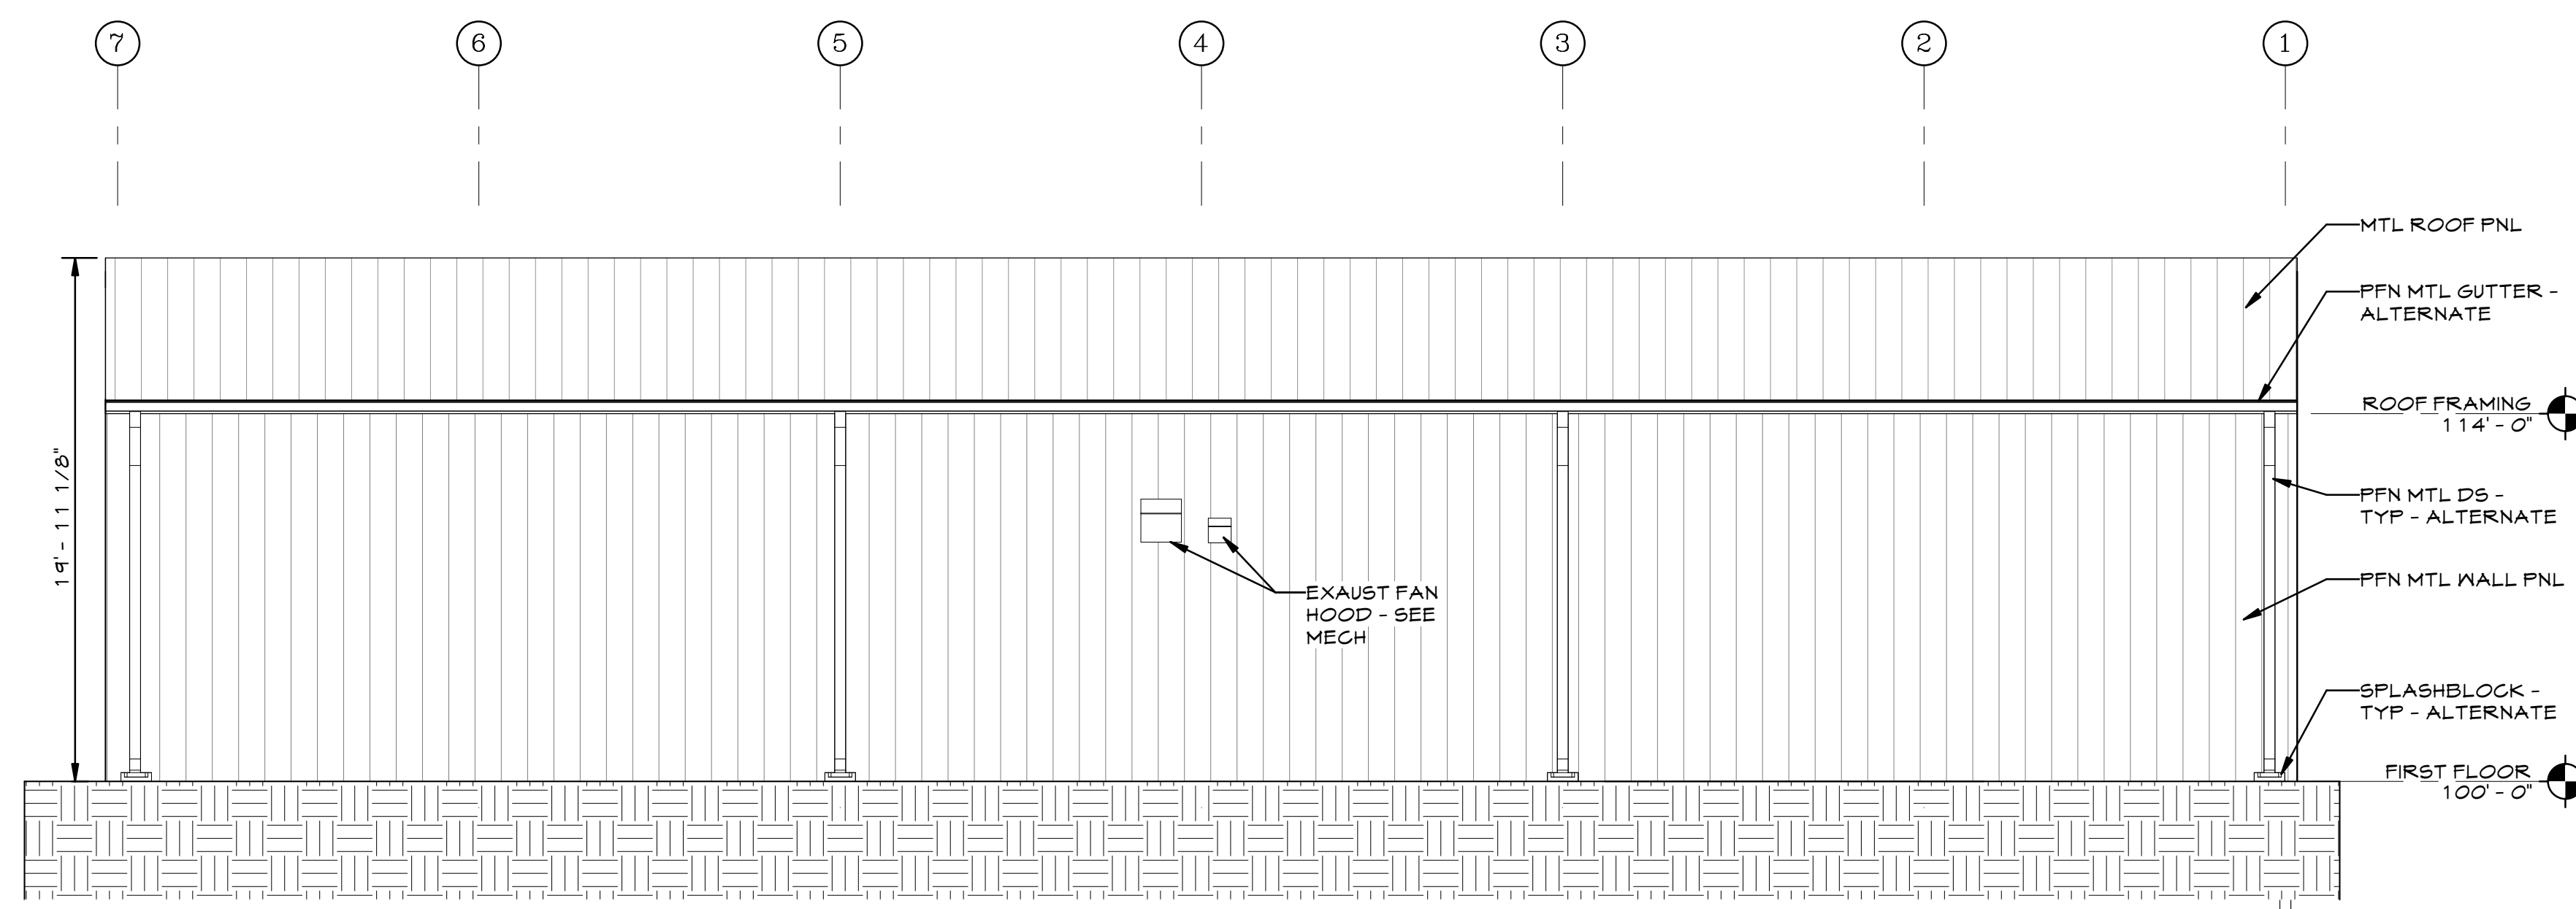

4 WEST ELEVATION
SCALE: 3/16" = 1'-0"

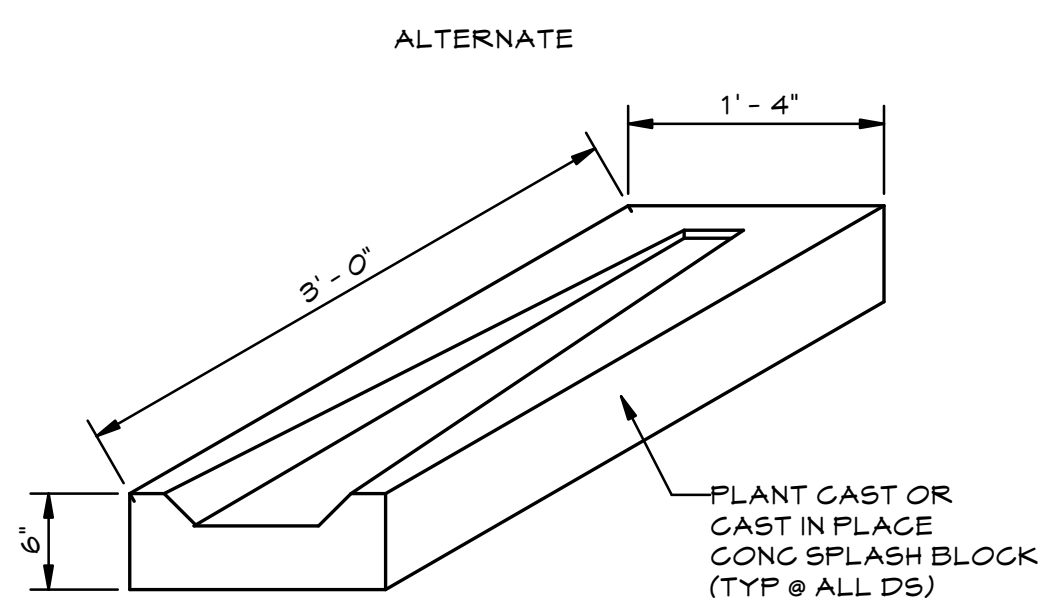

5 SPLASH BLOCK
SCALE: 1" = 1'-0"



hgm
ASSOCIATES INC.
ENGINEERING ARCHITECTURE SURVEYING
councilbluffs omaha

This drawing is being made available for your review in accordance with hgm's standard terms of agreement for professional services. hgm associates inc. assumes no liability for any use of this drawing for any purpose except in accordance with the terms of the above agreement.


Rev#	Date
HGM	
drawn	
HGM	
designed	
HGM	
approved	
10-10-25	date

HHS STS NEW GARAGE BLDG
3211 Edgington Ave, Eldora, IA 50027
project client sheet

project no. **106025**
sheet no. **9476.00**
A2.1


EXTERIOR ELEVATIONS

10/8/2025 10:53:59 AM S:\250824\Rvt_24\106025 IDAS Garage_STRUCT_RVT24_mlibov@performance.com.rvt

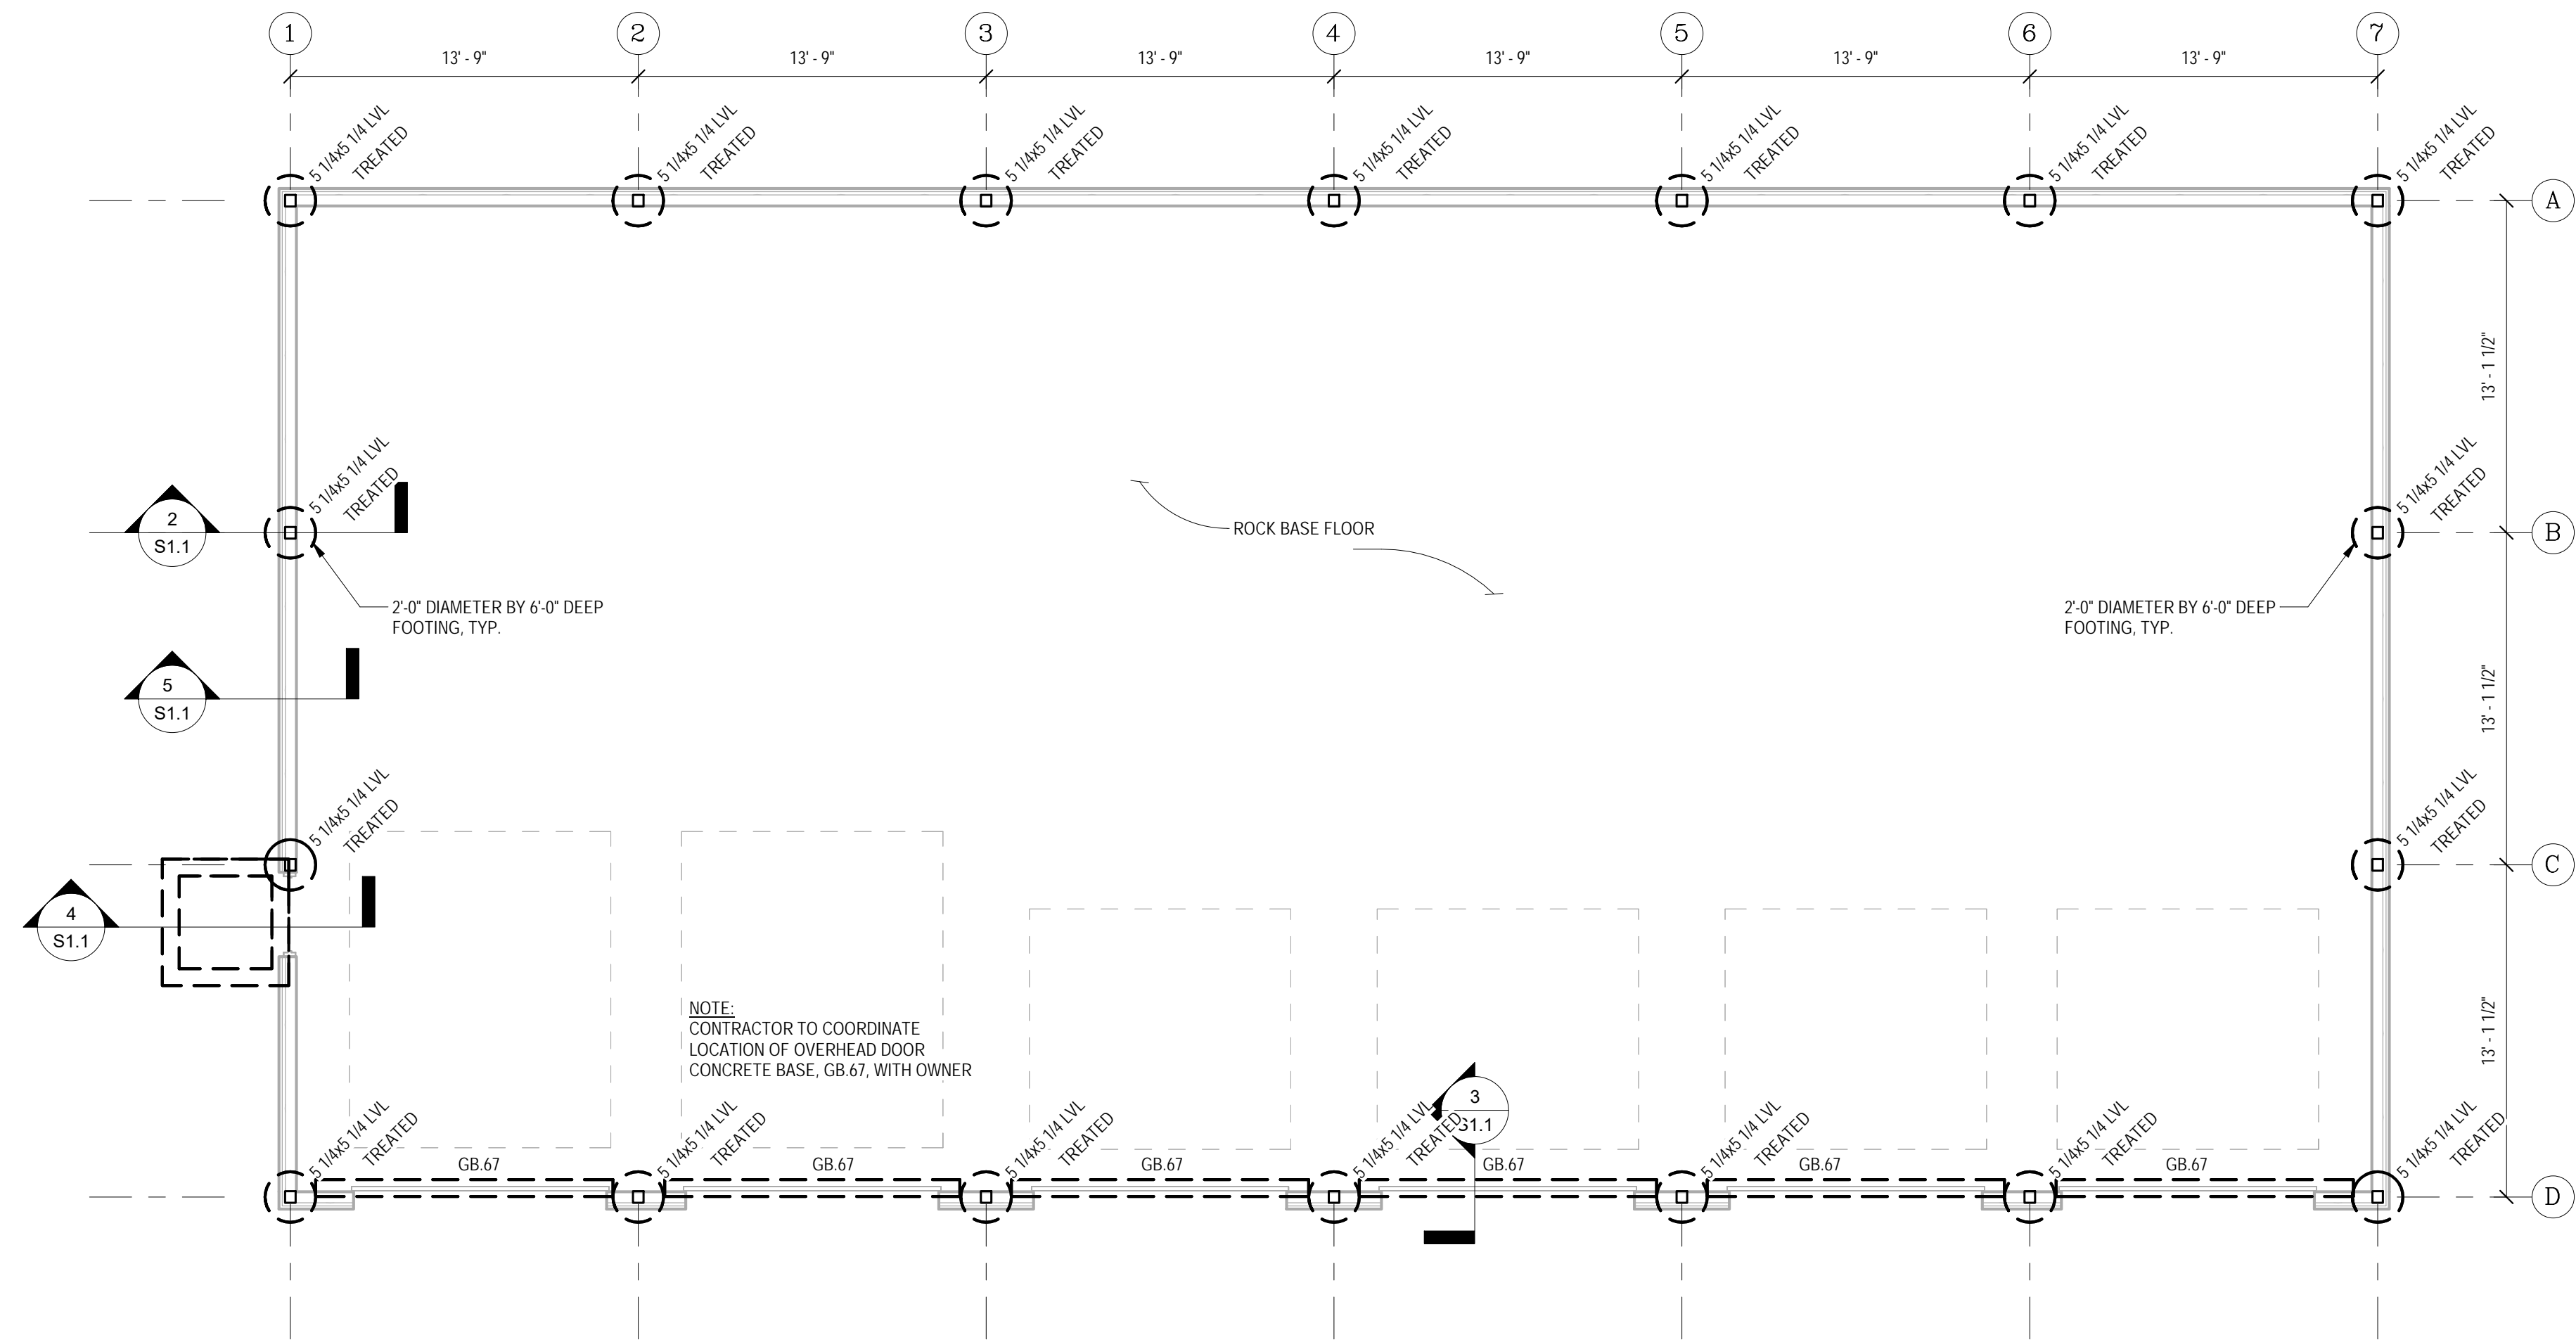


NOTES:
 T.O. 4" ROCK BASE EL - 100'-0", U.N.O.
 T.O. FTGL EL - 99'-8", U.N.O.


1 FOUNDATION PLAN
 SCALE: 3/16" = 1'-0"

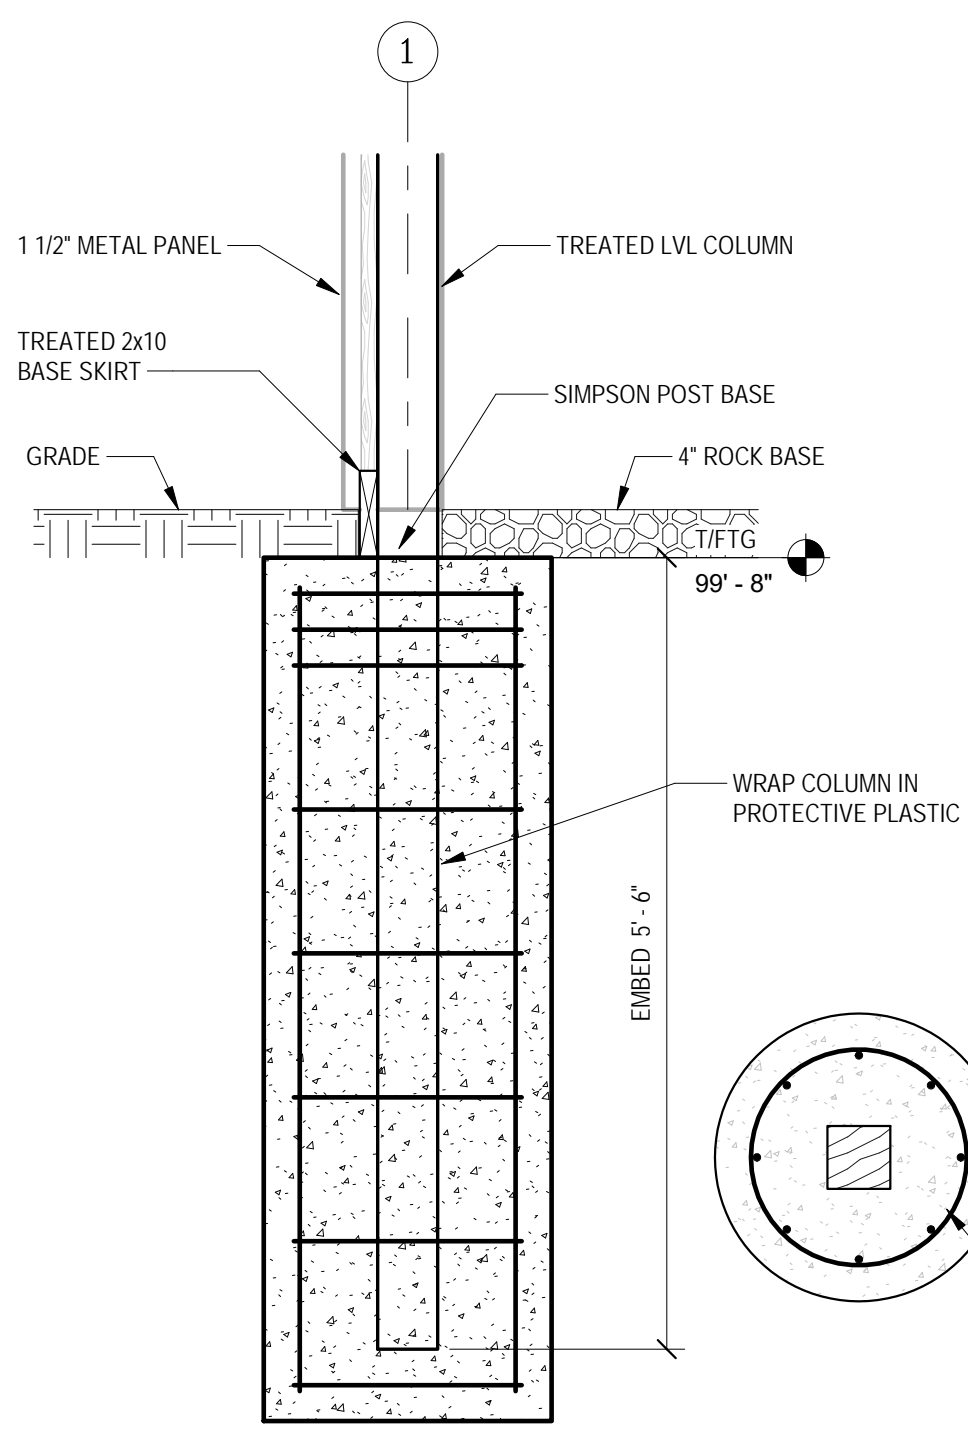


2 FOUNDATION SECTION
 SCALE: 3/4" = 1'-0"

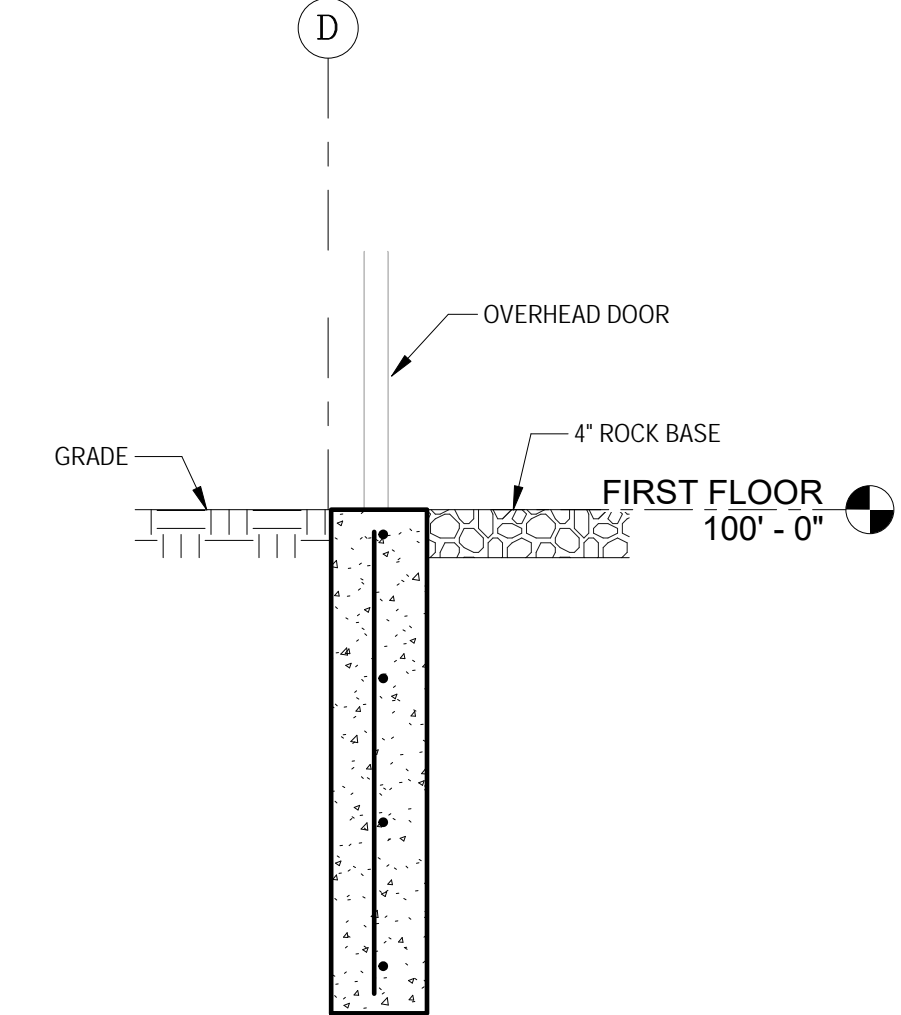

3 SECTION @ OH DOOR
 SCALE: 3/4" = 1'-0"

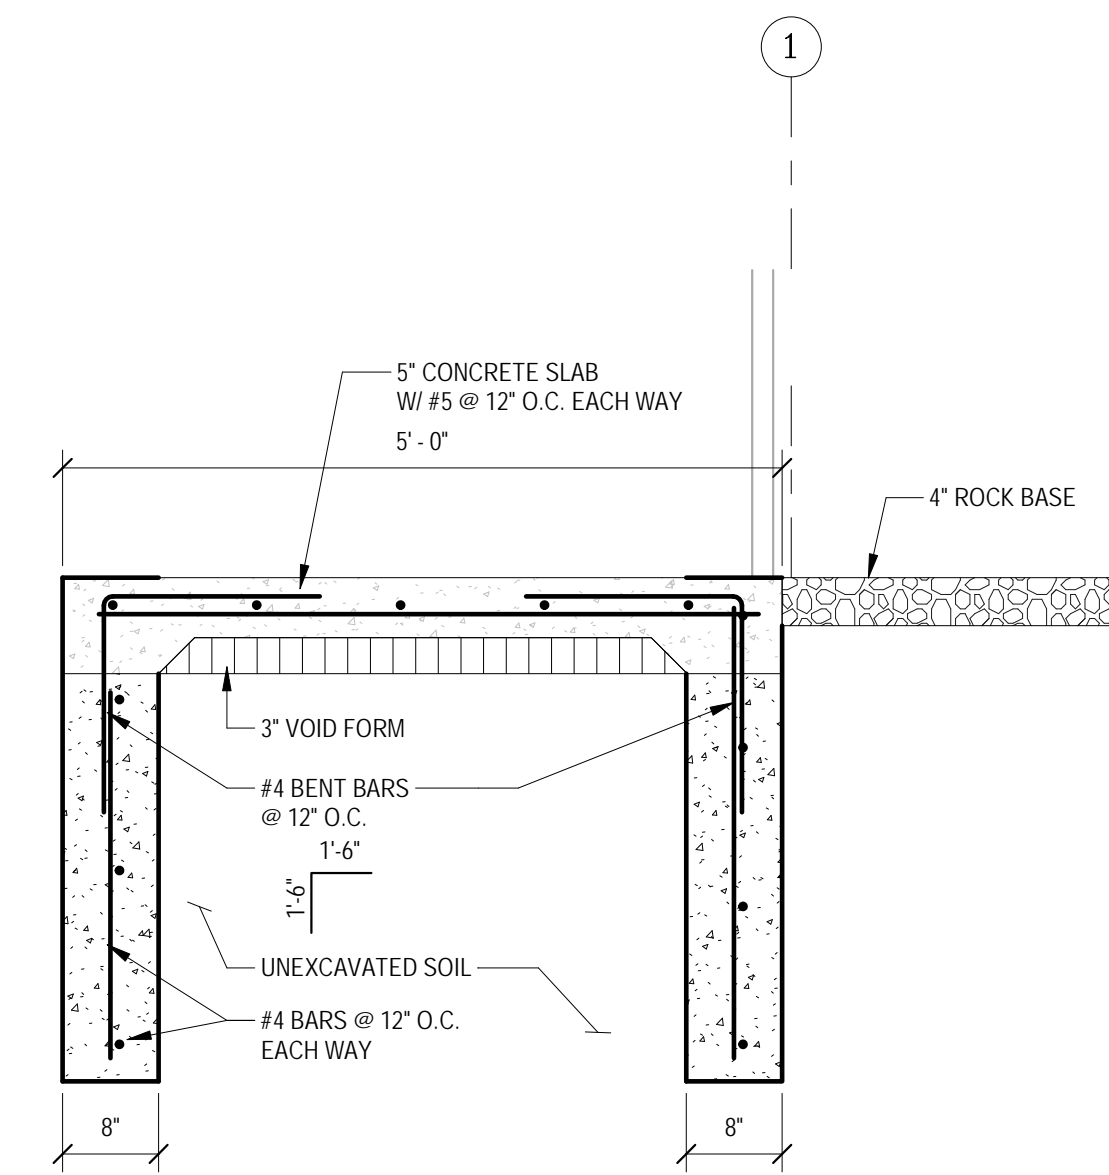


4 STOOP SECTION
 SCALE: 3/4" = 1'-0"

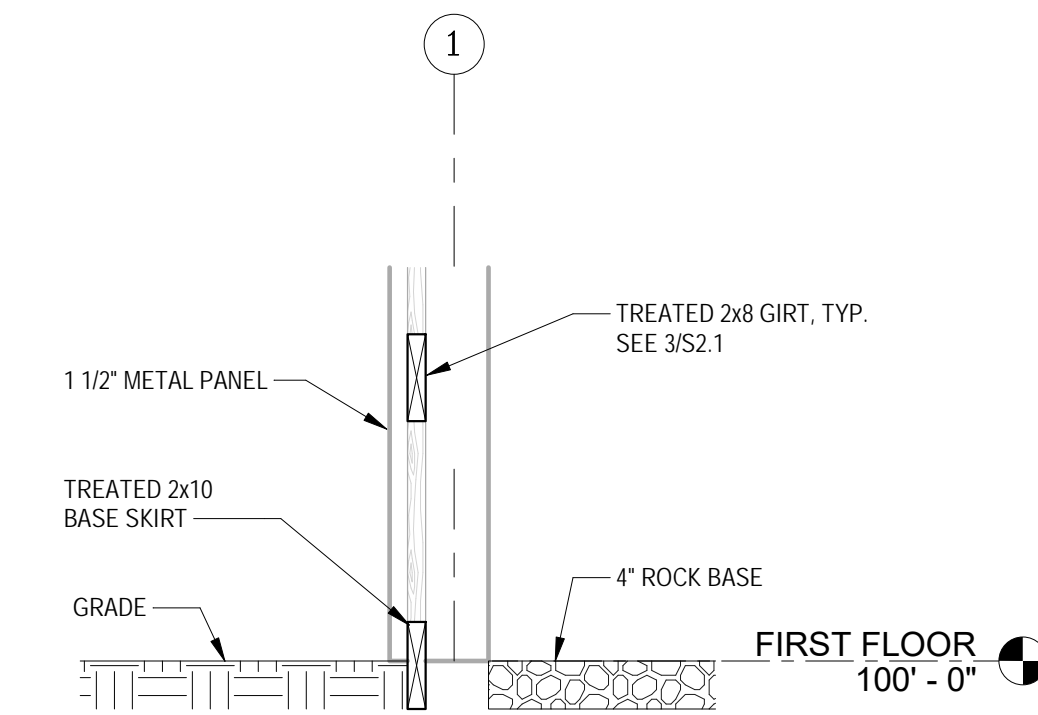

5 FOUNDATION SECTION
 SCALE: 3/4" = 1'-0"

PERFORMANCE Engineering
 11811 Fort Street, Suite 104 - Omaha, NE 68164
 (402) 343-3889
 389 Perry St., Suite 204 - Castle Rock, CO 80104
 (303) 771-3829
 PE # - 250824

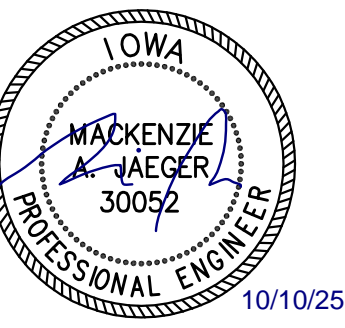

hgm ASSOCIATES INC.
 ENGINEERING ARCHITECTURE SURVEYING
 council bluffs omaha


This drawing is being made available for use by the contractor in accordance with hgm professional services. hgm associates inc. assumes no liability for any use of this drawing except in accordance with the terms of the above agreement.

Rev#	Date
MLL	drawn
MAJ	designed
MAJ	approved
10-10-25	date


HHS STS NEW GARAGE BLDG
 3211 Edgington Ave, Eldora, IA 50027
 project
 client IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES
 sheet **FOUNDATION PLAN & DETAILS**

project no. **106025**
 9476.00
 sheet
S1.1


10/8/2025 11:46:17 AM S:\250824\Rvt_24\106025 IDAS Garage_STRUCT_RVT24_mlibov@performance.com.rvt

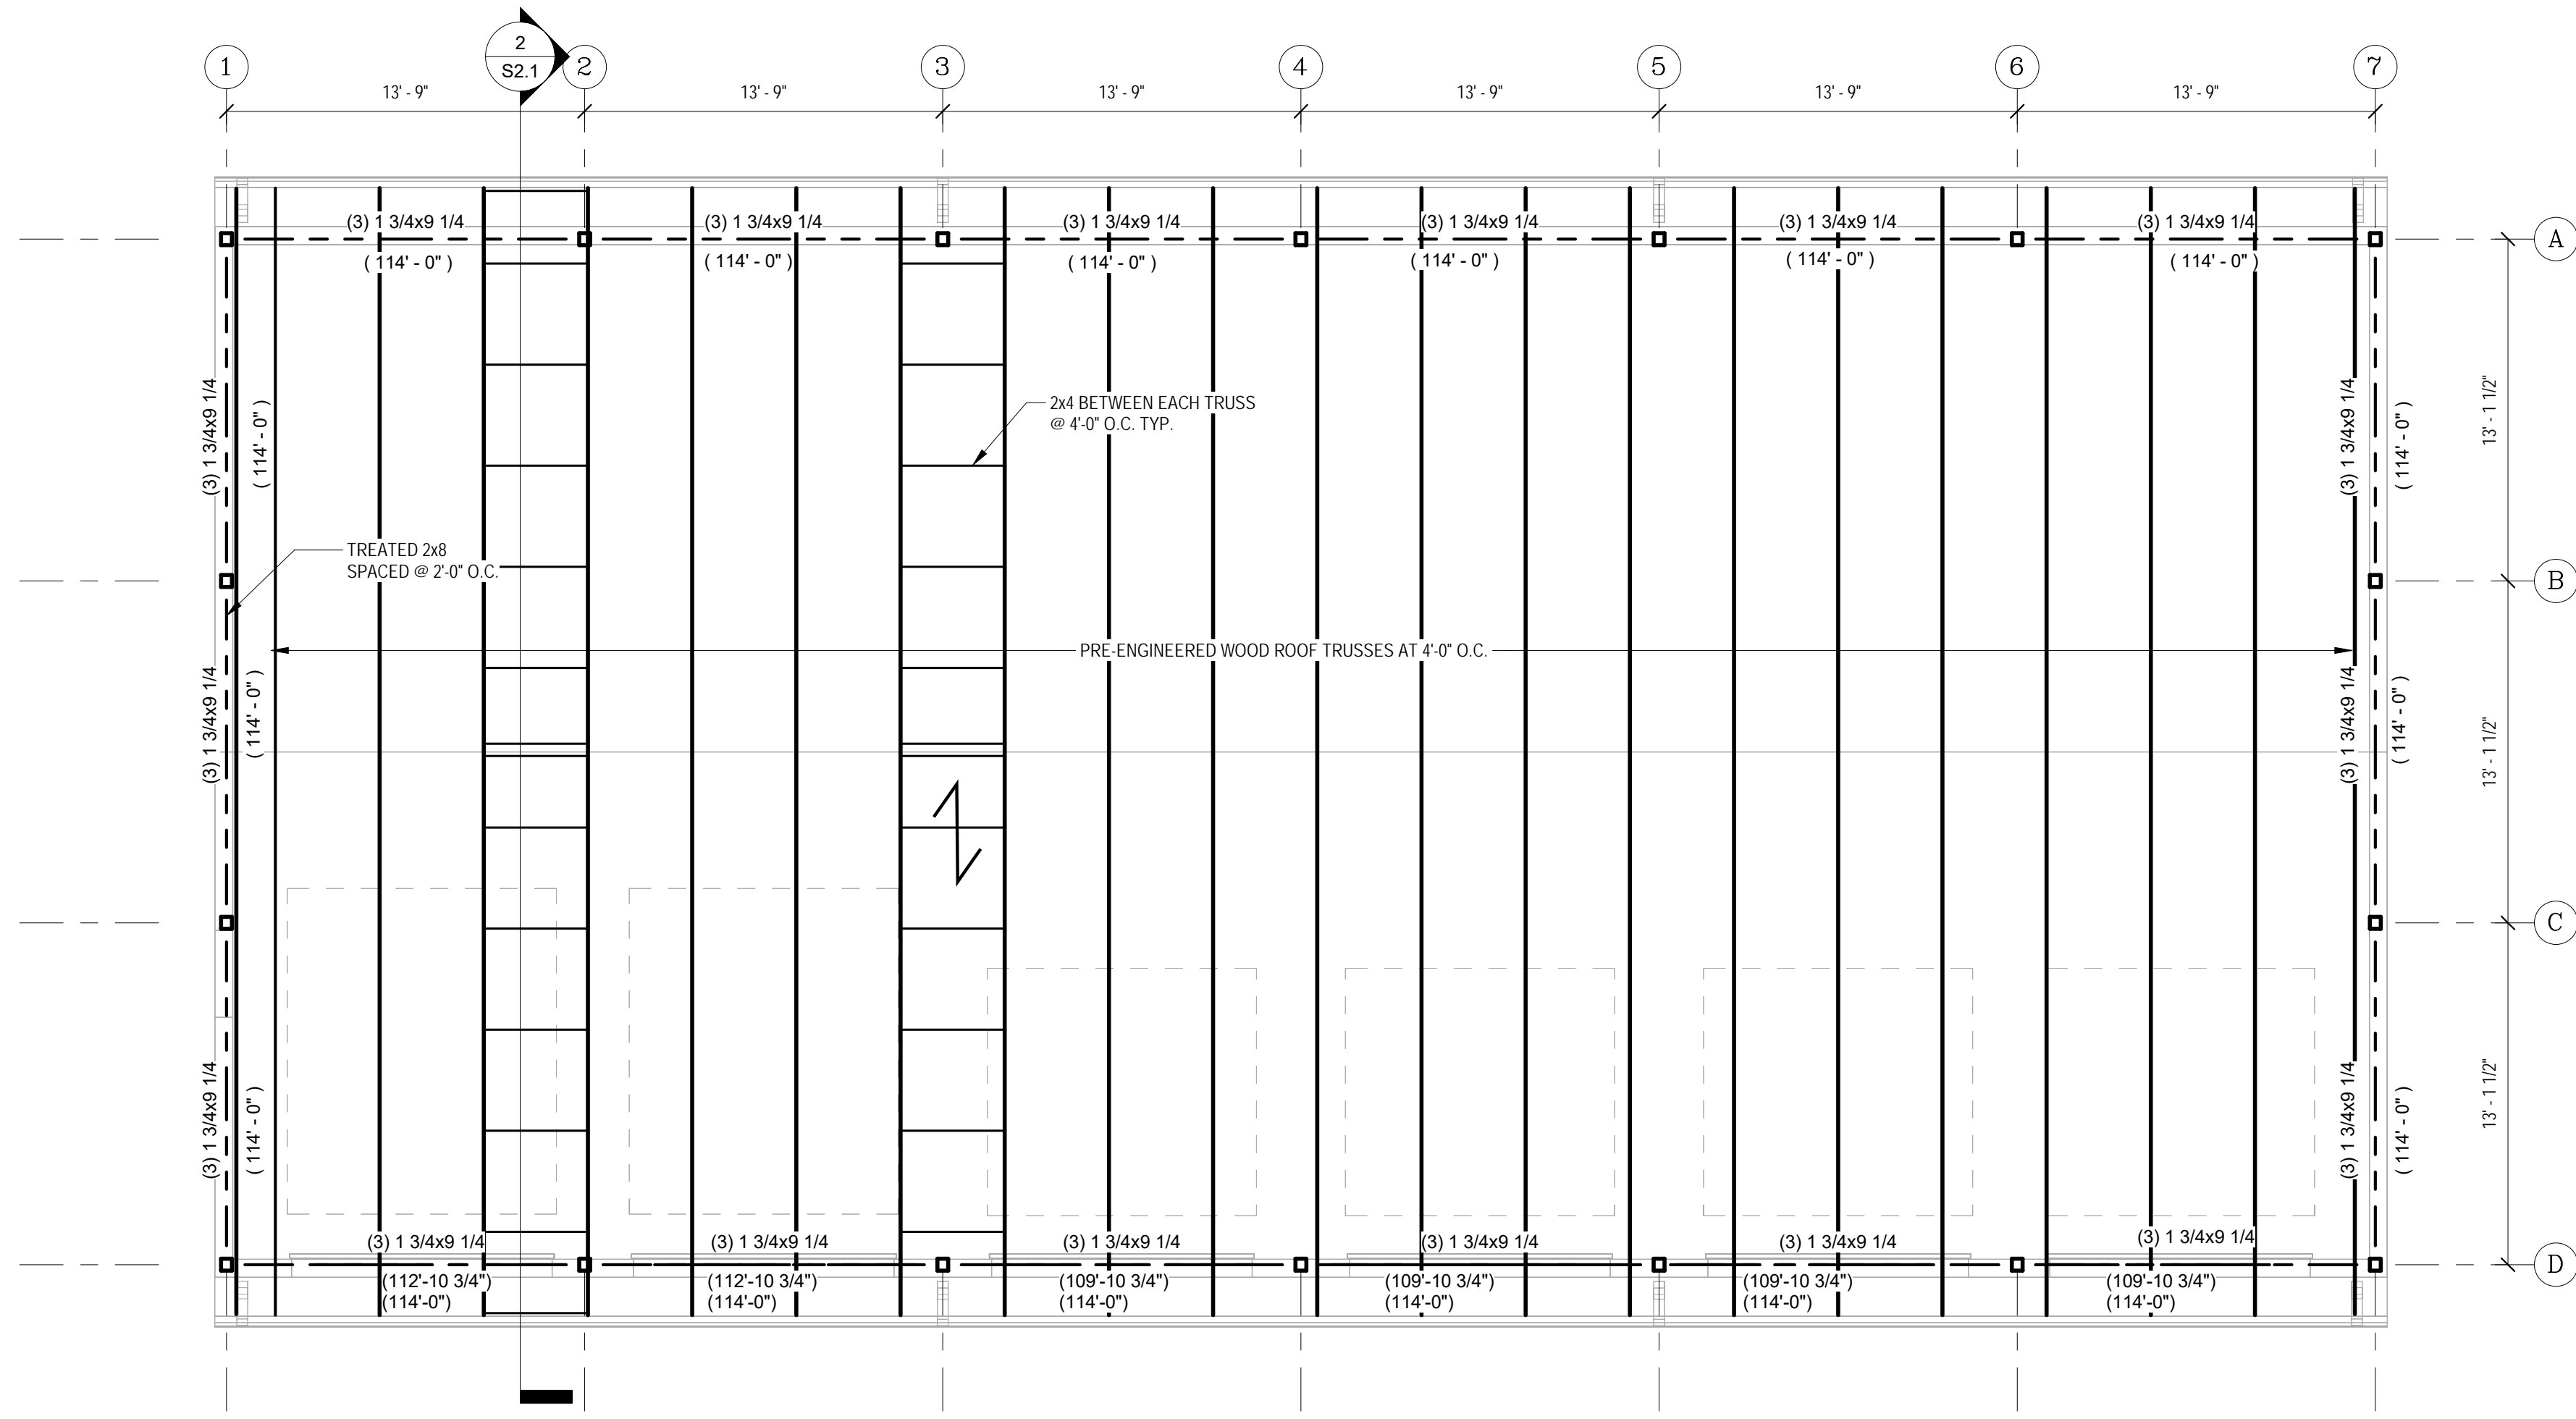

1 ROOF FRAMING PLAN
SCALE: 3/16" = 1'-0"

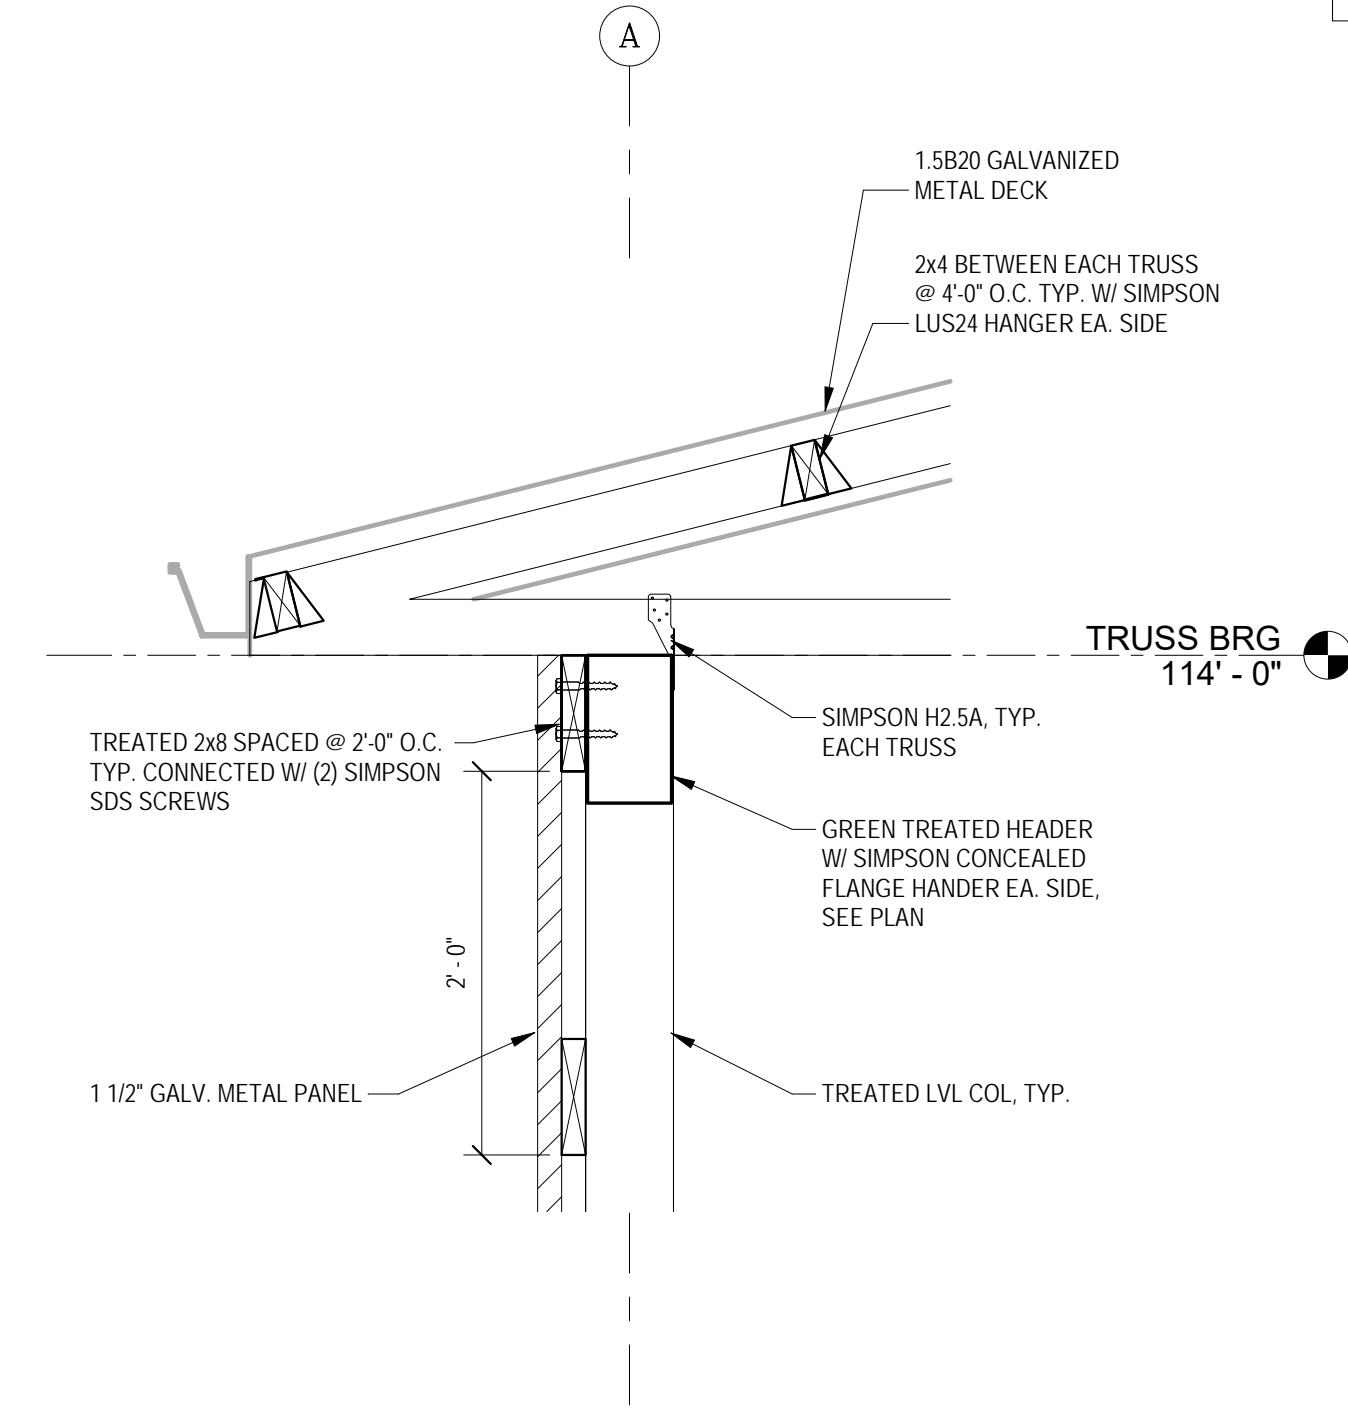

3 TRUSS BEARING DETAIL
SCALE: 1" = 1'-0"

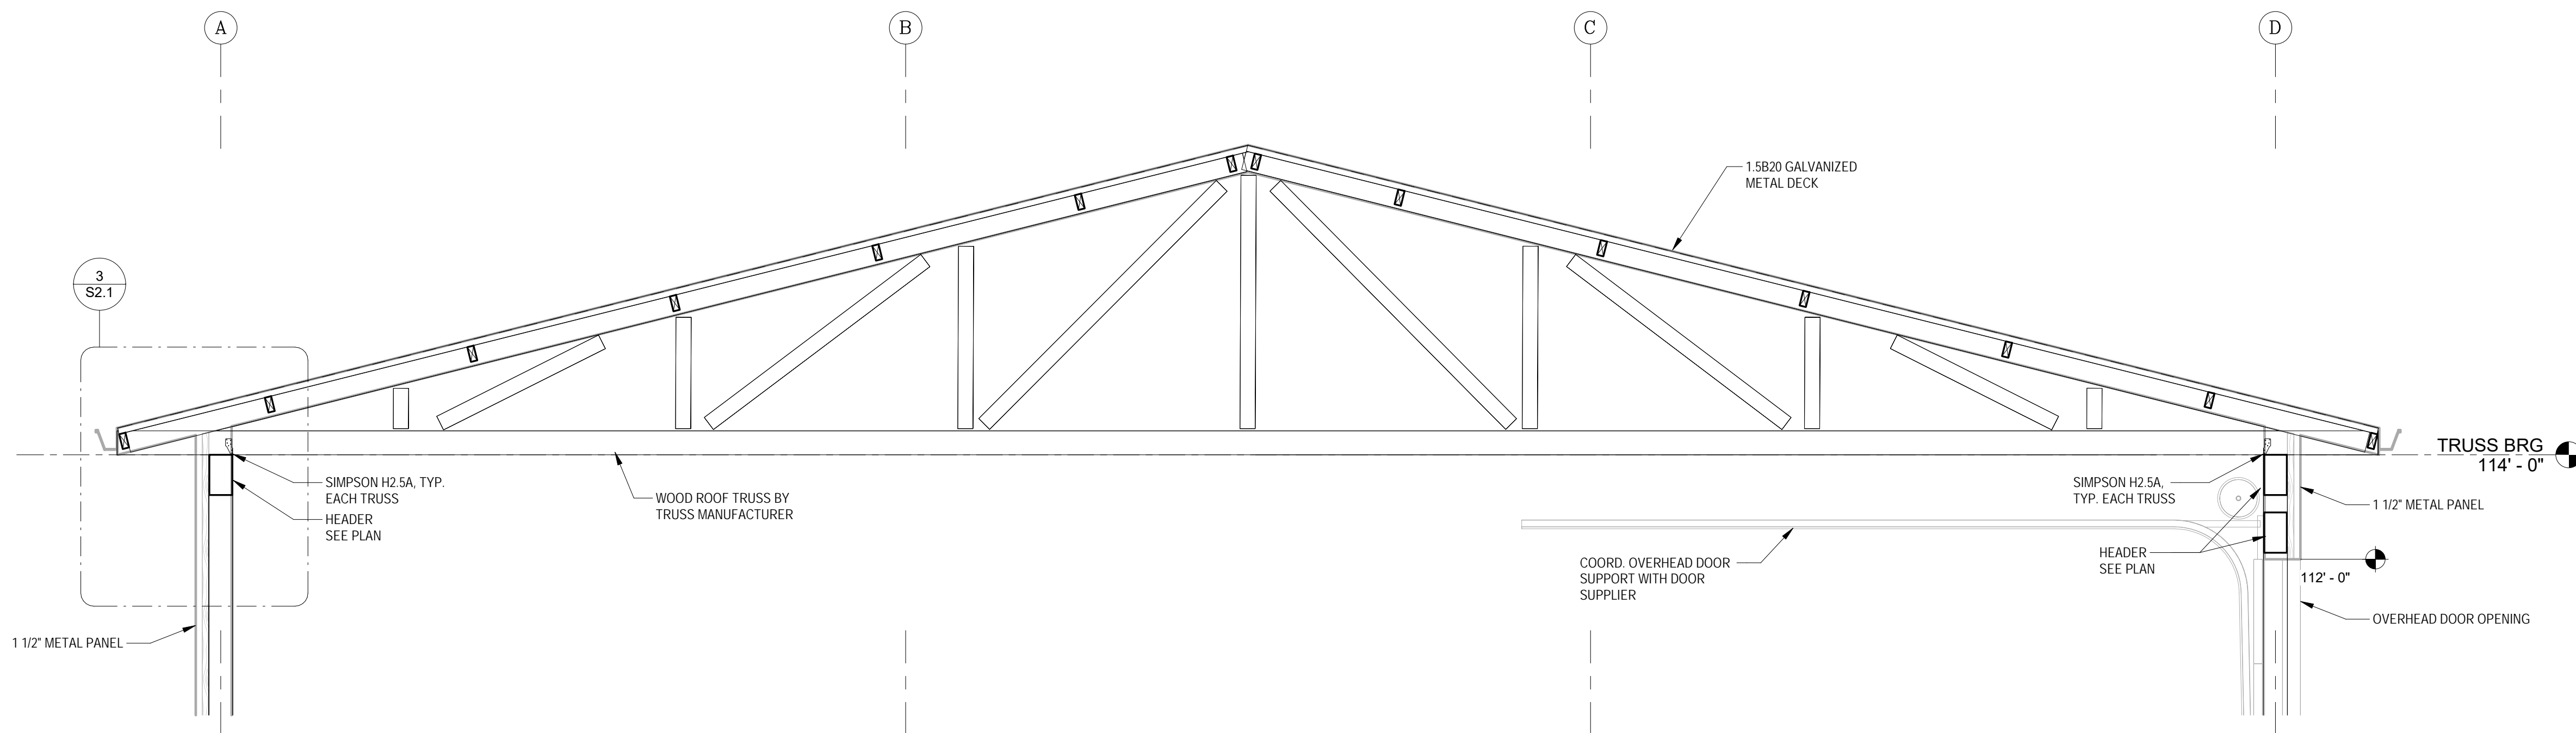


2 TRUSS SECTION
SCALE: 1/2" = 1'-0"

GENERAL STRUCTURAL NOTES:

- A. DESIGN CRITERIA, DESIGN CODE: IBC 2018
- DESIGN LOADS
- GRAVITY LOADS
- ROOF'S: DL = 10 PSF
- LL BASED ON GROUND SNOW LOAD OF 25 PSF (Ce = 1.0, Cf = 1.2, AND i = 0.8)**
- ** INCREASE LIVE LOAD FOR SNOW FRITTING AS REQUIRED IN CONFORMANCE WITH THE AMERICAN SOCIETY OF CIVIL ENGINEERS ANS/ASCE 7-16
- WIND LOAD CRITERIA (2018 IBC)
- BASE WIND SPEED (3 SECOND GUST), V = 110 MPH
- BUILDING CATEGORY I
- IMPORTANCE FACTOR Iw = 1'-0"
- EXPOSURE CATEGORY C
- CONCRETE 28 DAY STRENGTH FC = 4,000 PSI
- ALLOWABLE SOIL BEARING CAPACITY 1,500 PSF (ASSUMED MINIMUM)
- WOOD MEMBERS DOUGLAS FIR LARCH NO. 2 MINIMUM

PERFORMANCE Engineering
11811 Fort Street, Suite 104 - Omaha, NE 68164
(402) 343-8866
NE-C24-05
389 Perry St., Suite 304 - Castle Rock, CO 80104
(803) 721-3829
PE # - 250824

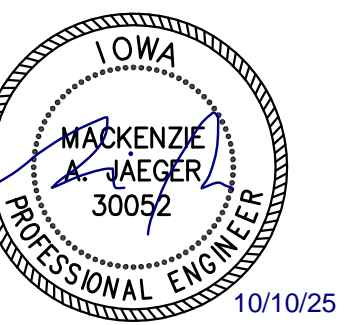

hgm ASSOCIATES INC.
ENGINEERING ARCHITECTURE SURVEYING
council bluffs omaha

This drawing is being made available on this project in accordance with hgm classification for professional services. hgm associates inc. assumes no liability for any use of this drawing except in accordance with the terms of the above agreement.

Rev#	Date
MLL	drawn
MAJ	designed
MAJ	approved
10-10-25	date

project **HHS STS NEW GARAGE BLDG**
3211 Edgington Ave, Eldora, IA 50027
client IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES
sheet **ROOF FRAMING PLAN & DETAILS**

project no. **106025**
sheet **9476.00**
S2.1

MECHANICAL ABBREVIATIONS

AFF	ABOVE FINISHED FLOOR
AHU-XX	AIR HANDLING UNIT, XX=UNIT NUMBER
APPROX	APPROXIMATE
ARCH	ARCHITECTURAL
B-XX	BOILER, XX=UNIT NUMBER
BC-XX	BLOWER COIL, XX=UNIT NUMBER
BLDG	BUILDING
BDG	BOTTOM OF DUCT
BOP	BOTTOM OF PIPE
BTU	BRITISH THERMAL UNIT
BTUH	BTU PER HOUR
CFM	CUBIC FEET PER MINUTE
CSA-US	CANADIAN STANDARDS ASSOCIATION (FORMERLY AGA)
CU-XX	CONDENSING UNIT, XX=UNIT NUMBER
CUH-XX	CABINET UNIT HEATER, XX=UNIT NUMBER
DCW	DOMESTIC COLD WATER
DEG	DEGREE
DEMO	DEMOLITION
DHW	DOMESTIC HOT WATER
DHWC	DOMESTIC HOT WATER CIRCULATOR
DIA	DIAMETER
DN	DOWN
DWG	DRAWING
DWH-XX	DOMESTIC WATER HEATER, XX=UNIT NUMBER
EF-XX	EXHAUST FAN, XX=UNIT NUMBER
ERV-XX	ENERGY RECOVERY VENTILATOR, XX=UNIT NUMBER
ET-XX	EXPANSION TANK, XX=UNIT NUMBER
EXIST	EXISTING
F-XX	FURNACE, XX=UNIT NUMBER
FCU-XX	FAN COIL UNIT, XX=UNIT NUMBER
FD	FIRE DAMPER
FM	FEET PER MINUTE
FSD	FIRE & SMOKE DAMPER
FT	FEET OR FOOT
FT-XX	FIN TUBE, XX=UNIT NUMBER
G	NATURAL GAS
GAL	GALLON
GPH	GALLONS PER HOUR
GPM	GALLONS PER MINUTE
HP	HEAT PUMP
HP-XX	HEAT PUMP, XX=UNIT NUMBER
HR	HEAT PUMP RETURN
HPS	HEAT PUMP SUPPLY
HUH-XX	HORIZONTAL UNIT HEATER, XX=UNIT NUMBER
HWR	HOT WATER RETURN
HWS	HOT WATER SUPPLY
HVAC	HEATING, VENTILATING, AND AIR CONDITIONING
ID	INSIDE DIAMETER
IN	INCH
KV	KILOVOLT
KW	KILOWATT
LB	POUND
LTG	LIGHTING
MAX	MAXIMUM
MAU-XX	MAKE-UP AIR UNIT, XX=UNIT NUMBER
MFR	MANUFACTURER
MN	MINIMUM
MTR	MOTOR
MU	MAKE-UP WATER
MECH	MECHANICAL
NC	NORMALLY CLOSED
NO	NORMALLY OPEN OR NUMBER
NOM	NOMINAL
NTS	NOT TO SCALE
OBD	OPPOSED BLADE DAMPER
OD	OUTSIDE DIAMETER
P-XX	PUMP, XX=UNIT NUMBER
PSI	POUNDS PER SQUARE INCH
PTAC-XX	PACKAGED TERMINAL AIR CONDITIONER, XX=UNIT NUMBER
PTHP-XX	PACKAGED TERMINAL HEAT PUMP, XX=UNIT NUMBER
PWR	POWER
QTY	QUANTITY
RA	RETURN AIR
RPM	REVOLUTIONS PER MINUTE
RTN	RETURN
RTU-XX	ROOF TOP UNIT, XX=UNIT NUMBER
SA	SUPPLY AIR
SD	SMOKE DAMPER
SEC	SECOND (SECONDARY)
SHT	SHEET
SQ	SQUARE
SS	STAINLESS STEEL
STD	STANDARD
STM	STEAM
SWBD	SWITCHBOARD
TEMP	TEMPERATURE
TSTAT	THERMOSTAT
TYP	TYPICAL
UG	UNDERGROUND
UTL	UTILITY
V	VENT
VAV-XX	VARIABLE AIR VOLUME TERMINAL, XX=UNIT NUMBER
VFD-XX	VARIABLE FREQUENCY DRIVE, XX=UNIT NUMBER
VOL	VOLUME
VTR	VENT THROUGH ROOF
W	WITH
WO	WITHOUT
WG	WATER GAUGE
WT	WEIGHT
XA	EXHAUST AIR
XFMR	TRANSFORMER
Ø	DIAMETER

MECHANICAL SYMBOLS

	NOTE REFERENCE
	SECTION IDENTIFICATION
	DETAIL IDENTIFICATION
	ELECTRICAL PANEL
	CARBON MONOXIDE SENSOR
	NITROGEN DIOXIDE SENSOR

GENERAL NOTES - HVAC

- A ALL WALL MOUNTED DEVICES SHALL BE COORDINATED WITH OTHER TRADES AND ALIGNED WITH ADJACENT WALL MOUNTED DEVICES ON CENTER.
- B PROVIDE FRAMED 1/2" X 1/2" BIRD SCREEN AT ALL DUCTS TERMINATING WITHOUT AN AIR DEVICE, AT INDOOR FACE OF LOUVERS, AND AT UNDUCTED AIRFLOW OPENINGS AT EQUIPMENT.

PROJECT DESIGN CRITERIA	
LOCATION:	ELDORA, IA
CITY/STATE:	
APPLICABLE CODES:	
BUILDING	2024 IBC
MECHANICAL	2024 IMC
PLUMBING	2024 UPC
FUEL GAS	2024 IFGC
ELECTRICAL	2023 NEC
LATITUDE:	42.36°
DEG. N. LAT.	
ELEVATION:	1086'
FT. ABOVE SEA LEVEL	
ASHRAE DESIGN CONDITIONS:	
0.4% DB(MCW) (COOLING)	93.0°/76.1° F
99.6% DB (HEATING)	-4.4° F


GENERAL NOTES - MECHANICAL

- A ALL MECHANICAL, ELECTRICAL, AND PLUMBING SYSTEMS SHALL BE INSTALLED TO COMPLY WITH ALL APPLICABLE STATE BUILDING CODES.
- B CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS AND PAY THE ASSOCIATED FEES. THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE NATIONAL, AND STATE, AND LAWS, CODES, AND ORDINANCES RELATING TO BUILDING AND PUBLIC SAFETY.
- C THE CONTRACTOR SHALL PROVIDE A COMPLETE WORKING AND COORDINATED SYSTEM. FURNISH ALL NECESSARY MATERIALS, EQUIPMENT, AND LABOR AS REQUIRED.
- D COORDINATE THE EXACT LOCATION OF MECHANICAL AND PLUMBING EQUIPMENT WITH ELECTRICAL EQUIPMENT, LIGHT FIXTURES, PIPING, CONDUIT, DUCTWORK, AND ALL OTHER CONSTRUCTION TO ALLOW FOR ADEQUATE ACCESS TO SERVICE EQUIPMENT.
- E CONTRACTOR IS RESPONSIBLE FOR COORDINATING DUCTWORK AND PIPING WITH OTHER TRADES AND PROVIDE OFFSETS AS NECESSARY. NOT ALL OFFSETS ARE INDICATED ON DRAWINGS.
- F DUCTWORK PIPING AND CONDUIT SHALL BE INDEPENDENTLY SUPPORTED. WHERE INDEPENDENT SUPPORT SYSTEMS ARE NOT POSSIBLE, AN ENGINEERING SYSTEM SHALL BE ALLOWED UPON APPROVAL BY ENGINEER OF RECORD.
- G COORDINATE ON-SITE STORAGE OF EQUIPMENT AND MATERIAL WITH FACILITY.
- H CONTRACTOR SHALL REMOVE EXCESS MATERIAL AND DEBRIS AND CLEAN ALL EQUIPMENT UPON COMPLETION OF WORK. CONTRACTOR SHALL BE RESPONSIBLE FOR TOUCHING UP PAINT WHERE REQUIRED.
- I MECHANICAL AND PLUMBING SYSTEMS SHALL BE COORDINATED WITH NEW ELECTRICAL DISCONNECTS, PANELS, AND CONNECTIONS TO MAINTAIN ALL NEC REQUIRED CLEARANCES.

FAN SCHEDULE

- NOTES:**
- WALL MOUNTED PROPELLER FAN WITH WALL HOUSING, WEATHERHOOD, AND GRAVITY BACKDRAFT DAMPER. PROVIDE INSECT SCREEN AT FAN OUTLET.
 - INTERLOCK FAN OPERATION WITH TOXIC GAS DETECTION SYSTEM.
 - FAN SHALL RUN 24/7.

MARK	LOCATION	SERVES	TYPE	CFM	ESP (IN. W.G.)	MAX DBA	DRIVE	ELECTRICAL DATA			RPM	MOUNTING	ROOF CURB HEIGHT (IN.)	WEIGHT (LBS.)	MANUFACTURER AND MODEL	NOTES	
								DISCONNECT	CONTROLLER	MOTOR HP							
EF-1	GARAGE	GARAGE	PROP	2340	0.1	63	DIRECT	BY E.C.	MOTOR STARTER	1/3	120 / 1	1750	WALL	-	113	SE-16-421-43	1,2
EF-2	GARAGE	GARAGE	PROP	170	0.1	47	DIRECT	BY E.C.	MOTOR STARTER	1/40	120 / 1	1550	WALL	-	52	SE-14-426-D	1,3

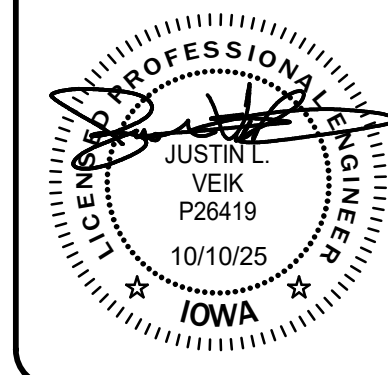

This drawing is being made available for use on this project in accordance with hgm Associates Inc. professional services agreement. hgm associates inc. assumes no liability for any use of this drawing for any purpose other than that intended, except in accordance with the terms of the above agreement.


Rev#	Date
JES	drawn
WWW	designed
WWW	approved
10-10-25	date

project: **HHS STS NEW GARAGE BLDG**
3211 Edgington Ave. Blaca, Ia 50627


client: IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES

sheet: **MECHANICAL GENERAL INFORMATION**

project no. **106025**
sheet no. **9476.00**

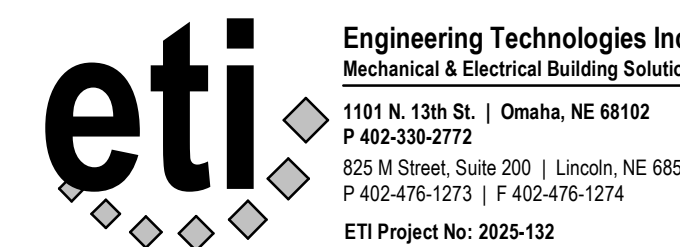

MG0.0

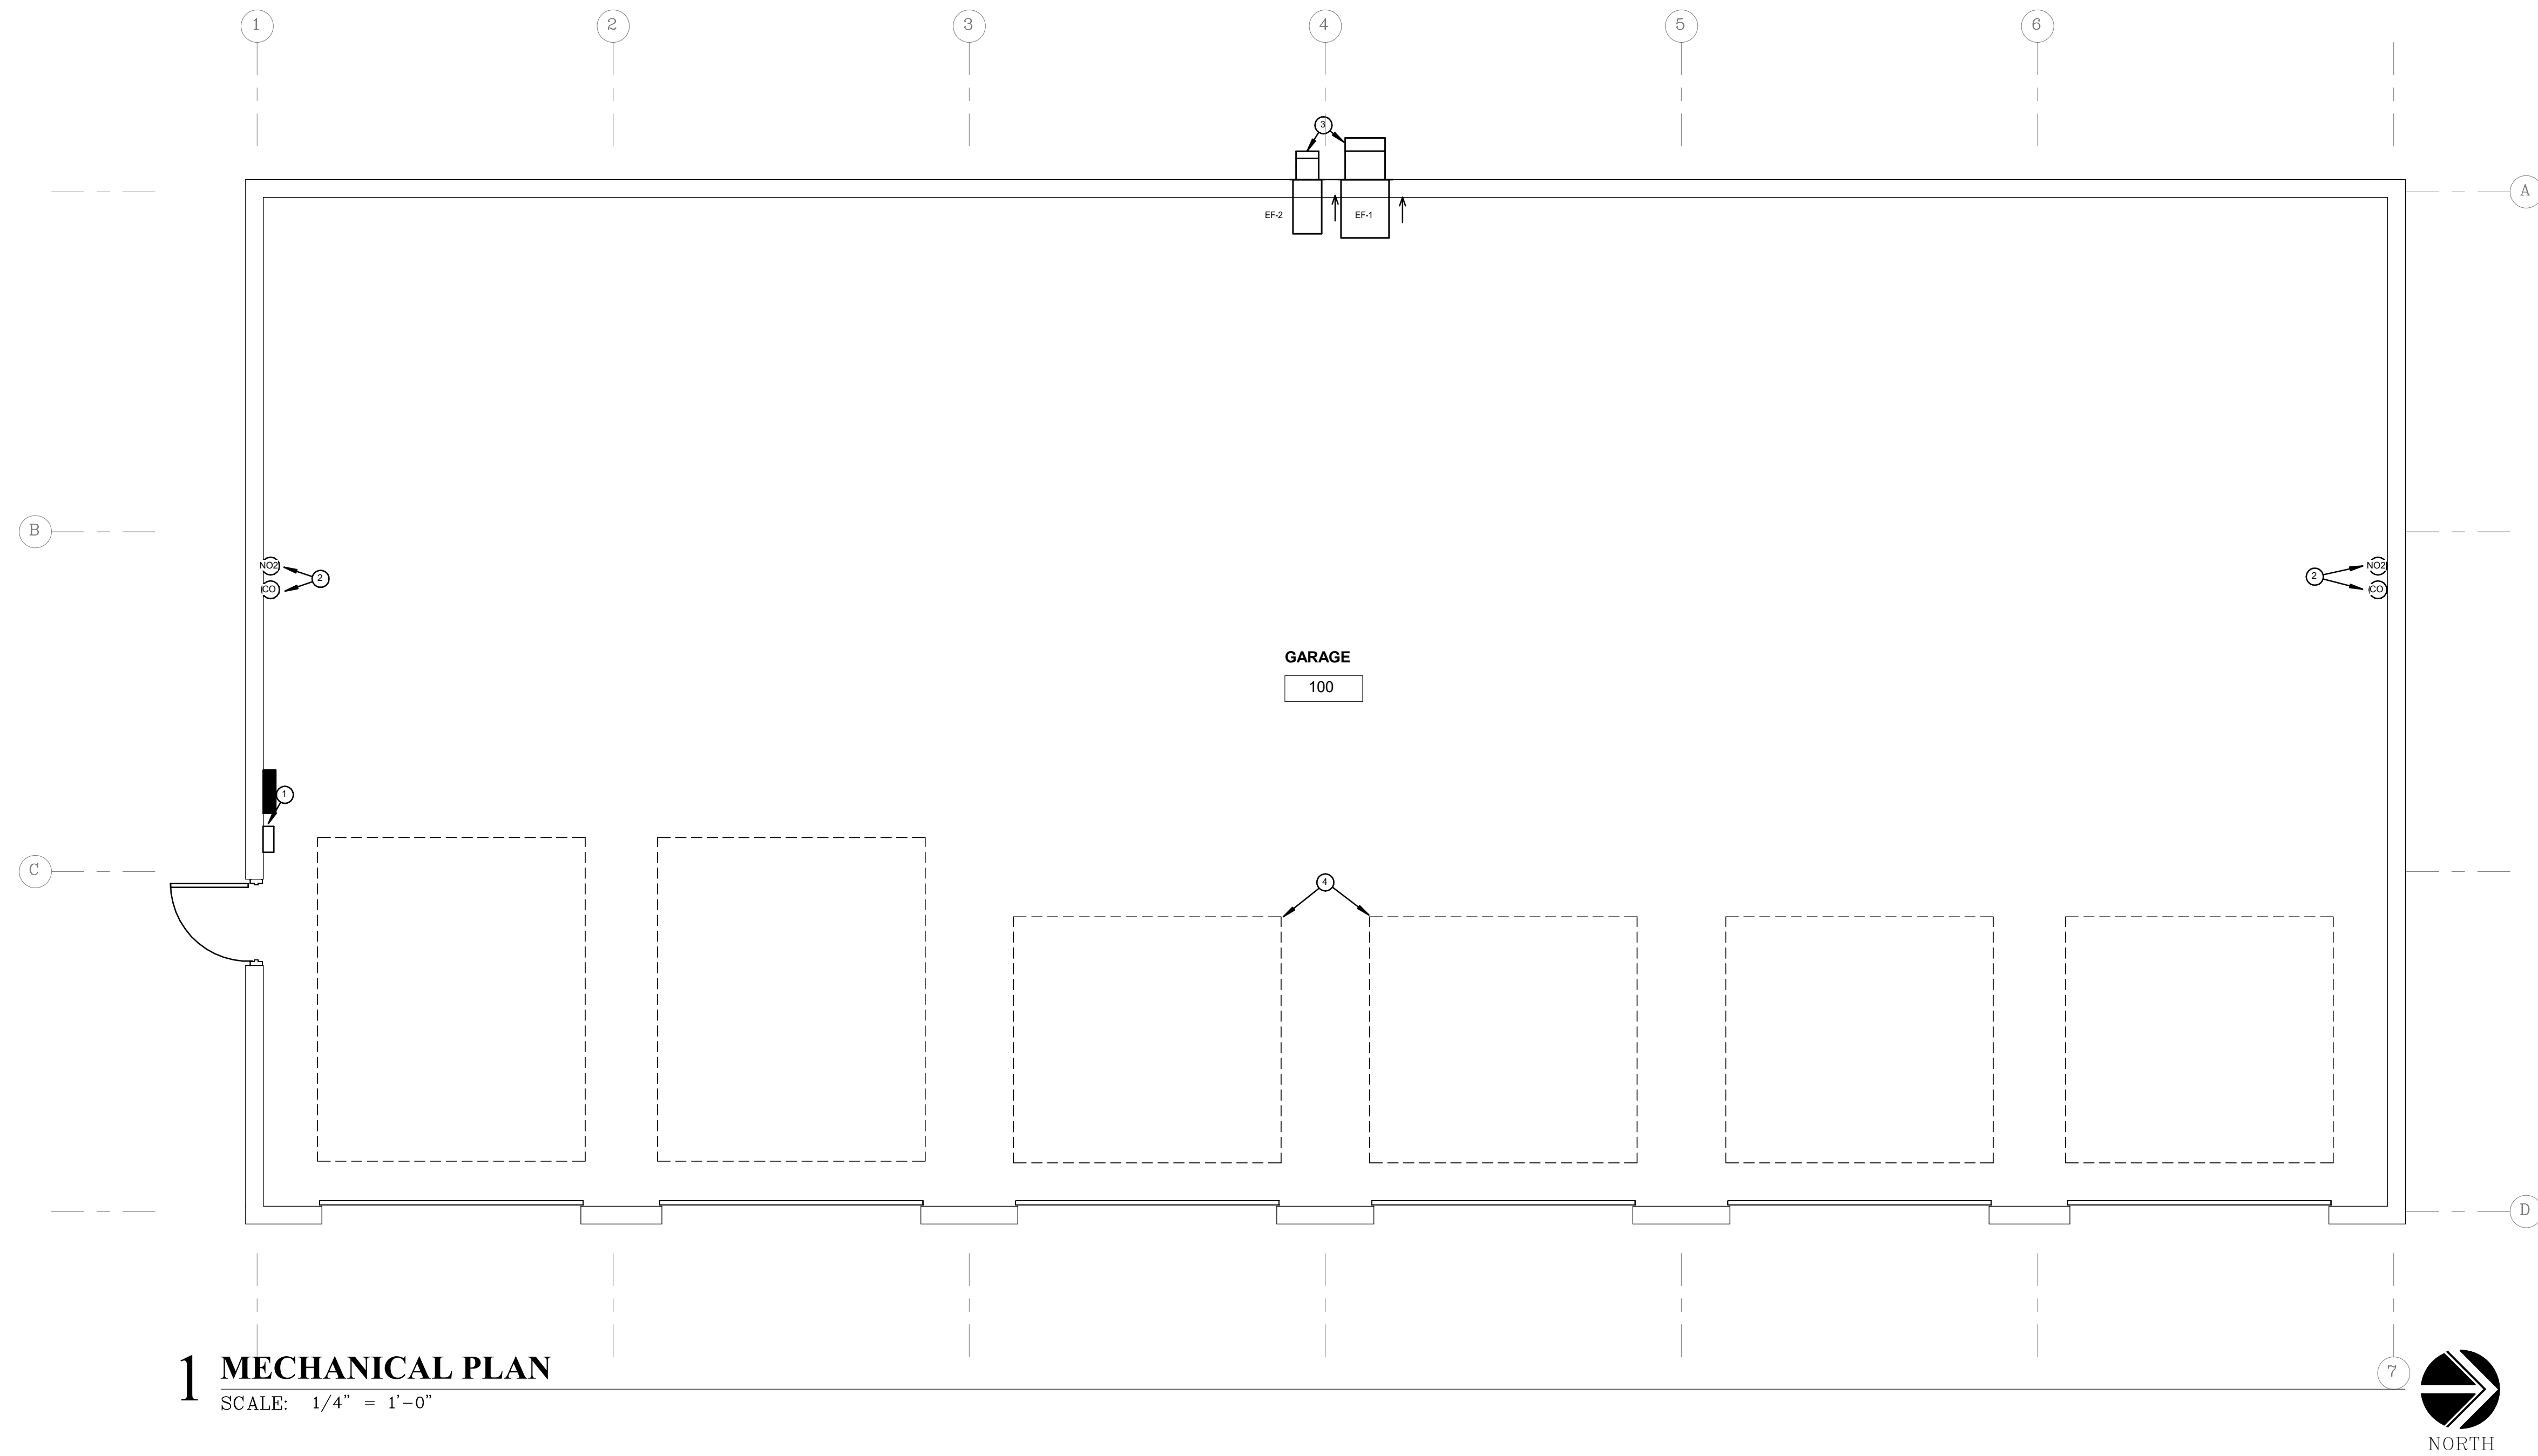

1 MECHANICAL PLAN
SCALE: 1/4" = 1'-0"

SHEET NOTES

- 1 TOXIC GAS DETECTION SYSTEM CONTROLLER INTEGRATED WITH TOXIC GAS EXHAUST FAN (EF-1).
- 2 CARBON MONOXIDE (CO) AND NITROGEN DIOXIDE (NO2) DETECTORS FOR EF-1 AND EF-2 TOXIC GAS SYSTEM. INSTALL CARBON MONOXIDE (CO) DETECTOR AND NITROGEN DIOXIDE (NO2) DETECTOR ABOVE THE FLOOR FOR DETECTION IN BREATHABLE AREA. SEE MANUFACTURER'S RECOMMENDATIONS FOR ALL OTHER.
- 3 MOUNT FANS AT 9'-0" A.F.F. AND SPACE FAN OUTLETS AT 6" APART AS REQUIRED TO ALLOW FOR FRAMING.
- 4 EACH GARAGE DOOR IS TO BE PROVIDED WITH A DRY CONTACT THAT SHALL BE INTEGRATED INTO THE TOXIC GAS DETECTION SYSTEM WHEN THE GAS DETECTION SYSTEM ALARMS. EXHAUST FAN EF-1 SHALL ENERGIZE AND THE GARAGE DOORS SHALL OPEN.



hgm
ASSOCIATES INC.
ENGINEERING ARCHITECTURE SURVEYING
council bluffs omaha

This drawing is being made available for use on this project in accordance with hgm Associates Inc. for professional services. hgm Associates Inc. assumes no liability for any use of this drawing for any other project except in accordance with the terms of the above agreement.

Author	Rev#	Date
drawn		
designed		
approved		
date	10-10-25	

project **HHS STS NEW GARAGE BLDG**
3211 Edgington Ave. Blara, IA 50627

client IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES

sheet **MECHANICAL PLAN**

project no. **106025**
9476.00
sheet

M1.1

eti Engineering Technologies Inc.
Mechanical & Electrical Building Solutions
1101 N. 13th St. | Omaha, NE 68102
P 402-330-2722
825 M Street, Suite 200 | Lincoln, NE 68508
P 402-476-1273 | F 402-476-1274
ETI Project No: 2025-132

MISC. ELECTRICAL SYMBOLS

	PLAN OR DETAIL NOTE IDENTIFICATION
	DETAIL IDENTIFICATION SHEET NUMBER
	SURFACE MOUNTED RACEWAY, TYPE AS NOTED, WITH DEVICES AS INDICATED
	HOMERUN TO PANELBOARD, LETTER INDICATES PANEL DESIGNATION, NUMBER INDICATES CIRCUIT
	CONDUIT CONCEALED IN WALLS OR CEILING, CROSSHATCHES INDICATE NUMBER OF CONDUCTORS EXCEPT NO CROSSHATCHES INDICATE 2 CONDUCTORS (GROUND WIRES ARE NOT SHOWN)
	CONDUIT CONCEALED BELOW FLOOR
	TELEPHONE RACEWAY
	TELEVISION RACEWAY
	FIBER OPTICS RACEWAY
	DATA SYSTEM RACEWAY
	PROVIDE HDMI CABLE IN CONDUIT
	EMERGENCY POWER AND LIGHTING CIRCUIT
	SOUND SYSTEM RACEWAY
	CONDUIT DOWN
	CONDUIT UP
	WIREMOLD SURFACE MOUNTED RACEWAY
	CONDUIT TO BE REMOVED
	EXPOSED CONDUIT
	UNDERGROUND PRIMARY ELECTRICAL
	UNDERGROUND SECONDARY ELECTRICAL
	UNDERGROUND ELECTRICAL
	OVERHEAD ELECTRICAL
	LOW VOLTAGE ELECTRICAL
	CLOCK SYSTEM RACEWAY
	CONDUIT SEAL-OFF FITTING
	EXISTING CONDUIT, VERIFY EXACT LOCATION
	UTILITY CO. POWER POLE
	GROUND CONNECTION

LIGHTING SYMBOLS

	RECESSED OR SURFACE MOUNTED LIGHT FIXTURE, NUMBER = TYPE, LETTER = SWITCH
	HATCHING INDICATES EMERGENCY LIGHT FIXTURE, NUMBER = TYPE
	WALL MOUNTED LIGHT FIXTURE, NUMBER = TYPE
	LIGHT FIXTURE, NUMBER = TYPE
	HATCHING INDICATES EMERGENCY LIGHT FIXTURE, NUMBER = TYPE
	PENDANT MOUNTED LIGHT FIXTURE, NUMBER = TYPE
	WALL MOUNTED LINEAR LIGHT FIXTURE, NUMBER = TYPE
	LINEAR LIGHT FIXTURE, NUMBER = TYPE
	SINGLE FACED EXIT LIGHT, NUMBER = TYPE, HATCH INDICATES ILLUMINATED FACE, ARROW = CHEVRON DIRECTION
	DOUBLE FACED EXIT LIGHT, NUMBER = TYPE, HATCH INDICATES ILLUMINATED FACE, ARROW = CHEVRON DIRECTION
	EXIT LIGHT WITH TWO EMERGENCY LIGHTING HEADS, NUMBER = TYPE, HATCH INDICATES ILLUMINATED FACE, ARROW = CHEVRON DIRECTION
	EMERGENCY LIGHT WALL PACK, NUMBER = TYPE
	POLE MOUNTED LIGHT FIXTURE, NUMBER = TYPE
	LIGHTING TRACK, TRIANGLE INDICATES LIGHT FIXTURE HEAD, PROVIDE NUMBER OF HEADS AS SHOWN, NUMBER = TYPE
	CEILING FAN
	STRIP LIGHT FIXTURE, NUMBER = TYPE
	EXISTING POLE MOUNTED LIGHT FIXTURE
	DOUBLE POLE SWITCH
	KEYED SWITCH
	SWITCH WITH LIGHTED HANDLE FOR PILOT
	SWITCH MOUNTED ON WIREMOLD BOX WITH WIREMOLD TO ABOVE ACCESSIBLE CEILING
	MOMENTARY CONTACT SWITCH
	SINGLE POLE SWITCH, 3-WAY SWITCH AND 4-WAY SWITCH
	LINE VOLTAGE DIMMER SWITCH
	CEILING MOUNTED OCCUPANCY SENSOR
	AUTOMATIC WALL SWITCH WITH OCCUPANCY SENSOR
	WALL MOUNTED OCCUPANCY SENSOR
	LIGHTING CONTROL TAG, LETTER INDICATES TAG IN LIGHTING CONTROL SCHEDULE
	LIGHTING CONTROL LOAD CONTROLLER, LETTER INDICATES LIGHTING CONTROLLED ZONE
	LOW-VOLTAGE SWITCH, WHERE PRESENT, LETTER INDICATES LIGHTING CONTROL ZONE, SEE LIGHTING CONTROL SCHEDULE.
	CEILING MOUNTED PHOTOCELL
	WALL MOUNTED PHOTOCELL

POWER SYMBOLS

	DUPLIX CONVENIENCE RECEPTACLE - WP = WEATHERPROOF - GFCI = GROUND FAULT CIRCUIT INTERRUPTER - T = TAMPER RESISTANT - L = DUPLEX RECEPTACLE WITH USB PORTS - IG = ISOLATED GROUND RECEPTACLE, PROVIDE FULL SIZE GROUND WIRE EXTENDED BACK TO PANEL
	DUPLIX CONVENIENCE RECEPTACLE MOUNTED ON WIREMOLD BOX WITH WIREMOLD TO ABOVE ACCESSIBLE CEILING
	SPLIT WIRED DUPLEX RECEPTACLE
	DUPLIX CONVENIENCE RECEPTACLE MOUNTED HORIZONTAL
	4-PLEX CONVENIENCE RECEPTACLE
	CEILING MOUNTED RECEPTACLE
	SPECIAL OUTLET OR CONNECTION, SEE PLAN AND SCHEDULE
	MULTI-SERVICE AV WALL BOX
	FLUSH MOUNTED DUPLEX FLOOR OUTLET
	MULTI-SERVICE FLOOR BOX
	THERMOSTAT
	GENERATOR
	MOTOR CONNECTION, SEE PLAN AND SCHEDULE
	SOLENOID VALVE
	BELL
	PRESSURE SWITCH
	PUSH-BUTTON
	MOTOR CONTROL PUSH-BUTTON STATION
	JUNCTION BOX
	WALL MOUNTED JUNCTION BOX
	POWER POLE
	DRY-TYPE TRANSFORMER
	PAD-MOUNTED TRANSFORMER
	ELECTRICAL RELAY
	BUZZER OR CHIME
	MAGNETIC MOTOR STARTER
	COMBINATION MAGNETIC MOTOR STARTER/DISCONNECT SWITCH, FUSED UNLESS OTHERWISE NOTED
	VARIABLE FREQUENCY DRIVE
	HORSEPOWER RATED MANUAL MOTOR CONTROLLER WITH TOGGLE SWITCH
	MANUAL MOTOR STARTER WITH HORSEPOWER RATED TOGGLE SWITCH, PROVIDE THERMAL ELEMENT IF MOTOR IS NOT INTERNALLY PROTECTED
	HORSEPOWER RATED TOGGLE SWITCH WITH PLUG FUSE AND FUSTAT ADAPTER, SIZE AS REQUIRED FOR LOAD.
	TIME CLOCK
	DISCONNECT SWITCH - FUSED
	DISCONNECT SWITCH - NON FUSED
	SURFACE MOUNTED PANELBOARD
	RECESSED MOUNTED PANELBOARD
	DISTRIBUTION PANEL
	SWITCHBOARD

COMMUNICATION SYMBOLS

	COMMUNICATIONS OUTLET, ROUGH-IN ONLY
	COMMUNICATIONS OUTLET, # INDICATES NUMBER OF CABLES / JACKS REQUIRED OF EACH TYPE, LETTER INDICATED TYPE OF JACK - D = DATA - T = TELEPHONE - H = HDMI - TV = TELEVISION
	DATA OUTLET AT 48" ABOVE FINISHED FLOOR, COVERPLATE WITH MOUNTING LUGS
	DATA OUTLET MOUNTED ON WIREMOLD BOX WITH WIREMOLD TO ABOVE ACCESSIBLE CEILING
	WIRELESS ACCESS POINT
	FLOOR COMMUNICATIONS OUTLET
	CEILING COMMUNICATIONS OUTLET
	TELEPHONE OUTLET
	TELEPHONE OUTLET AT 48" ABOVE FINISHED FLOOR, COVERPLATE WITH MOUNTING LUGS
	TELEPHONE OUTLET MOUNTED ON WIREMOLD BOX WITH WIREMOLD TO ABOVE ACCESSIBLE CEILING

ABBREVIATIONS


A	AMPERES
AC	4" ABOVE COUNTERTOP OR BACKSPLASH TO CENTER
AFB	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHU	AIR HANDLING UNIT
ATS	AUTOMATIC TRANSFER SWITCH
AWG	AMERICAN WIRE GAUGE
BD	BOARD
BFG	BELOW FINISHED GRADE
C	CONDUIT
CU	COPPER
CE	INDICATES EXISTING TO REMAIN
EB	INDICATES EXISTING J-BOX AND CONDUIT IN WALL TO BE REUSED
EF	EXHAUST FAN
EM	EMERGENCY
EMT	ELECTRICAL METALLIC TUBING
EWC	ELECTRIC WATER COOLER
F OR FRAC	FRACTIONAL
FA	FIRE ALARM
FAAP	FIRE ALARM ANNUNCIATOR PANEL
FACP	FIRE ALARM CONTROL PANEL
FCU	FAN COIL UNIT
FSD	FIRE AND SMOKE DAMPER
GND	GROUND
HVAC	HEATING, VENTILATION, & AIR CONDITIONING
HPF	HIGH POWER FACTOR
HZ	HERTZ
KVA	KILOVOLT AMPERES
KW	KILOWATT
MCB	MAIN CIRCUIT BREAKER
MLO	MAIN LUG ONLY
NEC	NATIONAL ELECTRICAL CODE
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NL	NIGHT LIGHT, CONNECT TO UNSWITCHED LIGHTING CIRCUIT
P	POLE
PART	PARTIAL CIRCUIT
PIV	POST INDICATOR VALVE
PNL	PANELBOARD
PVC	POLY VINYL CHLORIDE NON-METALLIC RACEWAY, SCHEDULE 40 OR SCHEDULE 80
R	REMOVE EQUIPMENT, INCLUDING MOUNTING HARDWARE, AND CONDUIT AND CONDUCTORS TO SOURCE OF SUPPLY, UNLESS OTHERWISE NOTED
RL	REMOVE AND RELOCATE ITEM, EXTEND EXISTING CONDUIT AND/OR CABLING AS REQUIRED TO NEW LOCATION, UNLESS OTHERWISE NOTED, SEE PLANS FOR NEW LOCATION.
RR	REMOVE AND REPLACE WITH NEW DEVICE, REUSE BOX AND CONDUIT IN WALL AND PROVIDE NEW CONDUIT AND WIRING TO DEVICE AS REQUIRED.
RMC	STEEL RIGID METAL CONDUIT
RTU	ROOF TOP UNIT
SD	SMOKE DAMPER
SPDT	SINGLE POLE DOUBLE THROW
SPST	SINGLE POLE SINGLE THROW
SS	STAINLESS STEEL
SWBD	SWITCHBOARD
TEL	TELEPHONE
TV	TELEVISION
TYP	TYPICAL
V	VOLTS
VFD	VARIABLE FREQUENCY DRIVE
W	WATT
WG	WIREGUARD
WP	INDICATES WEATHERPROOF
XFMR	TRANSFORMER

ELECTRICAL GENERAL NOTES

- A PROVIDE TEMPORARY POWER, LIGHTING, AND HEATING AS REQUIRED FOR CONSTRUCTION, COORDINATE WITH THE GENERAL CONTRACTOR AND OTHER TRADES.
- B FIRE SEAL ALL PENETRATIONS THROUGH FIRE RATED WALLS, CEILING AND FLOORS.
- C COORDINATE LOCATION OF WIRING DEVICES, TELECOM OUTLETS, FIRE ALARM DEVICES, ETC. WITH MILLWORK, TILE LAYOUT, AND OTHER WALL FINISHES PRIOR TO ROUGH-IN.
- D ALIGN ADJACENT WALL MOUNTED OUTLET BOXES FOR SWITCHES, THERMOSTATS, AND SIMILAR DEVICES. DEVICES SHALL BE ALIGNED VERTICALLY WHEN INSTALLED AT DIFFERING HEIGHTS AND INSTALL ALL ADJACENT DEVICES AT THE SAME HEIGHT TO CENTER, NOTIFY ARCHITECT OF ANY DISCREPANCIES BETWEEN TRADES PRIOR TO ROUGH-IN.
- E CONCEAL ALL CONDUITS IN WALL CHASES, ABOVE CEILINGS, BELOW FLOOR, OR IN ADJACENT STORAGE OR UNFINISHED SPACES, WHERE POSSIBLE. RUN EXPOSED CONDUITS VERTICALLY, WHERE POSSIBLE, TO ABOVE ACCESSIBLE CEILING, CONNECT HORIZONTALLY ABOVE CEILING.
- F PROVIDE TAMPER RESISTANT RECEPTACLES WHERE REQUIRED BY THE NEC.

LIGHTING GENERAL NOTES


- A CONNECT EXIT LIGHTS, EMERGENCY POWER SUPPLY UNITS, EMERGENCY BATTERY UNIT FIXTURES, AND NIGHTLIGHT (NL) INDICATED FIXTURES UNSWITCHED TO THE CIRCUIT INDICATED ON THE PLANS.
- B LOCATE REMOTE DRIVERS, WHERE PRESENT, FOR LUMINAIRES ABOVE THE NEAREST ACCESSIBLE CEILING, UNLESS OTHERWISE NOTED.
- C WHERE INDICATED, SUBSCRIPTS ON LIGHTING CONTROL DEVICES INDICATE CONTROL OF LUMINAIRES WITH CORRESPONDING SUBSCRIPTS WITHIN THE SAME ROOM.
- D WHERE DIMMING IS INDICATED, PROVIDE A DEDICATED LOAD CONTROLLER FOR EACH LIGHT FIXTURE TYPE WITHIN A ZONE.
- E WHERE LOW-VOLTAGE LIGHTING CONTROL WIRING IS REQUIRED BETWEEN DEVICES, IT SHALL BE PROVIDED PER MANUFACTURER'S INSTRUCTIONS. ROUTE CABLING ALONG ASSOCIATED LIGHTING CIRCUIT CONDUIT, SUPPORT USING PLASTIC TIES OR VELCRO STRAPS. 0-10V WIRING SHALL BE INSTALLED IN CONDUIT.
- F MOTION SENSORS SHALL BE INSTALLED A MINIMUM OF 8FT FROM HVAC DIFFUSERS. FIELD COORDINATE.
- G MOTION SENSORS ARE INDICATED SCHEMATICALLY FOR COORDINATION AND ARE A MINIMUM. PROVIDE ADDITIONAL SENSORS AS REQUIRED FOR ROOM COVERAGE. CONNECT MOTION SENSORS WITHIN A ROOM TO CONTROL ALL LIGHTS WITHIN THE SAME ROOM, UNLESS OTHERWISE NOTED.

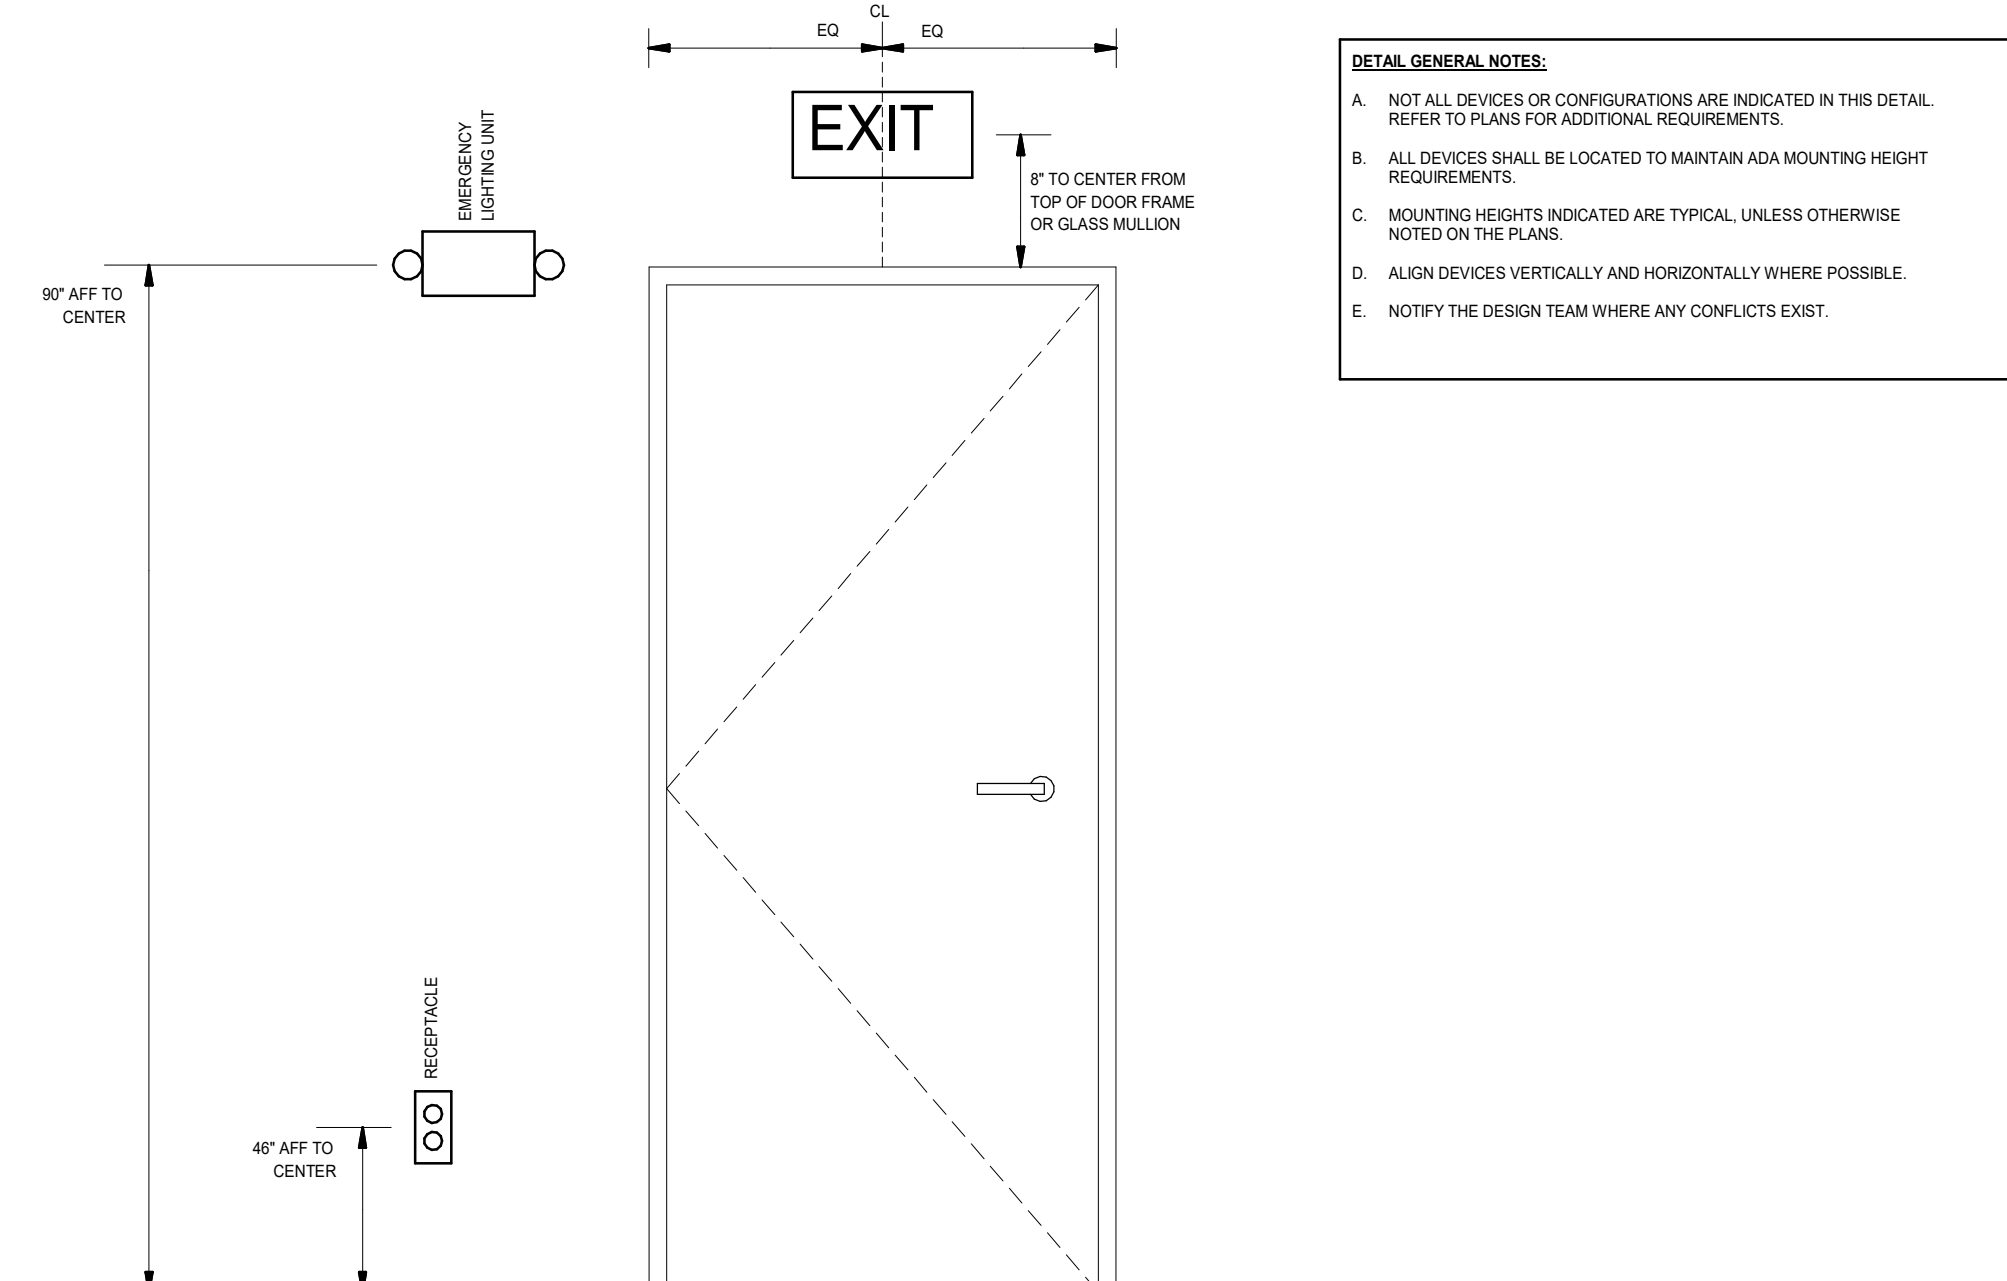

DETAIL GENERAL NOTES:

- A. NOT ALL DEVICES OR CONFIGURATIONS ARE INDICATED IN THIS DETAIL. REFER TO PLANS FOR ADDITIONAL REQUIREMENTS.
- B. ALL DEVICES SHALL BE LOCATED TO MAINTAIN ADA MOUNTING HEIGHT REQUIREMENTS.
- C. MOUNTING HEIGHTS INDICATED ARE TYPICAL, UNLESS OTHERWISE NOTED ON THE PLANS.
- D. ALIGN DEVICES VERTICALLY AND HORIZONTALLY WHERE POSSIBLE.
- E. NOTIFY THE DESIGN TEAM WHERE ANY CONFLICTS EXIST.

1 TYPICAL DEVICE ALIGNMENT DETAIL
SCALE: N.T.S.

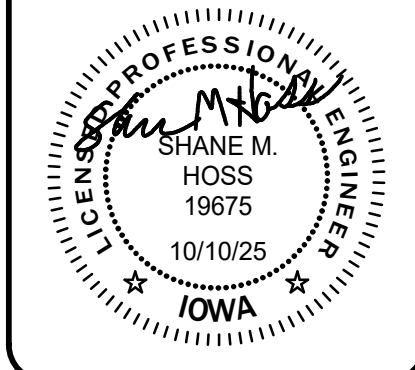

hgm ASSOCIATES INC.
ENGINEERING ARCHITECTURE SURVEYING
council bluffs omaha

This drawing is being made available for your use on this project in accordance with hgm Associates Inc. professional services agreement. hgm Associates Inc. assumes no liability for any use of this drawing for any purpose other than that intended, except in accordance with the terms of the above agreement.

Rev#	Date
CDB	
drawn	
SMH	
designed	
SMH	
approved	
10-10-25	date


HHSSTS NEW GARAGE BLDG
3211 Edgington Ave. Blara, Ia 50627

project no. **106025**
client **IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES**
sheet **9476.00**


ELECTRICAL GENERAL INFORMATION

eti Engineering Technologies Inc.
Mechanical & Electrical Building Solutions
1101 N. 13th St. | Omaha, NE 68102
P 402-330-2722
825 M Street, Suite 200 | Lincoln, NE 68508
P 402-476-1273 | F 402-476-1274
ETI Project No: 2025-132

EG0.0

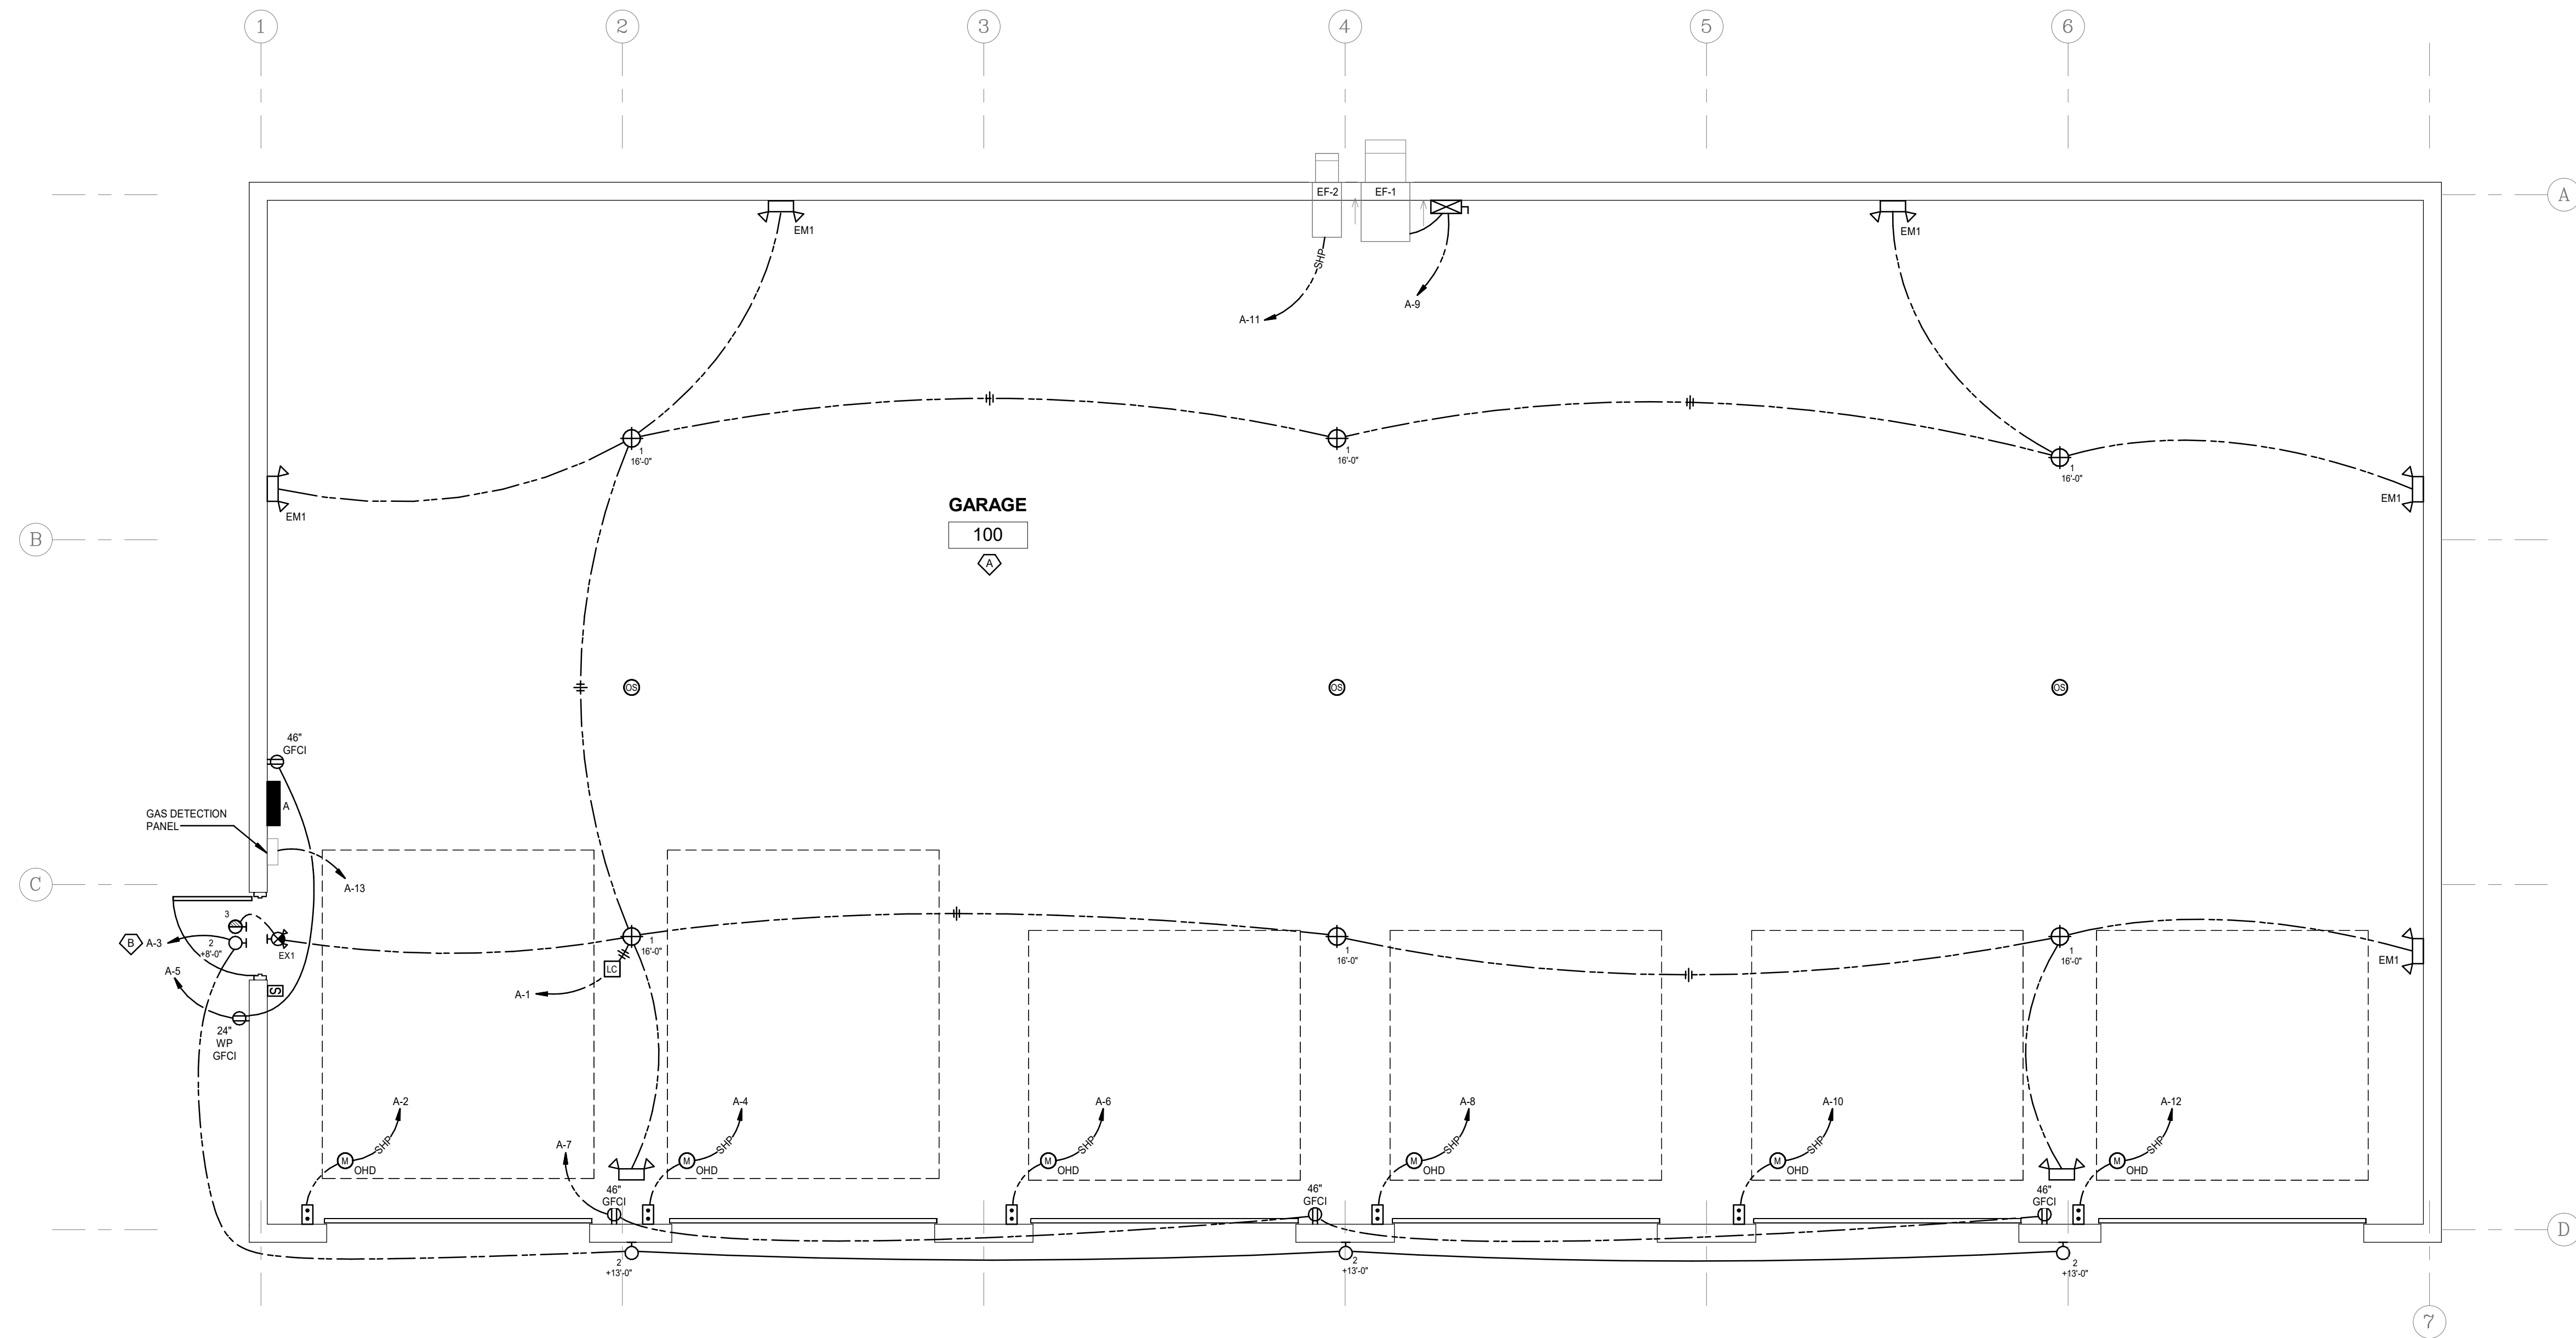

1 ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

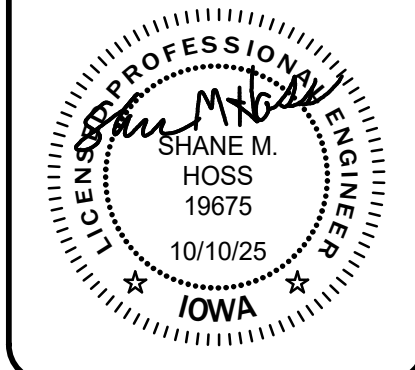

hgm
ASSOCIATES INC.
ENGINEERING ARCHITECTURE SURVEYING
council bluffs omaha

This drawing is being made for use on this project in accordance with hgm professional services. hgm associates inc. assumes no liability for any use of this drawing except in accordance with the terms of the above agreement.

Rev#	Date
CDE	
drawn	
SMH	
designed	
SMH	
approved	
10-10-25	date

project **HHS STS NEW GARAGE BLDG**
3211 Edgington Ave, Eldora, IA 50027
client IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES
sheet **ELECTRICAL PLAN**

project no. **106025**
9476.00
sheet
E1.1

eti Engineering Technologies Inc.
Mechanical & Electrical Building Solutions
1101 N. 13th St. | Omaha, NE 68102
P 402-330-2772
825 M Street, Suite 200 | Lincoln, NE 68508
P 402-476-1273 | F 402-476-1274
ETI Project No: 2025-132

LIGHT FIXTURE SCHEDULE

GENERAL NOTES:
 A. MOUNTING HEIGHT IS TO BOTTOM OF LIGHT FIXTURE, UNLESS OTHERWISE NOTED.

NOTES:
 1. SET COLOR TEMPERATURE TO 4000K AS INDICATED.

MARK	DESCRIPTION	LAMP	COLOR TEMP	LUMENS	WATTS	MOUNTING	MANUFACTURER	CATALOG NUMBER	ACCEPTABLE MANUFACTURERS	NOTES
1	LED ROUND HIGH BAY, POLYCARBONATE LENS	LED	4000K	12000	83	SUSPENDED	LITHONIA	CPBR-AL013-UVOLT-SW9B-80CR-DWH	METALUX, COLUMBIA	1
2	SMALL RECTANGULAR, DIE-CAST ALUMINUM, EXTERIOR LED WALL PACK, IP66 RATED DARK BRONZE FINISH, INTEGRAL PHOTOCELL	LED	3000K	1650	13	WALL	LITHONIA	WPX0-LED-ALO-SWV2-MVOLT-PE-DDBXD-M2	METALUX, COLUMBIA	-
3	THERMOPLASTIC REMOTE HEAD	LED	-	-	-	SURFACE	LITHONIA	ELA-SD-Q-0309-M12	SURE-LITES, DUAL-LITE	-
EM1	THERMOPLASTIC SELF-CONTAINED EMERGENCY LIGHT, DUAL LED HEADS, NICKEL CADMIUM BATTERY	LED	-	-	-	SURFACE	LITHONIA	ELM4L	SURE-LITES, DUAL-LITE	-
EX1	THERMOPLASTIC SELF-CONTAINED EMERGENCY LIGHT, DUAL LED HEADS, NICKEL CADMIUM BATTERY, REMOTE HEAD CAPABLE	LED	-	-	-	SURFACE	LITHONIA	LHQM-W-RG-MVOLT-M6	SURE-LITES, DUAL-LITE	-


LIGHTING CONTROL SCHEDULE

GENERAL NOTES:
 A. WHERE A LOW VOLTAGE SWITCH IS INDICATED ON THE PLANS WITH NO SUBSCRIPT, PROVIDE A 2-BUTTON ON/OFF SWITCH TO CONTROL ALL LIGHTING IN A SPACE. WHERE SUBSCRIPTS ARE INDICATED ON A LOW VOLTAGE SWITCH, PROVIDE SEPARATE ON/OFF BUTTONS FOR EACH SUBSCRIPT (LIGHTING ZONE).
 B. WHERE DIMMING AND LOCAL ON/OFF IS INDICATED FOR A SPACE, PROVIDE LOW VOLTAGE SWITCH WITH SEPARATE RAISE AND LOWER BUTTONS FOR EACH ZONE INDICATED ON THE LOW VOLTAGE SWITCH.
 C. WHERE DIMMING IS INDICATED, PROVIDE DIMMING LOAD CONTROLLERS COMPATIBLE WITH LIGHT FIXTURES BEING PROVIDED. PROVIDE A DIMMING LOAD CONTROLLER FOR EACH LIGHT FIXTURE TYPE WITHIN A COMMON DIMMING ZONE.
 D. REFER TO THE LIGHTING CONTROLS SPECIFICATION FOR ADDITIONAL REQUIREMENTS.

NOTES:
 1. LIGHTING CONTROLS INTEGRAL TO LIGHT FIXTURE, SEE LIGHT FIXTURE SCHEDULE.
 2.
 3.

MARK	MOTION SENSOR SETTINGS			LOCAL ON/OFF	DIMMING	TIME CLOCK	PHOTOCELL	DAYLIGHT HARVESTING (FOOTCANDLES)	BUILDING NETWORKED LIGHTING CONTROL SYSTEM	EXAMPLE SPACE TYPE	NOTES
	MANUAL ON	AUTO ON (%)	TIME TO OFF (MIN)								
A	X	-	20	X	-	-	-	-	-	GARAGE	
B	-	-	-	-	-	-	X	-	-	EXTERIOR BUILDING LIGHTS	

1 RISER DIAGRAM
SCALE: N. T. S.

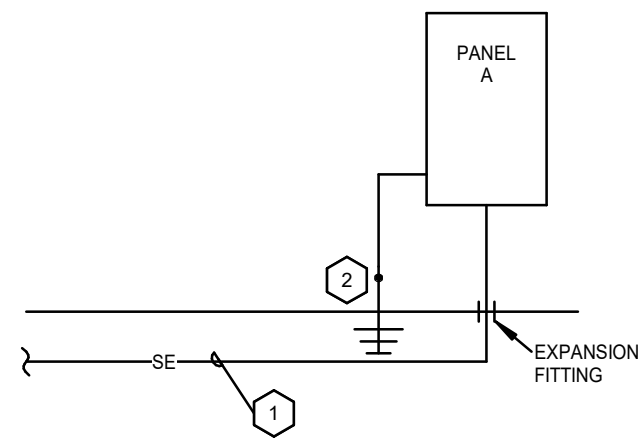

SHEET NOTES

- SECONDARY ELECTRICAL SERVICE. PROVIDE 4#1 AL IN 1.50" CONDUIT. CONTRACTOR TO MAKE ALL CONNECTIONS TO EXISTING PAD MOUNTED TRANSFORMER. COORDINATE WORK WITH THE OWNERS UTILITY DEPARTMENT.
- PROVIDE SERVICE GROUND. SEE DETAIL 2, THIS SHEET.

EQUIPMENT CONNECTION SCHEDULE

GENERAL NOTES:
 A. ALL LOW VOLTAGE HVAC CONTROL WIRING SHALL BE BY THE MECHANICAL CONTRACTOR UNLESS OTHERWISE NOTED.
 B. ALL EXHAUST FANS ARE FURNISHED WITH AN INTEGRAL DISCONNECTING MEANS, UNLESS NOTED OTHERWISE.

MARK	DESCRIPTION	ELECTRICAL		CONDUCTORS		GND SIZE	CONDUIT NO.	CONDUIT SIZE	SAFETY SWITCH	CONTROLLER	CONNECTION	REMARKS		
		KW	HP	VOLTS	PHASE								NO.	SIZE
EF-1	EXHAUST FAN	-	1/3	120	1	2	#12	#12	1	0.75"	INTEGRAL TO CONTROLLER	NEMA 0 COMBO STARTER GENERAL DUTY	DIRECT	INTERLOCK WITH THE GAS DETECTION SYSTEM, PER MANUFACTURERS INSTRUCTIONS.
EF-2	EXHAUST FAN	-	F	120	1	2	#12	#12	1	0.75"	SHP	-	DIRECT	INTERLOCK WITH THE GAS DETECTION SYSTEM, PER MANUFACTURERS INSTRUCTIONS.
OHD	OVERHEAD DOOR	-	F	120	1	2	#12	#12	1	0.75"	SHP	-	DIRECT	-

PANEL SCHEDULE


LOAD DESCRIPTION	LOAD		BREAKER		NO.		PHASE		NEUTRAL		BREAKER		LOAD		LOAD DESCRIPTION
	VA	TYPE	POLES	AMPS	TYPE	NO.	A	B	C	TYPE	AMPS	POLES	TYPE	VA	
INT. LIGHTING	500	L	1	20	-	20	1	X	-	-	20	1	X	800	OVERHEAD DOOR
EXT. LIGHTING	100	L	1	20	-	3	B	4	-	-	20	1	X	800	OVERHEAD DOOR
RECEPT	500	R	1	20	-	5	C	6	-	-	20	1	X	800	OVERHEAD DOOR
RECEPT	600	R	1	20	-	7	A	8	-	-	20	1	X	800	OVERHEAD DOOR
EF-1	1,560	M	1	25	-	9	B	10	-	-	20	1	X	800	OVERHEAD DOOR
EF-2	1,200	M	1	20	-	11	C	12	-	-	20	1	X	800	OVERHEAD DOOR
GAS DETECTION	1,000	X	1	20	-	13	A	14	-	-	20	1	S	1,000	SPARE
SPARE	1,000	S	1	20	-	15	B	16	-	-	20	1	S	1,000	SPARE
SPARE	1,000	S	1	20	-	17	C	18	-	-	20	1	S	1,000	SPARE
SPARE	1,000	S	1	20	-	19	A	20	-	-	20	1	-	-	SPACE ONLY
SPACE ONLY	-	-	1	20	-	21	B	22	-	-	20	1	-	-	SPACE ONLY
SPACE ONLY	-	-	1	20	-	23	C	24	-	-	20	1	-	-	SPACE ONLY
SPACE ONLY	-	-	1	20	-	25	A	26	-	-	20	1	-	-	SPACE ONLY
SPACE ONLY	-	-	1	20	-	27	B	28	-	-	20	1	-	-	SPACE ONLY
SPACE ONLY	-	-	1	20	-	29	C	30	-	-	20	1	-	-	SPACE ONLY

LOAD INFORMATION A = AFCI; G = GFCI; AVG = AFCI/GFCI; ST = SHUNT TRIP; LN = LOCK-ON; LF = LOCK-OFF



TOTAL CONNECTED LOAD	KVA	AMPS
	16	45
EST. MAX DEMAND	13	35

NOTES:
1.

2 SERVICE GROUND BUS DETAIL
SCALE: N. T. S.

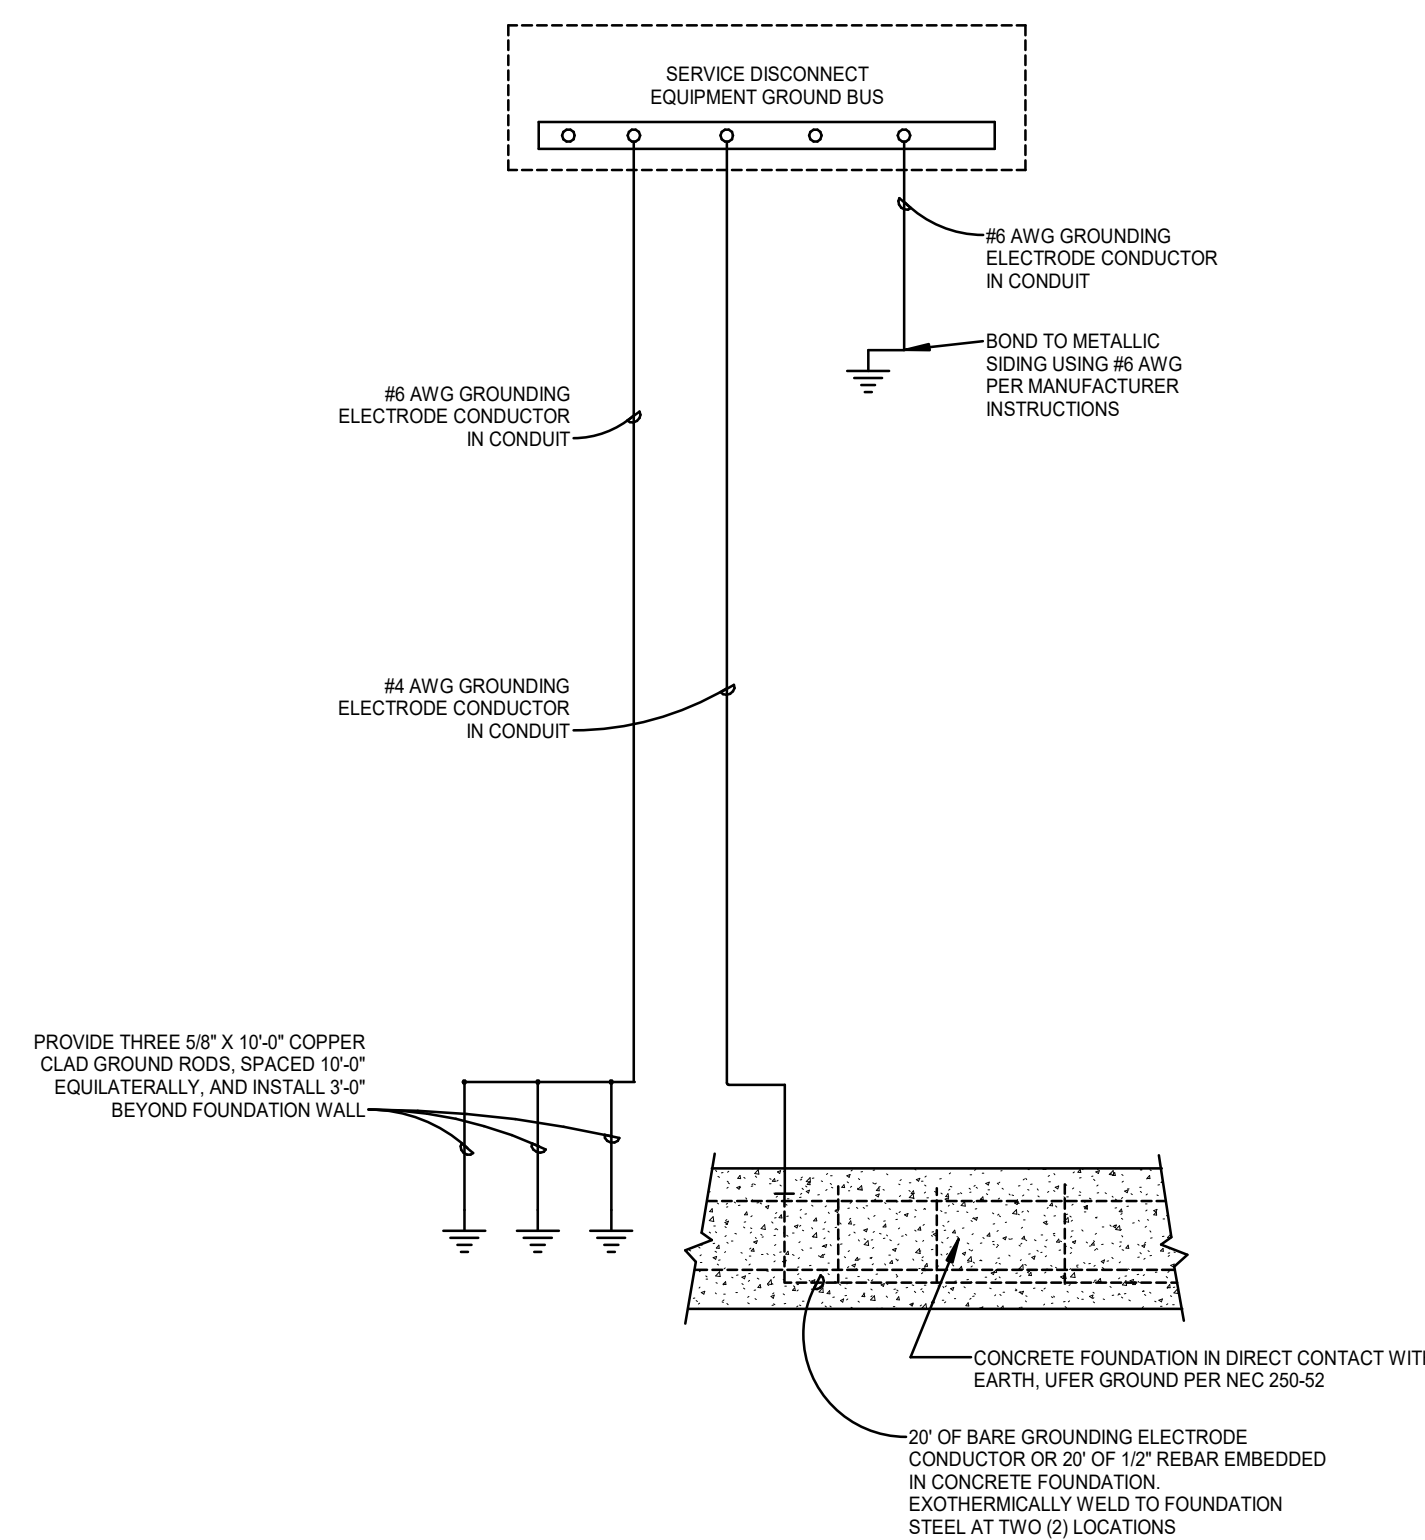

- DETAIL GENERAL NOTES:**
- INSTALL GROUND AND BONDING CONDUCTORS WITH SUFFICIENT SLACK TO AVOID BREAKAGE DUE TO SETTLEMENT AND MOVEMENT OF CONDUCTORS AT ATTACHED POINTS.
 - GROUNDING CONDUCTORS SHALL BE UL LISTED FOR THE PURPOSE INTENDED.
 - BELOW GRADE GROUNDING CONNECTIONS SHALL BE MADE BY USING EXOTHERMIC WELD PROCESS. MATERIALS USED (MOLDS, WELDING METAL, TOOLS ETC.) SHALL BE INSTALLED PER THE MANUFACTURER'S RECOMMENDATIONS AND PROCEDURES.
 - ABOVE GRADE GROUNDING CONNECTIONS SHALL BE MADE USING TWO HOLE CRIMP TYPE COMPRESSION CONNECTIONS. MECHANICAL CONNECTIONS, FITTINGS OR CONNECTIONS THAT DEPEND SOLELY ON SOLDER SHALL NOT BE USED.
 - THE GROUNDING ELECTRODE CONDUCTOR SHALL BE RUN CONTINUOUS FROM THE GROUND BAR. IDENTIFY EACH GROUNDING ELECTRODE WITH AN IDENTIFICATION LABEL AT ITS SOURCE.

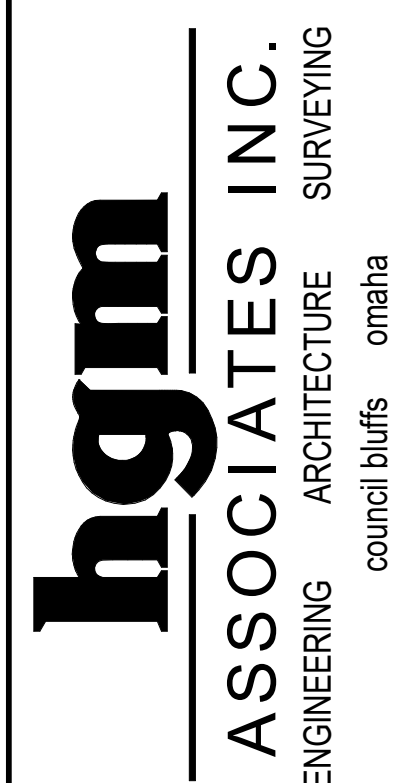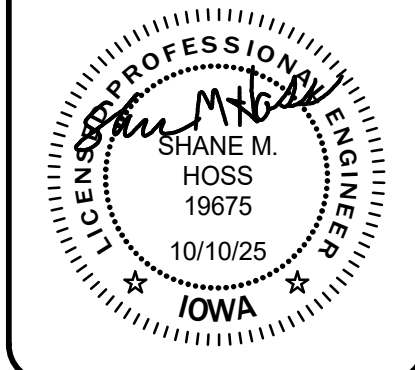

This drawing is being made for use on this project in accordance with hgm professional services. hgm associates inc. assumes no liability for any use of this drawing except in accordance with the terms of the above agreement.

Rev#	Date
CDE	drawn
SMH	designed
SMH	approved
10-10-25	date

project: **HHS STS NEW GARAGE BLDG**
3211 Edgington Ave, Eldora, IA 50027

client: **IOWA DEPARTMENT OF ADMINISTRATIVE SERVICES**

sheet: **ELECTRICAL SCHEDULES AND RISERS**

project no. **106025**
sheet **9476.00**

E2.1