



To: Prospective Offerors (emailed to known RFP holders)

Date: July 19<sup>st</sup>, 2018

From: Randall Stapp, Purchasing Agent  
Iowa Department of Administrative Services-Procurement Services  
Phone (515)-242-5005; e-mail: [randall.stapp@iowa.gov](mailto:randall.stapp@iowa.gov)

RE: **Addendum No. 1**, to RFP0218335036 DHS IMHI Witte Building Water Main Replacement

**The following additions, changes, and clarifications are hereby made by this Addendum;**

**Addition to original scope:**

- 1) Proposal shall address the following additional items:
  - New Water Main for Witte Building
- 2) Please see attached files:
  - Pre-proposal sign in (1 page)
  - Site Map (1 page)
- 3) Proposals can be emailed to Randall Stapp ([randall.stapp@iowa.gov](mailto:randall.stapp@iowa.gov))

**Questions:**

- 1.) Is there a construction budget for the project? A> Yes, The preliminary construction budget is \$45,000.
- 2.) Are there copies of general maps for current existing pipe network A> See attached site map
- 3.) Confirmed (usually on a map or figure drawing) main construction from Point A to Point B? A> See attached site map
- 4.) Proposed lineal feet of improvements? A> Approximately 250 LF
- 5.) Existing material of construction? A> Sand Cast Pipe, will be abandoned in place
- 6.) Preferred material of construction for new? A> PVC
- 7.) Existing main size/diameter, and if there are any proposed changes? A> existing pipe is 4", new main will be 6"
- 8.) Any maps (preferably) or other information in regard to other underground utilities A> facility will locate utilities on the property
- 9.) Any other special conditions, soils, obstacles, known issues, etc? A> None known at this time
- 10.) City water department Contact: Mark Loloff 319-334-3750 the email is [wwplt@indytel.com](mailto:wwplt@indytel.com)

Please acknowledge addendum #1 in your proposal. Thank You



**PROJECT NAME: DHSIMHI WITTE BUILDING WATER MAIN REPLACEMENT**

**PROJECT #: DAS #8978.00**

**MEETING LOCATION: IMHI, INDEPENDENCE, IA-REYNOLDS BUILDING**

**MEETING TYPE: DESIGN KICK-OFF MEETING**

**DATE AND TIME: TUESDAY, JULY 10<sup>TH</sup>, 2018, 11:00 AM**

**WISCONSIN**

311 Financial Way

Suite 300

Wausau, WI 54401

715.842.2222

715.848.8088

## IOWA

317 6<sup>th</sup> Avenue

Suite 720

Des Moines, IA 50309

515.232.6443

515.288.0471

313 E 5<sup>th</sup> Street

Waterloo, IA 50703

319.232.6443


319.233.3191



[www.samuelsgroup.net](http://www.samuelsgroup.net)

[illegible]



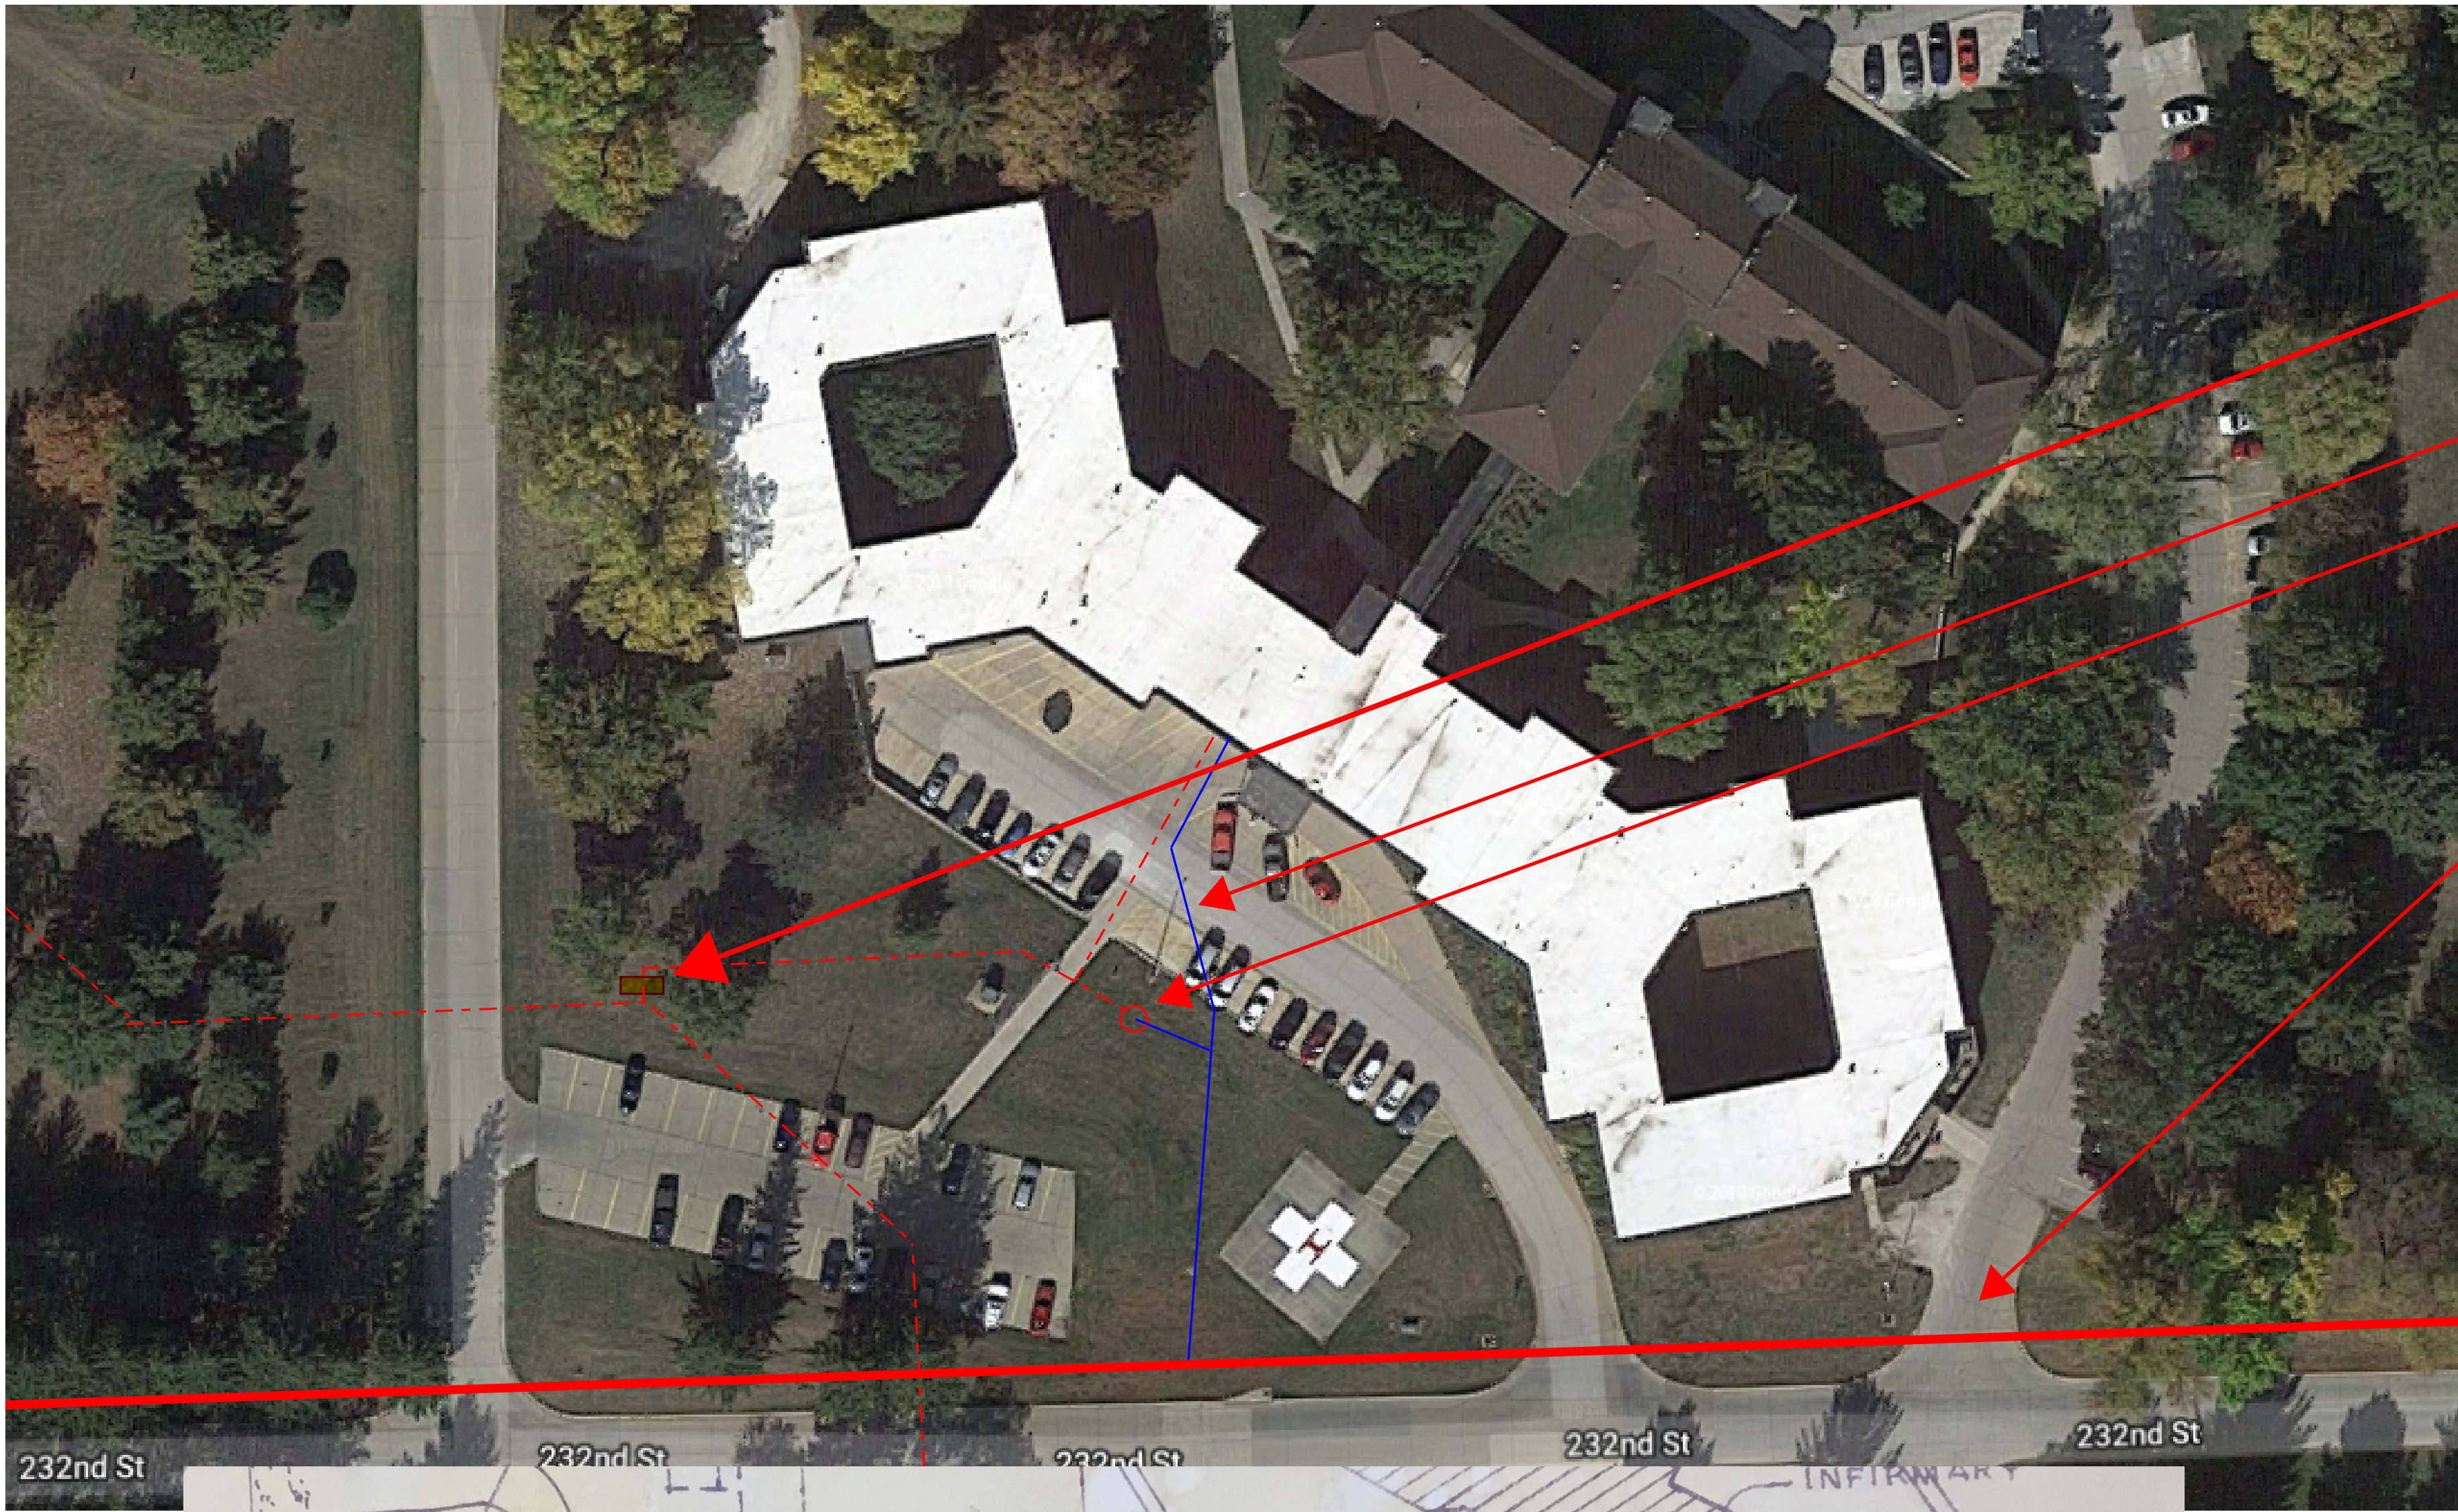

Existing 6" valve for Building Main Needs to be capped


Proposed location of proposed new 6" water main. Approximately 235 lineal feet

Proposed location of New Hydrant

Existing 12" City Water Main



Existing Water Main

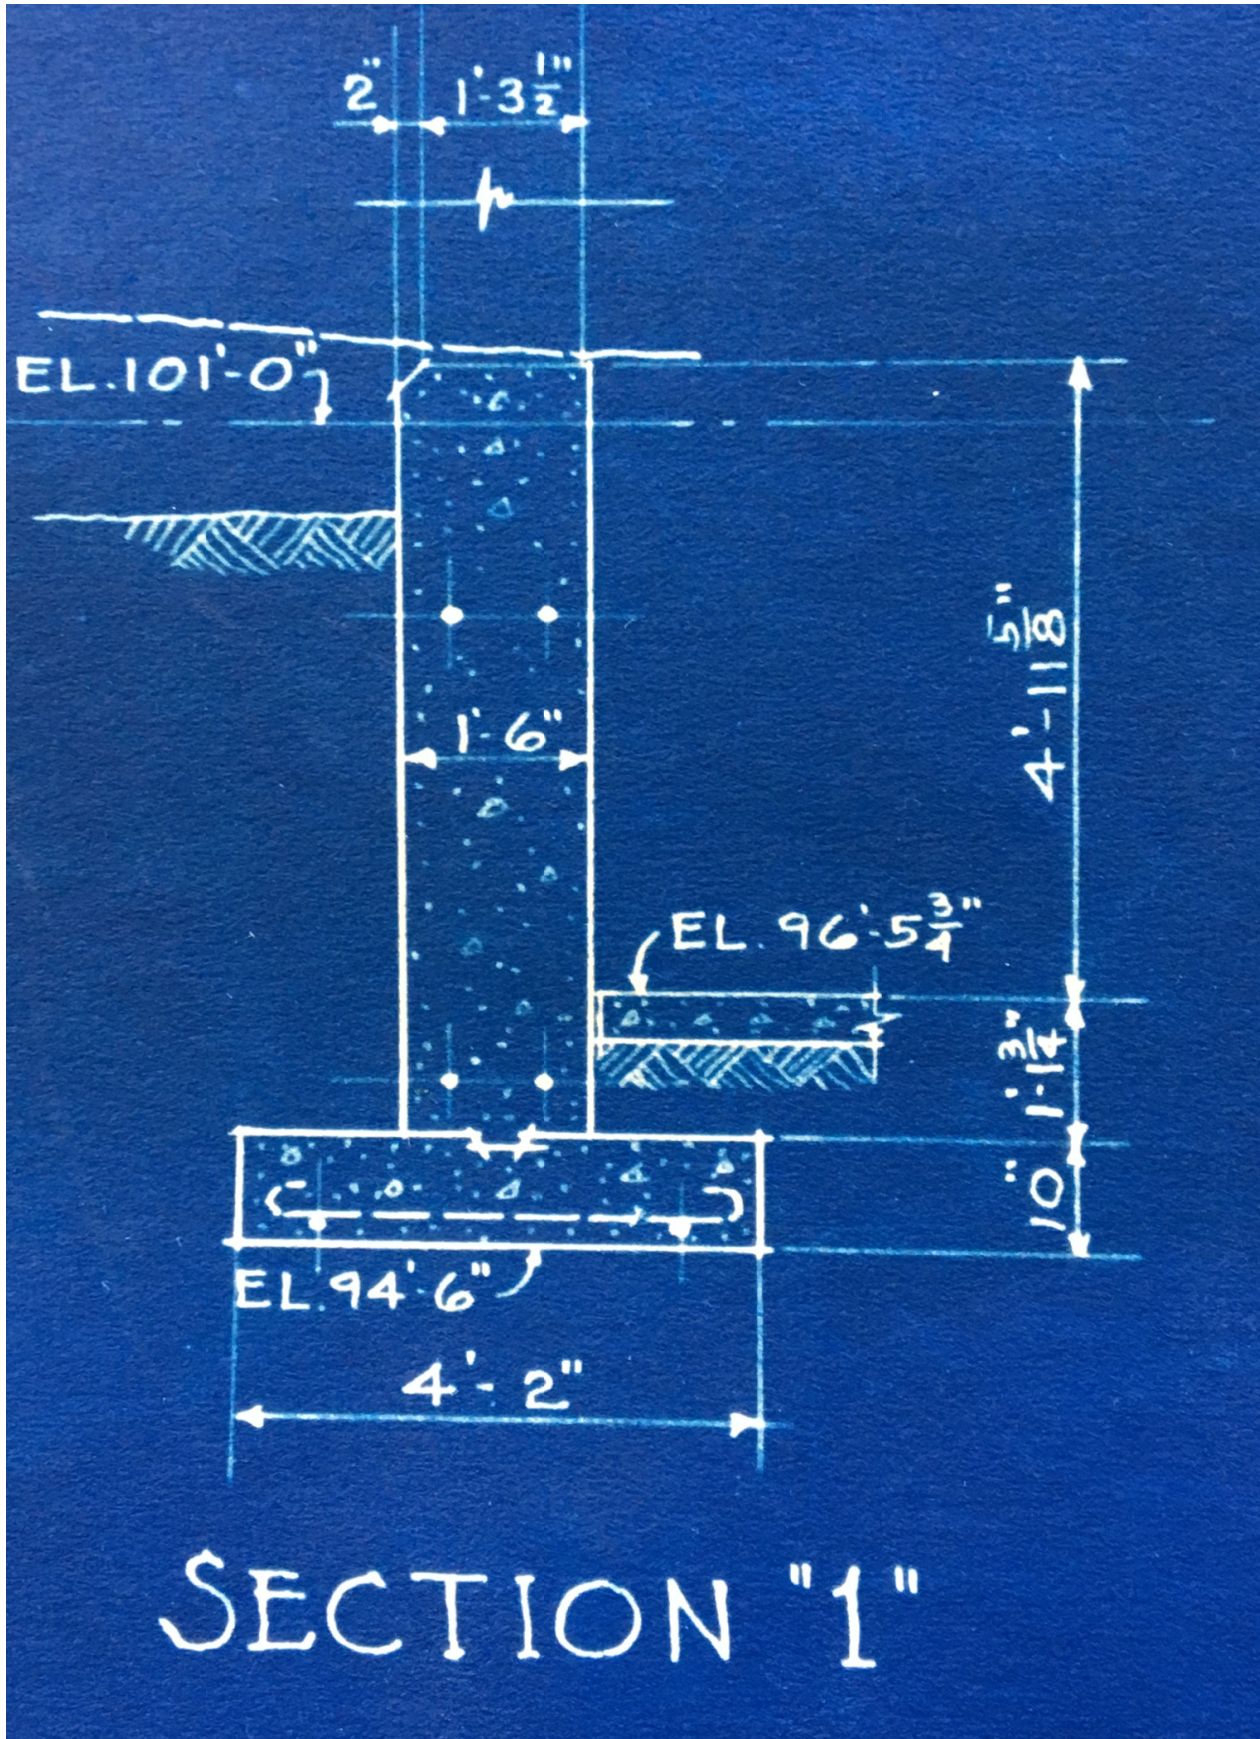

Existing Building Footing